


CERTIFICATE

Certified Passive House Component

Component-ID 0772fx02 valid until 31st December 2017

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

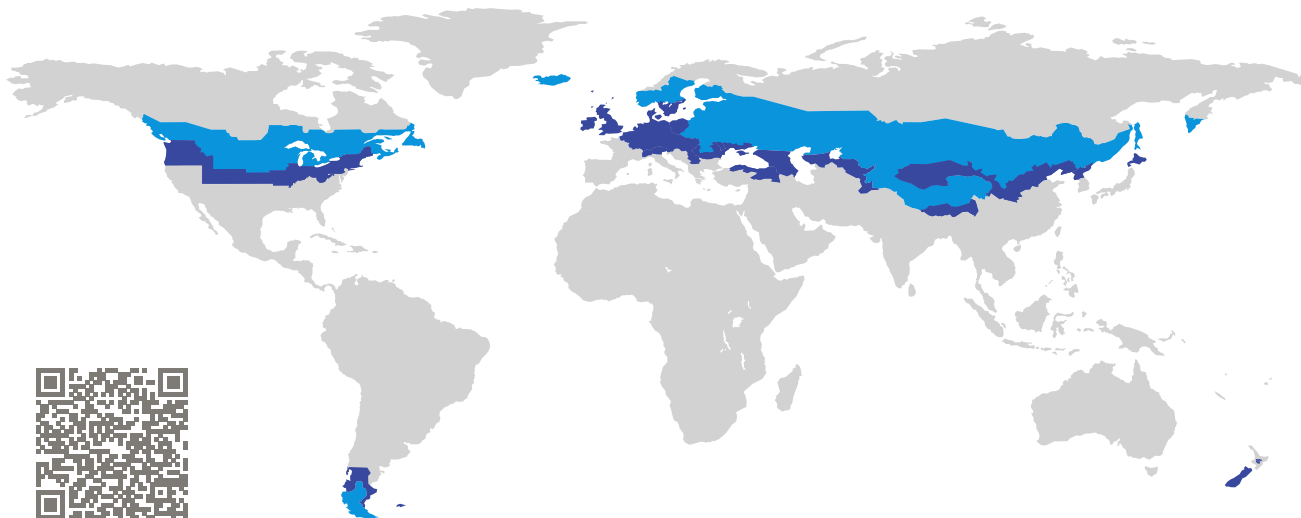


Category: **Fixed window**
Manufacturer: **Pazen Fenster+Technik GmbH,
Wittlich,
Germany**
Product name: **ENERSign plus fix**

**This certificate was awarded based on the following
criteria for the cold climate zone**

Comfort $U_W = 0.59 \leq 0.60 \text{ W}/(\text{m}^2 \text{ K})$
 $U_{W,\text{installed}} \leq 0.65 \text{ W}/(\text{m}^2 \text{ K})$
with $U_g = 0.52 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene $f_{Rsi=0.25} \geq 0.75$

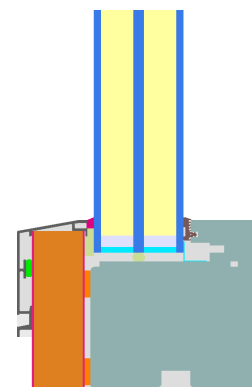

Passive House
efficiency class

phE

phD

phC

phB

phA


cold climate



phA

**CERTIFIED
COMPONENT**

Passive House Institute

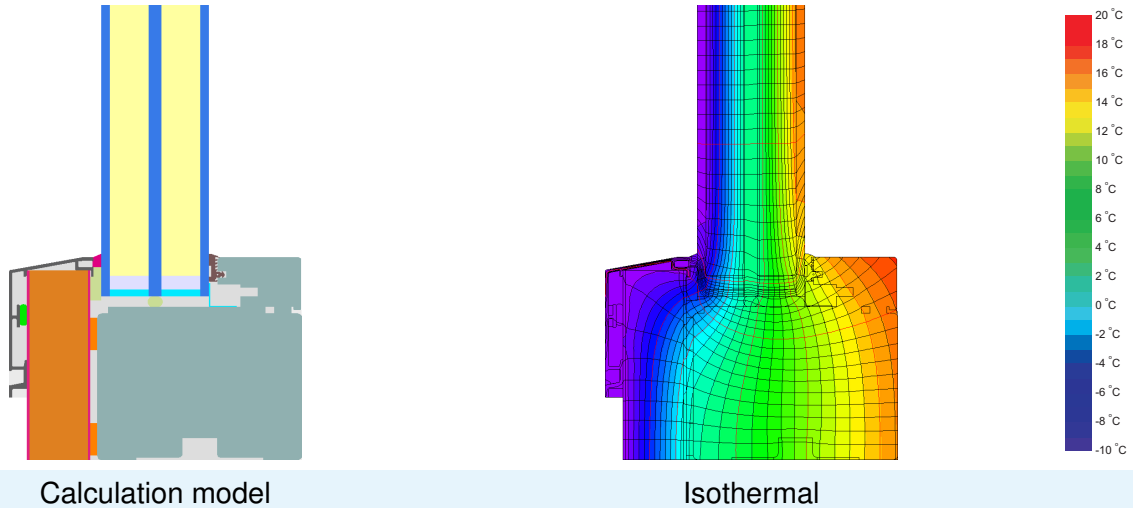

Description

Aluminium clad timber frame (0,11 W/(mK)), insulated by XPS-Foam (0,028 W/(mK)). The glazing is carried by ENERcell (0,06 W/(mK)). Pane thickness: 50 mm (4/18/6/18/4), rebate depth: 17 mm, spacer: SWISSPACER Ultimate with polyurethane as secondary seal

Explanation






The window U-values were calculated for the test window size of 1.23 m × 1.48 m with $U_g = 0.52 \text{ W}/(\text{m}^2 \text{ K})$. If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	$U_g =$	0.52	0.60	0.43	0.35	W/(m ² K)
		↓	↓	↓	↓	
Window	$U_W =$	0.59	0.65	0.53	0.47	W/(m ² K)

Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.




Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Frame values			Frame width b_f mm	U -value frame U_f W/(m ² K)	Ψ -glass edge Ψ_g W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Top fixed	(tof)		94	0.58	0.023	0.78
Side fixed	(sf)		94	0.58	0.023	0.78
Bottom fixed	(bof)		94	0.58	0.023	0.78
Mullion fixed	(m)		112	0.63	0.022	0.78
Mullion 2 casements	(m2)		112	0.63	0.022	0.78

Spacer: SWISSPACER Ultimate

Secondary seal: Polyurethane

Validated installations

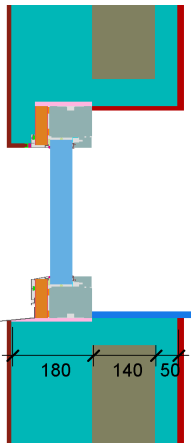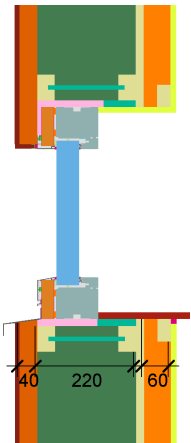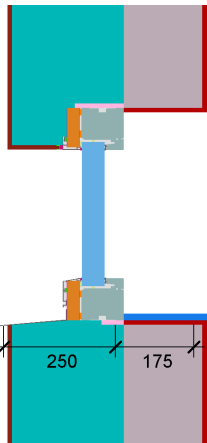Insulated formwork blocks		Timber frame		EIFS	
					
$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)
Top	0.001	Top	0.012	Top	-0.003
Side	0.001	Side	0.012	Side	-0.003
Bottom	0.008	Bottom	0.019	Bottom	0.009
$U_{W,installed} = 0.60$ W/(m ² K)		$U_{W,installed} = 0.64$ W/(m ² K)		$U_{W,installed} = 0.59$ W/(m ² K)	

