


CERTIFICATE

Certified Passive House Component

Component-ID 0177cw03 valid until 31st December 2017

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

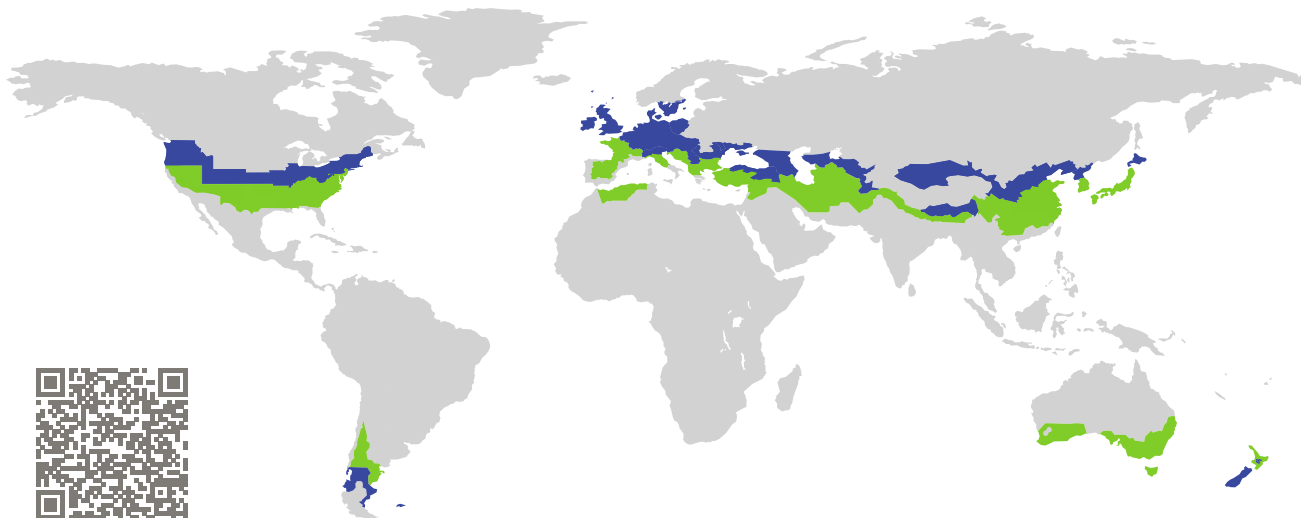


Category: **Curtain Wall**
Manufacturer: **Stabalux GmbH,
Bonn,
Germany**
Product name: **Stabalux H, System 60 PH**

**This certificate was awarded based on the following
criteria for the cool, temperate climate zone**

Comfort $U_{CW} = 0.78 \leq 0.80 \text{ W}/(\text{m}^2 \text{ K})$
 $U_{CW, \text{installed}} \leq 0.85 \text{ W}/(\text{m}^2 \text{ K})$
with $U_g = 0.70 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene $f_{Rsi=0.20} \geq 0.70$

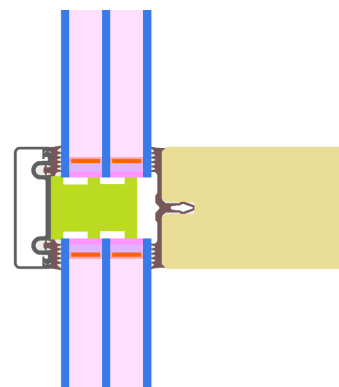

cool, temperate climate



**CERTIFIED
COMPONENT**

Passive House Institute

Passive House
efficiency class

phE


phD

phC

phB

phA

www.passivehouse.com

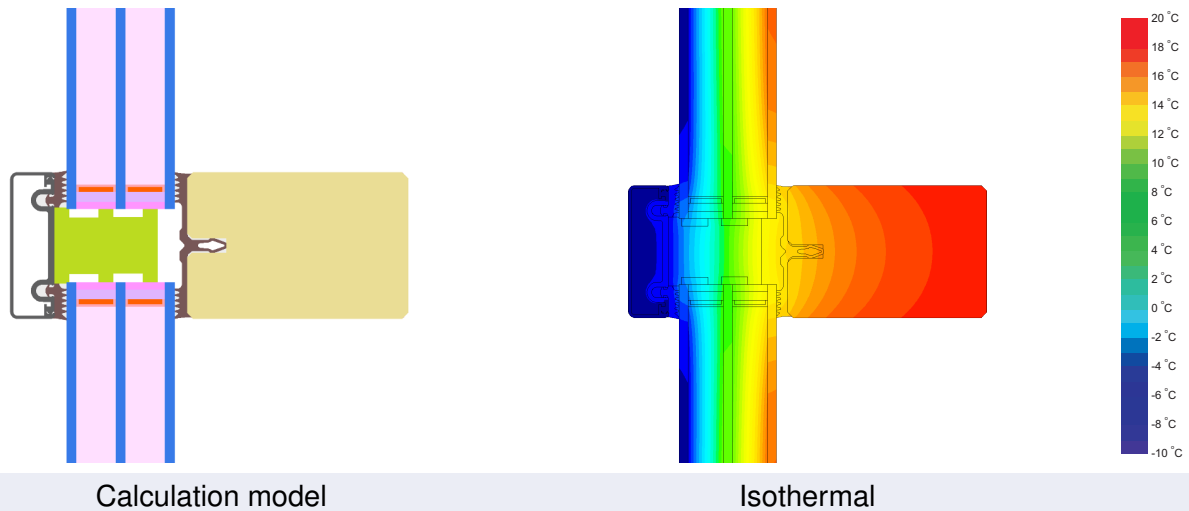

Description

Timber-aluminium curtain wall system with rebate insulation (0.035 W/(mK)). Plastic glass carrier with metal screws. Glazing thickness: 44 mm (4/16/4/16/4), glass intersection: 15 mm, used spacer: Swisspacer V. With an aluminium glass carrier is the thermal bridge 0.017 W/K.

Explanation






The element U-values were calculated for the test element size of 1.20 m × 2.50 m with $U_g = 0.70 \text{ W}/(\text{m}^2 \text{ K})$. If a higher quality glazing is used, the element U-values will improve as follows:

| | | | | | | |
|---------|----------|------|------|------|------|----------------------|
| Glazing | $U_g =$ | 0.70 | 0.66 | 0.62 | 0.58 | W/(m ² K) |
| | | ↓ | ↓ | ↓ | ↓ | |
| Element | U_{CW} | 0.78 | 0.75 | 0.71 | 0.67 | W/(m ² K) |


Transparent building components are sorted into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components that have been certified for climate zones with higher thermal requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

| Frame values | | | Frame width b_f mm | U -value frame U_f^1 W/(m ² K) | Ψ -glass edge Ψ_g W/(m K) | Temp. Factor $f_{Rsi=0.20}$ [-] |
|---|-------|---|-----------------------------|---|---|---------------------------------------|
| Top fixed | (tof) |  | 60 | 0.83 | 0.029 | 0.78 |
| Side fixed | (sf) |  | 60 | 0.83 | 0.029 | 0.78 |
| Bottom fixed | (bof) |  | 60 | 0.83 | 0.029 | 0.78 |
| Mullion fixed | (m) |  | 60 | 0.83 | 0.029 | 0.78 |
| Transom fixed | (tf) |  | 60 | 0.83 | 0.029 | 0.78 |
| Spacer: SWISSPACER V | | | Secondary seal: Polysulfide | | | |
| Thermal glass carrier bridge ² $\chi_{GT} = 0.006$ W/K | | | | | | |

Validated installations
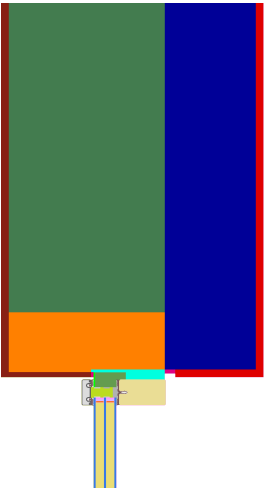
| Exterior insulation and finishing system (EIFS) (fixed glazed) | |
|---|---------|
| $U_{Wall} = 0.15$ W/(m ² K) | |
|  | |
| $\Psi_{install}$ | W/(m K) |
| Top | 0.048 |
| Left | 0.048 |
| Right | 0.048 |
| Bottom | 0.048 |
| $U_{W,installed} = 0.85$ W/(m ² K) | |

¹ Includes $\Delta U = 0.20$ W/(m² K). Determined through 3D - FEM Simulation

² Determined through 3D - FEM Simulation . Glass carrier type : Non-Metallic Glass Carrier with Screws

