


CERTIFICATE

Certified Passive House Component

Component-ID 0698wi03 valid until 31st December 2018

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

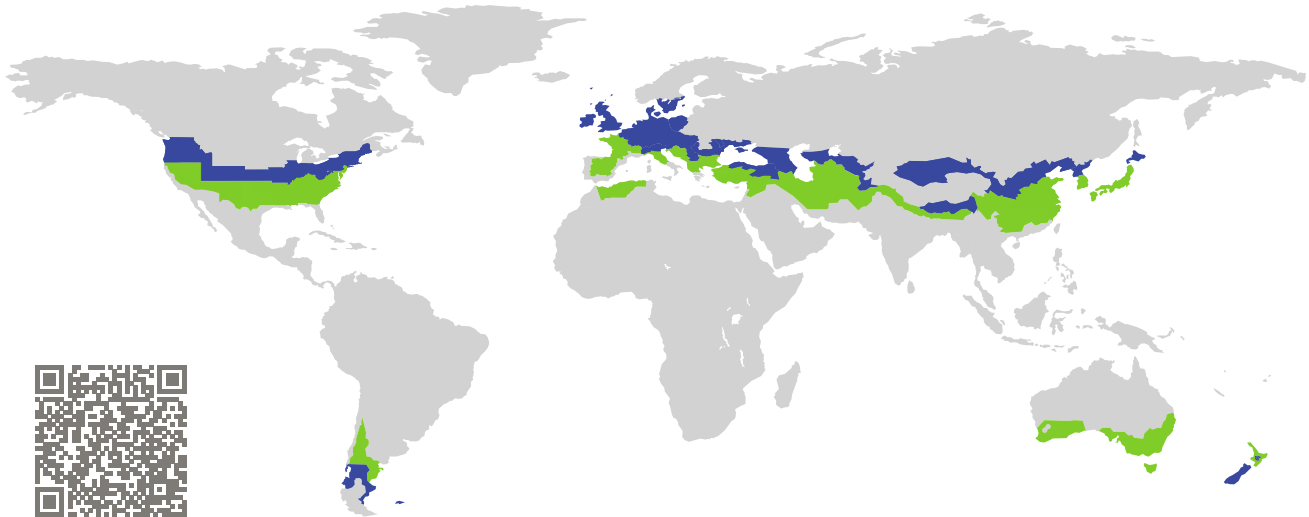


Category: **Window Frame (Coupled Window)**
Manufacturer: **Svenska Fönster AB,
Edsbyn,
Sweden**
Product name: **Intakt Passiv**

**This certificate was awarded based on the following
criteria for the cool, temperate climate zone**

Comfort $U_W = 0.79 \leq 0.80 \text{ W}/(\text{m}^2 \text{ K})$
 $U_{W,\text{installed}} \leq 0.85 \text{ W}/(\text{m}^2 \text{ K})$
with $U_g^1 = 0.62 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene $f_{Rsi=0.25} \geq 0.70$

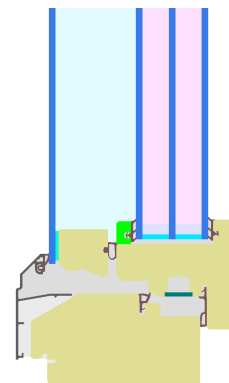

¹The specified U_g value is determined using the reference glazing of the climate zone in conjunction with the additional pane.

Passive House
efficiency class

phE

phD

phC

phB


phA

cool, temperate climate



**CERTIFIED
COMPONENT**

Passive House Institute

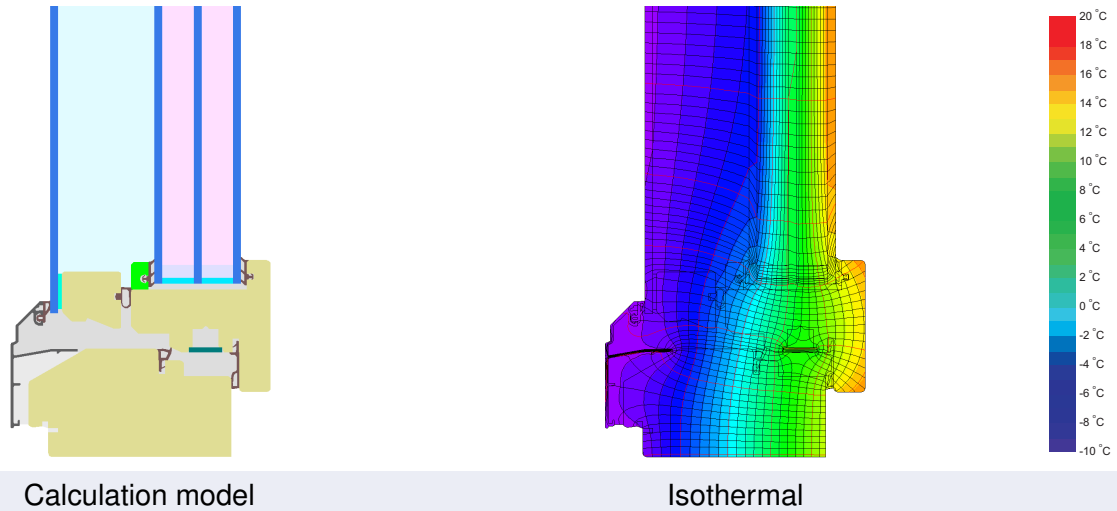

Description

Coupled timber Window frame (0.13 W/(mK)). 4/49 Air/4/16/4/16/4. Spacer: SWISSPACER Ultimate with polyurethane as secondary seal.

Explanation

The window U-values were calculated for the test window size of 1.23 m × 1.48 m with $U_g = 0.70$ W/(m² K). If a higher quality glazing is used, the window U-values will improve as follows:





Glazing ²	$U_g =$	0.70	0.58	0.52	0.64	W/(m ² K)
		↓	↓	↓	↓	
Window	$U_W =$	0.79	0.72	0.68	0.75	W/(m ² K)

Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.




The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

²The specified U_g values refer to the thermally decisive pane.

Frame values			Frame width b_f mm	U -value frame U_f W/(m ² K)	Ψ -panel edge Ψ_g W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Top	(to)		100	1.01	0.023	0.72
Side	(s)		100	1.01	0.023	0.72
Bottom	(bo)		100	1.08	0.021	0.72
Mullion 1 casement	(m1)		156	1.00	0.022	0.72
			Spacer: SWISSPACER Ultimate		Secondary seal: Polyurethane	

Validated installations

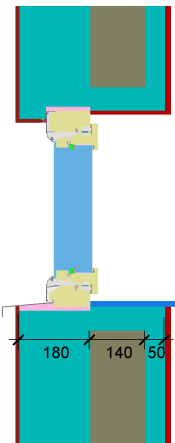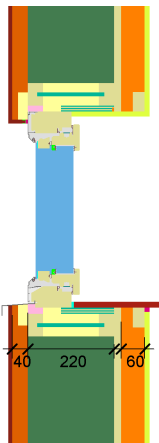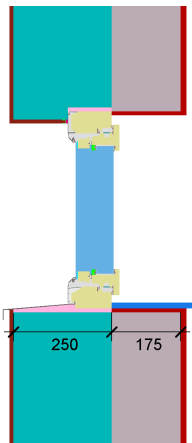Insulated formwork blocks		Timber frame		EIFS	
					
$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)
Top	0.011	Top	0.020	Top	0.016
Side	0.011	Side	0.020	Side	0.016
Bottom	0.015	Bottom	0.020	Bottom	0.020
$U_{W,installed} = 0.82$ W/(m ² K)		$U_{W,installed} = 0.85$ W/(m ² K)		$U_{W,installed} = 0.84$ W/(m ² K)	

