


CERTIFICATE

Certified Passive House Component

Component-ID 1516cw03 valid until 31st December 2021

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

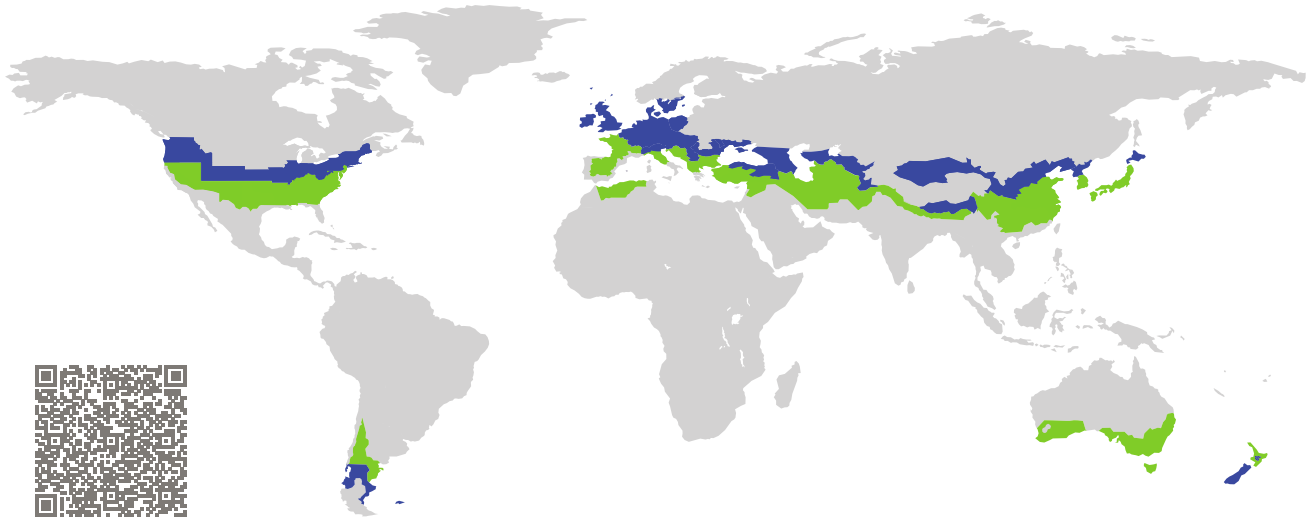


Category: **Curtain Wall**
Manufacturer: **Harbin Huaxing Energy-Saving Door and Window Co., Ltd., Harbin Heilongjiang, China**
Product name: **HS60PCW**

This certificate was awarded based on the following criteria for the cool, temperate climate zone

Comfort $U_{CW} = 0.79 \leq 0.80 \text{ W}/(\text{m}^2 \text{ K})$
 $U_{CW, \text{installed}} \leq 0.85 \text{ W}/(\text{m}^2 \text{ K})$
with $U_g = 0.70 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene $f_{Rsi=0.25} \geq 0.70$

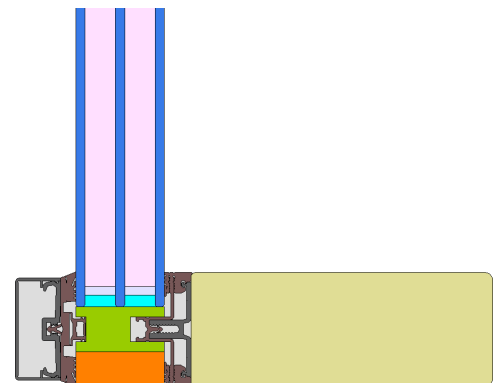

Passive House
efficiency class

phE

phD

phC


phB

phA

phA+


www.passivehouse.com

cool, temperate climate



**CERTIFIED
COMPONENT**

Passive House Institute

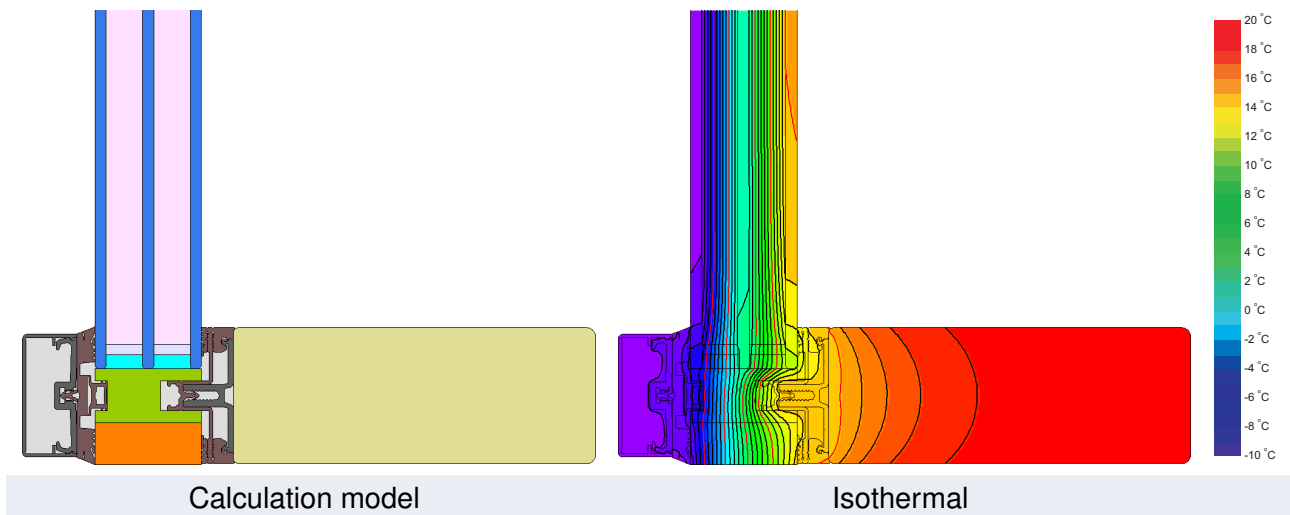

Description

Timber-Aluminium facade, aluminium - pressure-plate , polyethylene-foam-insulation inside the rebate (0.038 W/mK). Pane thickness: 47 mm (5/16/5/16/5), rebate depth: 18 mm, spacer: Super Spacer Premium with butyl as secondary seal

Explanation








The element U-values were calculated for the test element size of 1.20 m × 2.50 m with $U_g = 0.70 \text{ W}/(\text{m}^2 \text{ K})$. If a higher quality glazing is used, the element U-values will improve as follows:

Glazing	$U_g =$	0.70	0.64	0.62	0.58	W/(m ² K)
		↓	↓	↓	↓	
Element	U_{CW}	0.79	0.73	0.71	0.68	W/(m ² K)




Transparent building components are sorted into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components that have been certified for climate zones with higher thermal requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Frame values			Frame width b_f mm	U -value frame U_f^1 W/(m ² K)	Ψ -panel edge Ψ_g W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Top fixed	(tof)		60	0.91	0.030	0.77
Side fixed	(sf)		60	0.91	0.030	0.77
Bottom fixed	(bof)		60	0.91	0.030	0.77
Mullion fixed	(m)		60	0.87	0.030	0.75
Mullion 1 casement	(m1)		175	0.87	0.028	0.71
Transom fixed	(tf)		60	0.87	0.030	0.78
Transom 1 casement	(t1)		175	0.87	0.028	0.71
Spacer: Super Spacer Premium			Secondary seal: Butyl			
Thermal glass carrier bridge ² $\chi_{GT} = 0.004$ W/K						

Validated installations

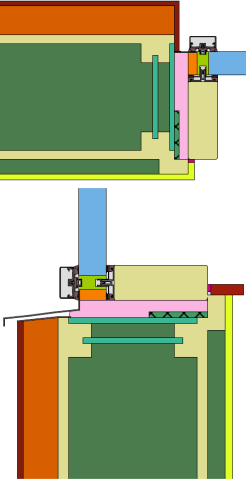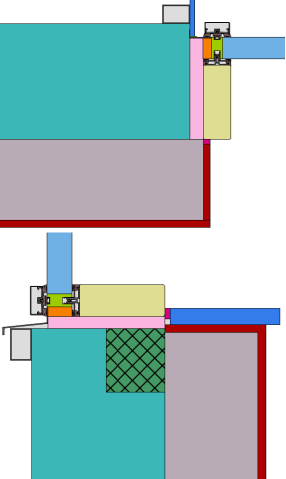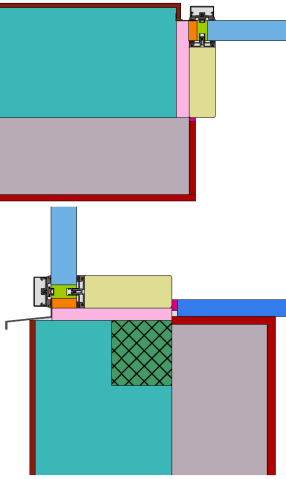Lightweight timber (fixed glazed)		Ventilated facade (fixed glazing)		Exterior insulation and finishing system (EIFS) (fixed glazed)	
$U_{Wall} = 0.13$ W/(m ² K)		$U_{Wall} = 0.13$ W/(m ² K)		$U_{Wall} = 0.13$ W/(m ² K)	
					
$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)
Top	0.032	Top	0.013	Top	0.013
Left	0.038	Left	0.013	Left	0.012
Right	0.038	Right	0.013	Right	0.012
Bottom	0.032	Bottom	0.013	Bottom	0.013
$U_{W,installed} = 0.84$ W/(m ² K)		$U_{W,installed} = 0.81$ W/(m ² K)		$U_{W,installed} = 0.81$ W/(m ² K)	

¹ Includes $\Delta U = 0.14$ W/(m² K). Determined through 3D - FEM Simulation

² Determined through 3D - FEM Simulation . Glass carrier type : Non-Metallic Glass Carrier with Screws

