


# CERTIFICATE

Certified Passive House Component

Component-ID 1024cw03 valid until 31st December 2019

Passive House Institute  
Dr. Wolfgang Feist  
64283 Darmstadt  
Germany

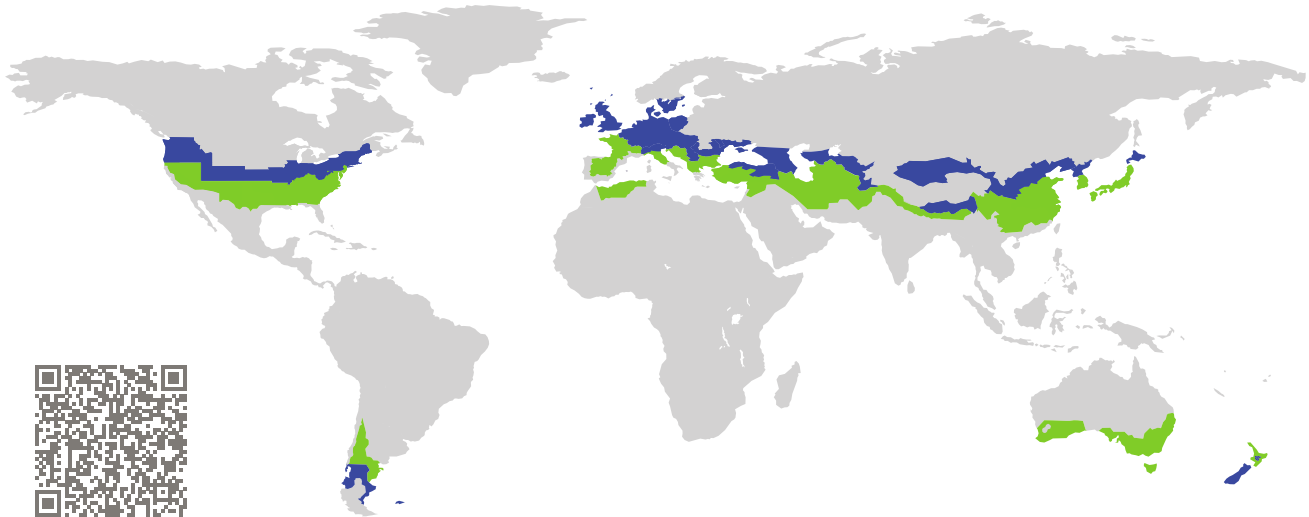


Category: **Curtain Wall**  
Manufacturer: **Kawneer UK Limited,  
Runcorn,  
United Kingdom**  
Product name: **AA 100**

**This certificate was awarded based on the following  
criteria for the cool, temperate climate zone**

Comfort  $U_{CW} = 0.80 \leq 0.80 \text{ W}/(\text{m}^2 \text{ K})$   
 $U_{CW, \text{installed}} \leq 0.85 \text{ W}/(\text{m}^2 \text{ K})$   
with  $U_g = 0.70 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene  $f_{Rsi=0.25} \geq 0.70$

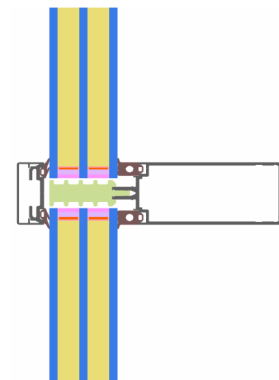

Passive House  
efficiency class

phE

phD

phC


phB

phA

phA+


[www.passivehouse.com](http://www.passivehouse.com)

cool, temperate climate



**CERTIFIED  
COMPONENT**

Passive House Institute

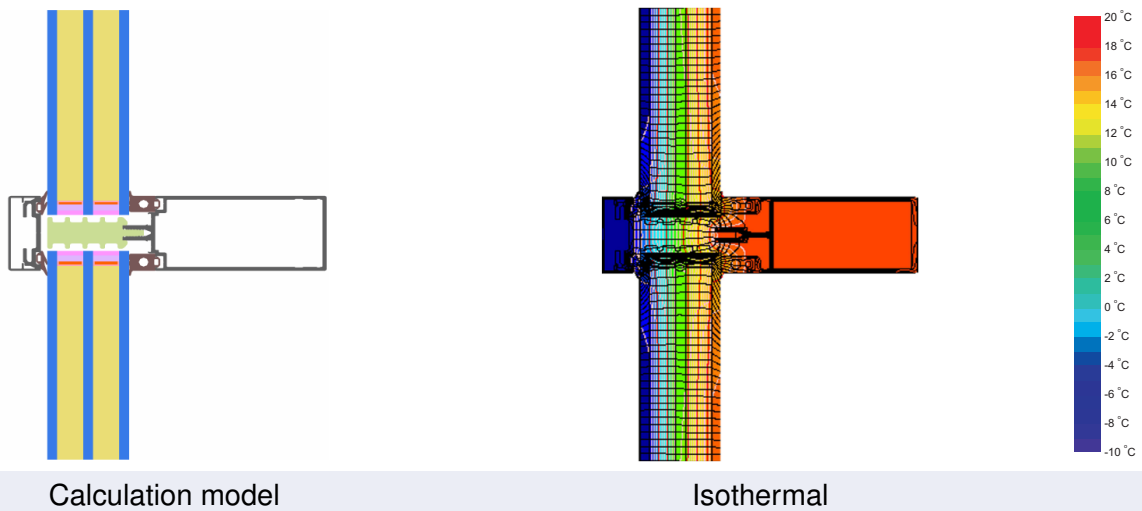

### Description

Aluminium mullion and transom facade, cover- and pressure- strip of aluminium. PE-insulator (0.038 W/(mK) inside of the rebate. The losses by the screws have been determined by measurement, the losses caused by the glass carrier by 3D-simulation (PHI). Used Pane: 54 mm (6/18/6/18/6), intersection of the Glass: 14 mm. Used spacer: Swisspacer V

### Explanation







The element U-values were calculated for the test element size of 1.20 m × 2.50 m with  $U_g = 0.70 \text{ W}/(\text{m}^2 \text{ K})$ . If a higher quality glazing is used, the element U-values will improve as follows:

|         |          |      |      |      |      |                      |
|---------|----------|------|------|------|------|----------------------|
| Glazing | $U_g =$  | 0.70 | 0.64 | 0.53 | 0.48 | W/(m <sup>2</sup> K) |
|         |          | ↓    | ↓    | ↓    | ↓    |                      |
| Element | $U_{CW}$ | 0.80 | 0.74 | 0.64 | 0.59 | W/(m <sup>2</sup> K) |

Transparent building components are sorted into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components that have been certified for climate zones with higher thermal requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.


Further information relating to certification can be found on [www.passivehouse.com](http://www.passivehouse.com) and [passipedia.org](http://passipedia.org).

| Frame values  |       |   | Frame width<br>$b_f$<br>mm  | $U$ -value frame<br>$U_f^1$<br>W/(m <sup>2</sup> K) | $\Psi$ -panel edge<br>$\Psi_g$<br>W/(m K) | Temp. Factor<br>$f_{Rsi=0.25}$<br>[-] |
|---|-------|---|-----------------------------|---|---|---------------------------------------|
| Top fixed   | (tof) |  | 50                          | 0.81  | 0.037                                     | 0.79                                  |
| Side fixed  | (sf)  |  | 50                          | 0.81  | 0.037                                     | 0.79                                  |
| Bottom fixed  | (bof) |  | 50                          | 0.81  | 0.037                                     | 0.79                                  |
| Mullion fixed   | (m)   |  | 50                          | 0.81  | 0.037                                     | 0.79                                  |
| Transom fixed   | (tf)  |  | 50                          | 0.81  | 0.037                                     | 0.79                                  |
| Transom 1 casement  | (t1)  |  | 180                         | 1.30  | 0.031                                     | 0.79                                  |
| Spacer: SWISSPACER V  |       |   | Secondary seal: Polysulfide |   |   |                                       |
| Thermal glass carrier bridge <sup>2</sup> $\chi_{GT} = 0.003$ W/K |       |   |                             |   |   |                                       |

### Validated installations

Exterior insulation and finishing system (EIFS) (fixed glazed)

$U_{Wall} = 0.13$  W/(m<sup>2</sup> K)

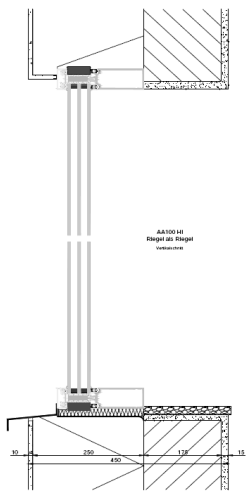


| $\Psi_{install}$ | W/(m K) |
|------------------|---------|
| Top              | 0.028   |
| Left             | 0.028   |
| Right            | 0.028   |
| Bottom           | 0.043   |

$U_{W,installed} = 0.84$  W/(m<sup>2</sup> K)

Lightweight timber (fixed glazed)

$U_{Wall} = 0.13$  W/(m<sup>2</sup> K)

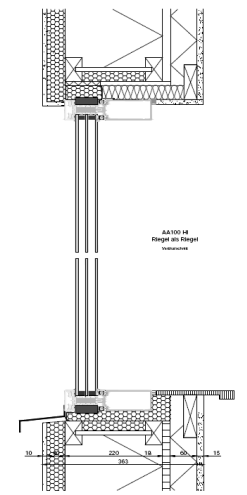


| $\Psi_{install}$ | W/(m K) |
|------------------|---------|
| Top              | 0.044   |
| Left             | 0.044   |
| Right            | 0.044   |
| Bottom           | 0.043   |

$U_{W,installed} = 0.85$  W/(m<sup>2</sup> K)

Ventilated facade (fixed glazing)

$U_{Wall} = 0.13$  W/(m<sup>2</sup> K)

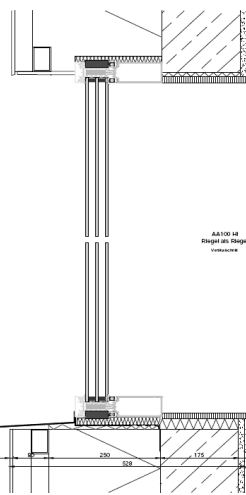

| $\Psi_{install}$ | W/(m K) |
|------------------|---------|
| Top              | 0.031   |
| Left             | 0.031   |
| Right            | 0.031   |
| Bottom           | 0.040   |

$U_{W,installed} = 0.84$  W/(m<sup>2</sup> K)

<sup>1</sup> Includes  $\Delta U = 0.15$  W/(m<sup>2</sup> K). Determined through measurement

<sup>2</sup> Determined through 3D - FEM Simulation . Glass carrier type : Non-Metallic

