


# CERTIFICATE

Certified Passive House Component

Component-ID 1038ed03 valid until 31st December 2018

Passive House Institute  
Dr. Wolfgang Feist  
64283 Darmstadt  
Germany

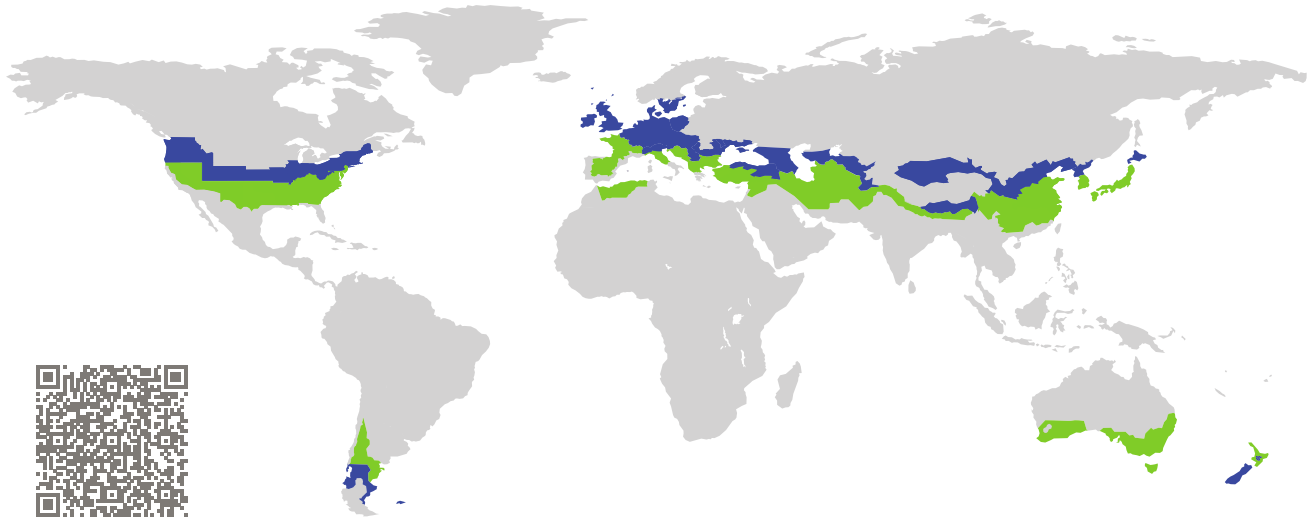


Category: **Entry door (with glas section)**  
Manufacturer: **Moralt AG**  
**Hausham**  
**Germany**  
Product name: **Moralt OutDoor FERRO Passiv Klima**

**This certificate was awarded based on the following criteria for the cool, temperate climate zone**

Comfort  $U_D = 0.74 \leq 0.80 \text{ W}/(\text{m}^2 \text{ K})$   
 $U_{D,\text{installed}} \leq 0.85 \text{ W}/(\text{m}^2 \text{ K})$   
with  $U_{\text{door leaf}}^1 = 0.59 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene  $f_{Rsi=0.25} \geq 0.70$   
Airtightness  $Q_{100} \leq 2.25 \text{ m}^3/(\text{h m})$

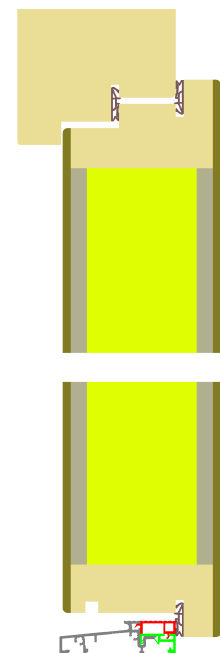

(Inward opening)


<sup>1</sup>U-value of the insulated area of door leaf

cool, temperate climate




**CERTIFIED  
COMPONENT**


Passive House Institute

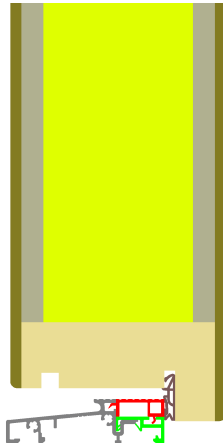

Calculation model

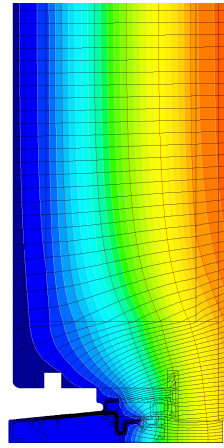

Isothermal



## Description

Door frame made of wood and wooden-based materials; Door leaf insulation: balsa 0.052 W/(mK); Threshold: thermally separated aluminum profile, the temperature factor requirement is not met at the threshold.

## Explanation





The U-values of the door apply to a door 1.10 m wide by 2.20 m tall.


A detailed report of the calculations performed in the context of certification is available from the manufacturer.

Unless stated otherwise, the air tightness was determined according to EN 1026 with respect to the joint length under climate load in conjunction with EN 1121 for the closed, non-locked door. The result corresponds at least to air-tightness class 3 according to EN 12207.


The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.


Further information relating to certification can be found on [www.passivehouse.com](http://www.passivehouse.com) and [passipedia.org](http://passipedia.org).

Frame values			Frame width $b_f$ mm	$U$ -value frame $U_f$ W/(m <sup>2</sup> K)	$\Psi$ edge $\Psi_g$ W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Top	(to)		99	1.08	0.001	0.52
Threshold	(th)		65	1.81	0.002	-
Hinge side Door	(hs)		99	1.08	0.001	-
Lock side Door	(ls)		199	0.86	0.000	0.73
			Spacer: -	Secondary seal: -		


 **Top**


$b_f = 99.00 \text{ mm}$   
 $U_f = 1.08 \text{ W/(m}^2 \text{ K)}$   
 $\Psi_g = 0.001 \text{ W/(m K)}$   
 $f_{Rsi} = 0.52$




 **Threshold**


$b_f = 65.00 \text{ mm}$   
 $U_f = 1.81 \text{ W/(m}^2 \text{ K)}$   
 $\Psi_g = 0.002 \text{ W/(m K)}$   
 $f_{Rsi} = -$




 **Hinge side**  
Door

$b_f = 99.00 \text{ mm}$   
 $U_f = 1.08 \text{ W/(m}^2 \text{ K)}$   
 $\Psi_g = 0.001 \text{ W/(m K)}$   
 $f_{Rsi} = -$

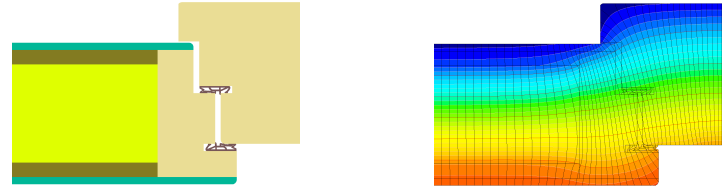

 **Lock side**  
Door

$b_f = 199.00 \text{ mm}$   
 $U_f = 0.86 \text{ W/(m}^2 \text{ K)}$   
 $\Psi_g = 0.000 \text{ W/(m K)}$   
 $f_{Rsi} = 0.73$

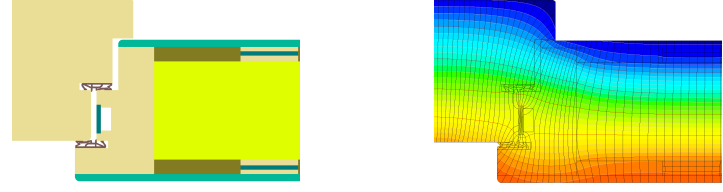



## Door with glas section/infill

Glazing/Infill : None

$$U_p = 0.60 \text{ W}/(\text{m}^2 \text{ K})$$

$$\Psi = 0.045 \text{ W}/(\text{m K})$$

$$f_{Rsi} = -$$

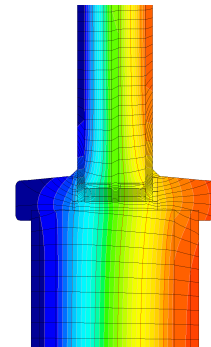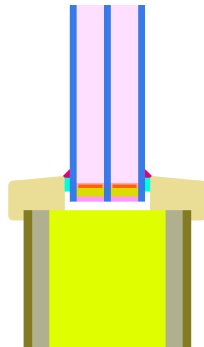

Description:

Glazing (4/16/4/16/4) with  $U_g = 0.60 \text{ W}/(\text{m}^2 \text{ K})$  in accordance with EN 673; Spacer: Thermix


The comfort criterion limits the use of the infill element as follows:

Maximum area =  $0.60 \text{ m}^2$

Maximum circumference =  $3.40 \text{ m}$

Exterior insulation and finishing system


$U_1 = 0.13 \text{ [W/(m}^2 \text{ K)]}$

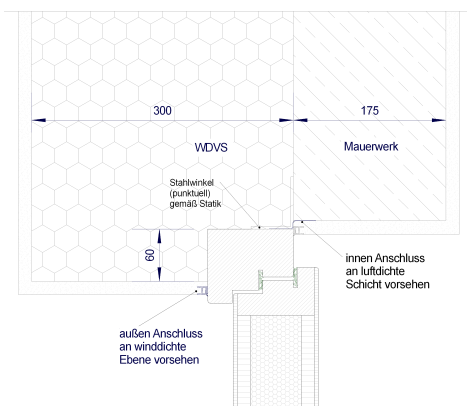

$\Psi_{\text{install}} = 0.000 \text{ W/(m K)}$

Threshold entrance door


$U_1 = 0.13 \quad U_2 = 0.15 \text{ [W/(m}^2 \text{ K)]}$

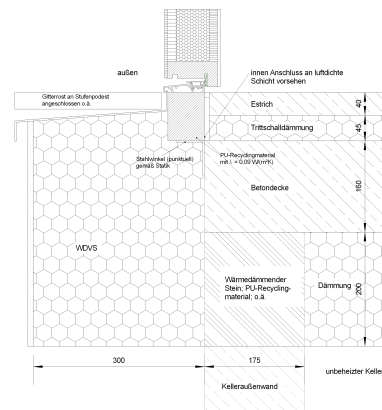

$\Psi_{\text{install}} = 0.073 \text{ W/(m K)}$

Timber frame

$U_1 = 0.14 \text{ [W/(m}^2 \text{ K)]}$

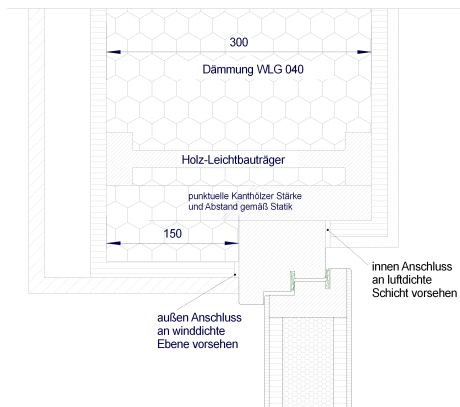

$\Psi_{\text{install}} = 0.001 \text{ W/(m K)}$

