


CERTIFICATE

Certified Passive House Component

Component-ID 0786wi03 valid until 31st December 2020

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

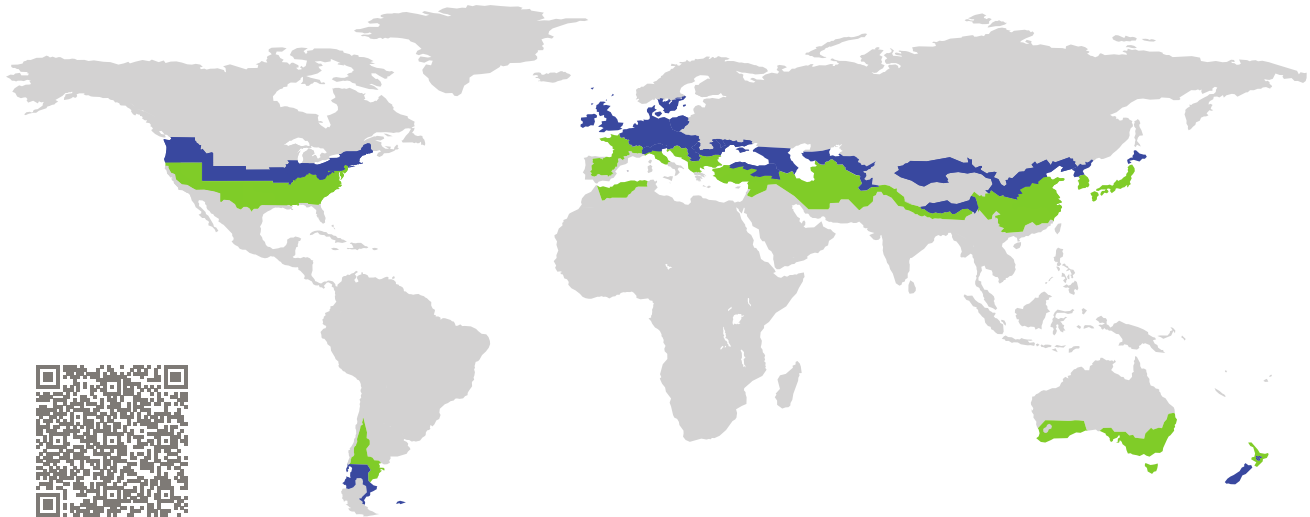


Category: **Window Frame**
Manufacturer: **Qingdao JERDVIN Windows & Doors Co. Ltd, Qingdao, China**
Product name: **Passive-Ha130**

This certificate was awarded based on the following criteria for the cool, temperate climate zone

Comfort $U_W = 0.78 \leq 0.80 \text{ W}/(\text{m}^2 \text{ K})$
 $U_{W,\text{installed}} \leq 0.85 \text{ W}/(\text{m}^2 \text{ K})$
with $U_g = 0.70 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene $f_{Rsi=0.25} \geq 0.70$

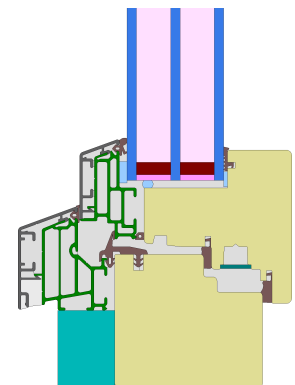

cool, temperate climate



CERTIFIED COMPONENT

Passive House Institute

Passive House
efficiency class

phE


phD

phC

phB

phA

www.passivehouse.com

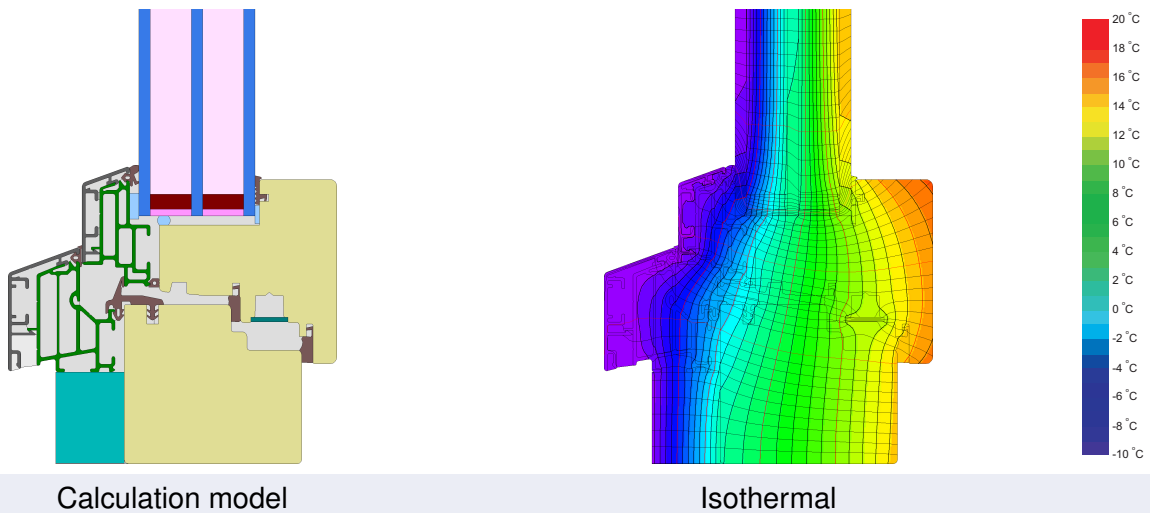

Calculation model Isothermal

Description

Timber frame with external shell made of ABS, insulation (0,035 W/(m²K)) and aluminium. Pane thickness: 51 mm (5/18/5/18/5), rebate depth: 20/25 mm, spacer: SWISSPACER Ultimate

Explanation





The window U-values were calculated for the test window size of 1.23 m × 1.48 m with $U_g = 0.70$ W/(m² K). If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	$U_g =$	0.70	0.64	0.58	0.52	W/(m² K)
		↓	↓	↓	↓	
Window	$U_W =$	0.78	0.74	0.71	0.67	W/(m² K)




Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Frame values			Frame width b_f mm	U -value frame U_f W/(m ² K)	Ψ -panel edge Ψ_g W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Top	(to)		131	0.76	0.025	0.75
Side	(s)		131	0.76	0.025	0.75
Bottom	(bo)		131	0.79	0.025	0.75
Mullion flying	(fm)		147	0.88	0.025	0.75
			Spacer: SWISSPACER Ultimate		Secondary seal: Polysulfid	

Validated installations

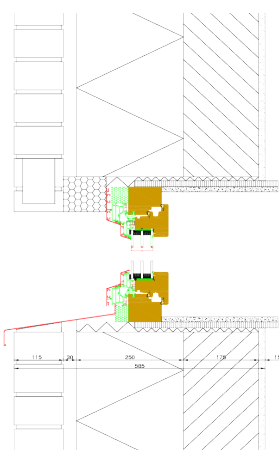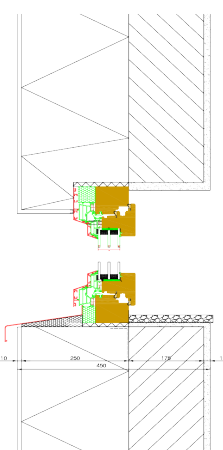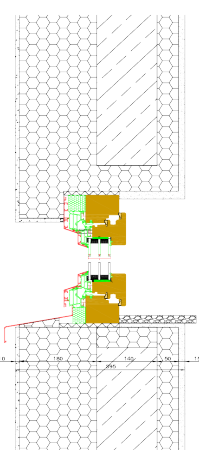Cavity wall (operable)		EIFS		Insulated formwork blocks	
					
$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)
Top	0.009	Top	0.008	Top	0.008
Side	0.009	Side	0.008	Side	0.008
Bottom	0.009	Bottom	0.009	Bottom	0.010
$U_{W,installed} = 0.81$ W/(m ² K)		$U_{W,installed} = 0.81$ W/(m ² K)		$U_{W,installed} = 0.81$ W/(m ² K)	

