


CERTIFICATE

Certified Passive House Component

Component-ID 1059wi03 valid until 31st December 2020

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

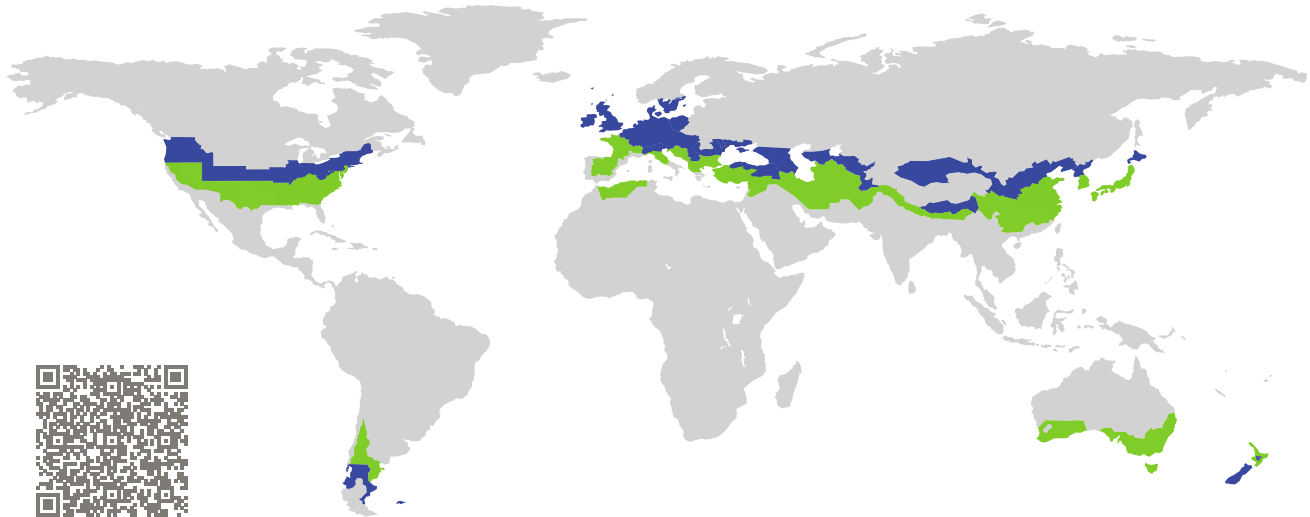


Category: **Window Frame**
Manufacturer: **Shandong Huajian Aluminium Group Co.,LTD, Shandong Province, China**
Product name: **ES101**

This certificate was awarded based on the following criteria for the cool, temperate climate zone

Comfort $U_W = 0.79 \leq 0.80 \text{ W}/(\text{m}^2 \text{ K})$
 $U_{W,\text{installed}} \leq 0.85 \text{ W}/(\text{m}^2 \text{ K})$
with $U_g = 0.70 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene $f_{Rsi=0.25} \geq 0.70$

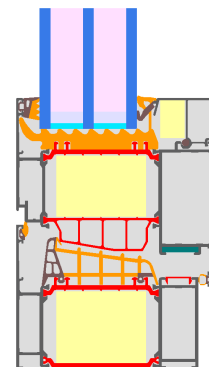

Passive House
efficiency class

phE

phD

phC

phB

phA


www.passivehouse.com

cool, temperate climate



**CERTIFIED
COMPONENT**

Passive House Institute

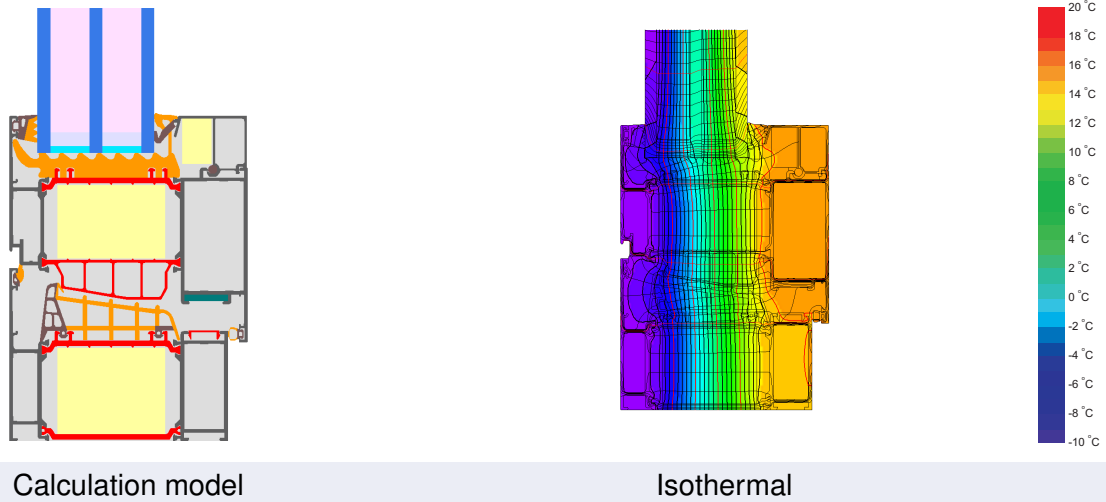

Calculation model Isothermal

Description

Thermally separated aluminium frame; insulated with resol foam (0,023W/(mK)) Pane thickness: 54 mm (6/18/6/18/6), rebate depth: 17 mm, spacer: TGI-Spacer Precision with polyurethane as secondary seal

Explanation





The window U-values were calculated for the test window size of 1.23 m × 1.48 m with $U_g = 0.70 \text{ W}/(\text{m}^2 \text{ K})$. If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	$U_g =$	0.70	0.64	0.58	0.52	W/(m ² K)
		↓	↓	↓	↓	
Window	$U_w =$	0.79	0.76	0.72	0.69	W/(m ² K)

Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.


Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Frame values			Frame width b_f mm	U -value frame U_f W/(m ² K)	Ψ -panel edge Ψ_g W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Top	(to)		150	0.81	0.022	0.76
Side	(s)		150	0.81	0.022	0.76
Bottom	(bo)		150	0.81	0.022	0.76
Mullion flying	(fm)		167	0.81	0.022	0.76
			Spacer: TGI-Spacer Precision		Secondary seal: Polyurethan	

Validated installations

Formwork blocks (operable)

$U_{Wall} = 0.15 \text{ W}/(\text{m}^2 \text{ K})$

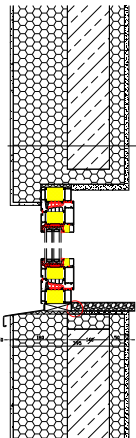


$\Psi_{install}$ W/(m K)

Top	0.012
Side	0.012
Bottom	0.045

$U_{W,installed} = 0.85 \text{ W}/(\text{m}^2 \text{ K})$

Ventilated facade

$U_{Wall} = 0.13 \text{ W}/(\text{m}^2 \text{ K})$

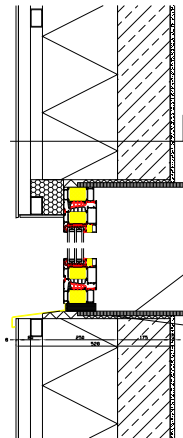


$\Psi_{install}$ W/(m K)

Top	0.017
Side	0.017
Bottom	0.024

$U_{W,installed} = 0.85 \text{ W}/(\text{m}^2 \text{ K})$

Exterior insulation and finishing system (EIFS) (operable)

$U_{Wall} = 0.13 \text{ W}/(\text{m}^2 \text{ K})$

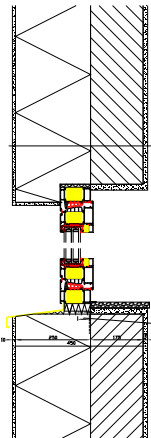

$\Psi_{install}$ W/(m K)

Top	0.014
Side	0.014
Bottom	0.025

$U_{W,installed} = 0.84 \text{ W}/(\text{m}^2 \text{ K})$

