


CERTIFICATE

Certified Passive House Component

Component-ID 0601ed03 valid until 31st December 2019

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

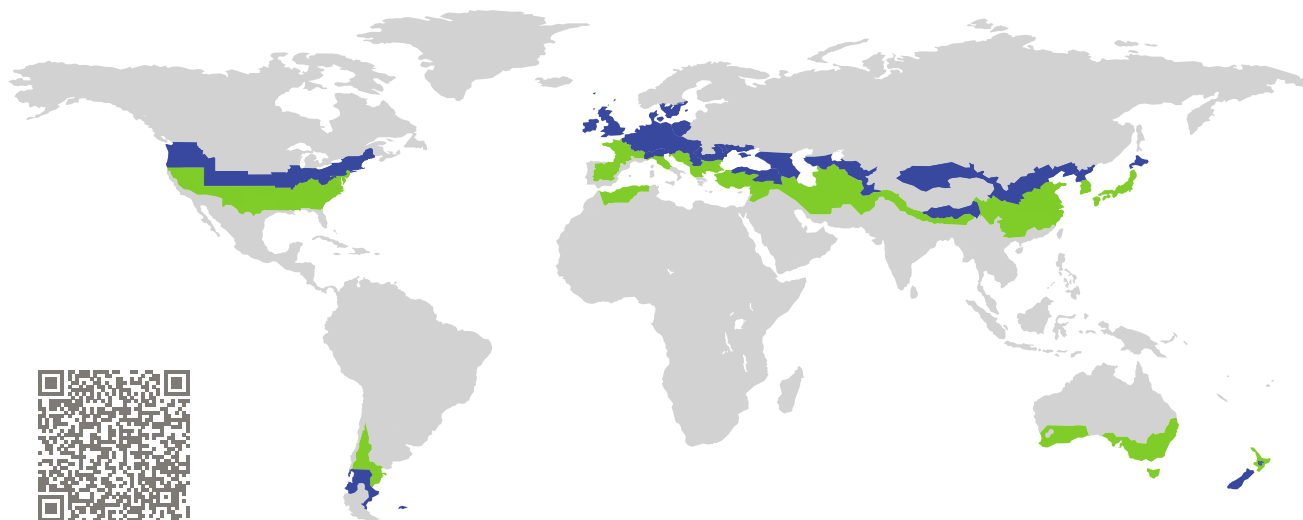


Category: **Entry door (with glas section)**
Manufacturer: **TOPIC GmbH
Sarleinsbach
Austria**
Product name: **Topic Passivhaustür**

This certificate was awarded based on the following criteria for the cool, temperate climate zone

Comfort $U_D = 0.66 \leq 0.80 \text{ W}/(\text{m}^2 \text{ K})$
 $U_{D,\text{installed}} \leq 0.85 \text{ W}/(\text{m}^2 \text{ K})$
with $U_{\text{door leaf}}^1 = 0.28 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene $f_{Rsi=0.25} \geq 0.70$
Airtightness $Q_{100} \leq 2.25 \text{ m}^3/(\text{h m})$

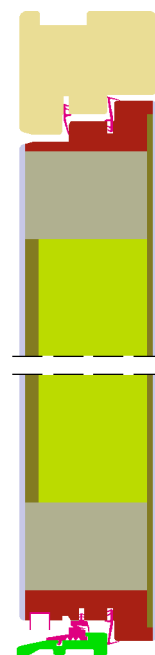

(Inward opening)


¹U-value of the insulated area of door leaf

cool, temperate climate




**CERTIFIED
COMPONENT**


Passive House Institute

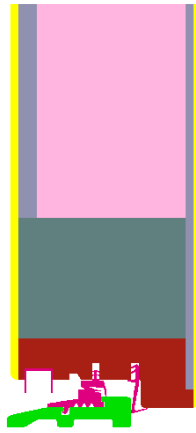

Calculation model

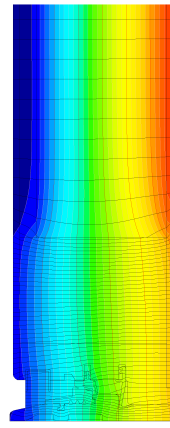

Isothermal



Description

Door frame made of wood and wooden-based materials; Door leaf insulation: PU-foam 0,024 W/(mK), Door leaf covered with phenolic resin panels at both sides; Threshold: plastic profile 0,30 W/(mK), the temperature factor requirement is not met at the threshold.

Explanation


The U-values of the door apply to a door 1.10 m wide by 2.20 m tall.


A detailed report of the calculations performed in the context of certification is available from the manufacturer.

Unless stated otherwise, the air tightness was determined according to EN 1026 with respect to the joint length under climate load in conjunction with EN 1121 for the closed, non-locked door. The result corresponds at least to air-tightness class 3 according to EN 12207.


The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.


Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Frame values			Frame width b_f mm	U -value frame U_f W/(m ² K)	Ψ edge Ψ_g W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Top	(to)		166	1.21	0.002	0.73
Threshold	(th)		111	1.40	0.002	0.67
Hinge side Door	(hs)		166	1.21	0.002	0.73
Lock side Door	(ls)		166	1.25	0.002	0.72
			Spacer: -	Secondary seal: -		


 **Top**


$b_f = 166.00$ mm
 $U_f = 1.21$ W/(m² K)
 $\Psi_g = 0.002$ W/(m K)
 $f_{Rsi} = 0.73$




 **Threshold**


$b_f = 111.00$ mm
 $U_f = 1.40$ W/(m² K)
 $\Psi_g = 0.002$ W/(m K)
 $f_{Rsi} = 0.67$




 **Hinge side**
Door

$b_f = 166.00$ mm
 $U_f = 1.21$ W/(m² K)
 $\Psi_g = 0.002$ W/(m K)
 $f_{Rsi} = 0.73$



 **Lock side**
Door

$b_f = 166.00$ mm
 $U_f = 1.25$ W/(m² K)
 $\Psi_g = 0.002$ W/(m K)
 $f_{Rsi} = 0.72$




Door with glas section/infill

Glazing/Infill : None

$$U_p = 0.55 \text{ W}/(\text{m}^2 \text{ K})$$

$$\Psi = 0.039 \text{ W}/(\text{m K})$$

$$f_{Rsi} = -$$



Description:

Glazing (4/24/4/24/4/22/14) with $U_g = 0.55 \text{ W}/(\text{m}^2 \text{ K})$ according to EN 673; Spacer: "TGI-Spacer".

The comfort criterion limits the use of the infill element as follows:


Maximum area = 0.42 m^2

Maximum circumference = 3.84 m

Validated installations

EIFS


$$U_1 = 0.13 \text{ [W/(m}^2 \text{ K)]}$$

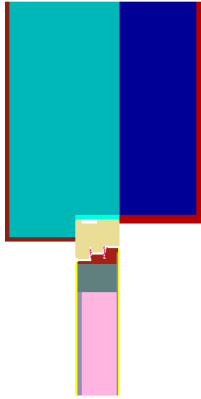

$$\Psi_{\text{install}} = 0.002 \text{ W/(m K)}$$

Exterior insulation and finishing s (EIFS) side (operable)


$$U_1 = 0.13 \text{ [W/(m}^2 \text{ K)]}$$

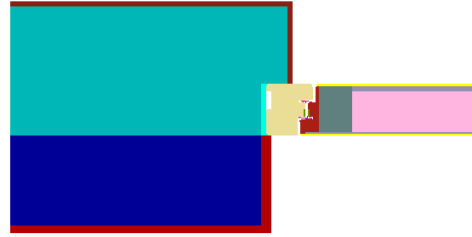

$$\Psi_{\text{install}} = 0.001 \text{ W/(m K)}$$

Insulated formwork blocks


$$U_1 = 0.15 \text{ [W/(m}^2 \text{ K)]}$$

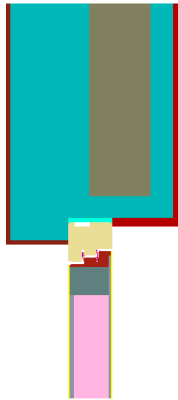

$$\Psi_{\text{install}} = 0.001 \text{ W/(m K)}$$

Threshold entrance door


$$U_1 = 0.13 \quad U_2 = 0.15 \text{ [W/(m}^2 \text{ K)]}$$

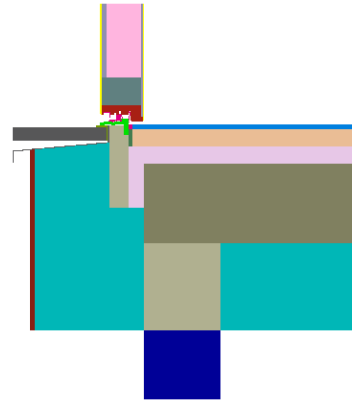

$$\Psi_{\text{install}} = 0.069 \text{ W/(m K)}$$

Timber frame

$$U_1 = 0.13 \text{ [W/(m}^2 \text{ K)]}$$

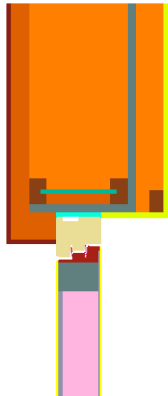

$$\Psi_{\text{install}} = 0.011 \text{ W/(m K)}$$

