


# CERTIFICATE

Certified Passive House Component

Component-ID 1587wi03 valid until 31st December 2021

Passive House Institute  
Dr. Wolfgang Feist  
64283 Darmstadt  
Germany

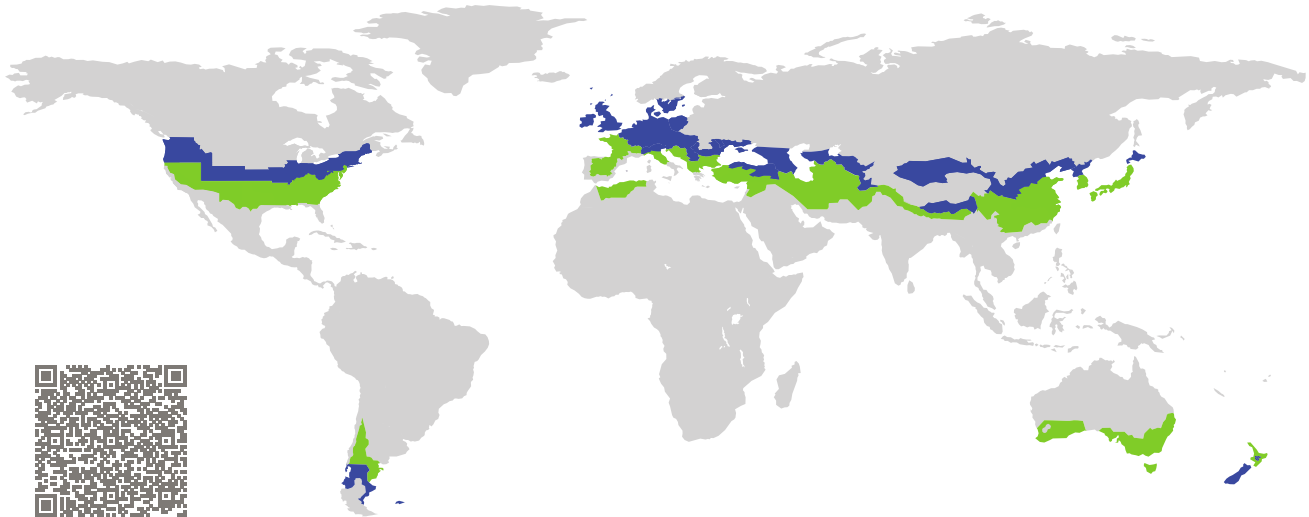


Category: **Window Frame**  
Manufacturer: **XI'AN GAOKE CURTAIN WALL & DOORS AND WINDOWS CO.,LTD, Xi'an, China**  
Product name: **GKBD90-S**

**This certificate was awarded based on the following criteria for the cool, temperate climate zone**

Comfort  $U_W = 0.77 \leq 0.80 \text{ W}/(\text{m}^2 \text{ K})$   
 $U_{W,\text{installed}} \leq 0.85 \text{ W}/(\text{m}^2 \text{ K})$   
with  $U_g = 0.70 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene  $f_{Rsi=0.25} \geq 0.70$

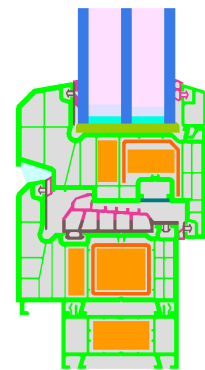

Passive House  
efficiency class

phE

phD

phC

phB


phA

cool, temperate climate




**CERTIFIED  
COMPONENT**

Passive House Institute

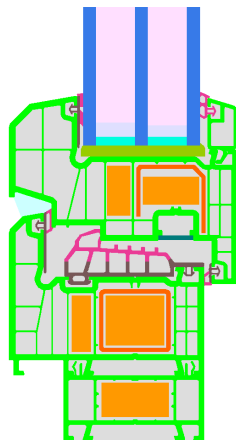

Calculation model

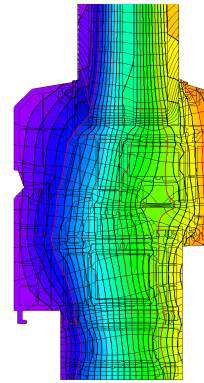

Isothermal

### Description

PVC frame with insulation (XPS 0.029W/(mK)) and reinforcement (Low lambda PA 0.21 W/(mK)); the maximum size of this frame is 1.5 m x 1.8 m; Pane thickness: 54 mm (6/18/6/18/6), rebate depth: 24 mm. Spacer: SWISSPACER Ultimate with butyl as secondary seal.

### Explanation





The window U-values were calculated for the test window size of 1.23 m x 1.48 m with  $U_g = 0.70$  W/(m<sup>2</sup> K). If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	$U_g =$	0.70	0.64	0.58	0.54	W/(m <sup>2</sup> K)
		↓	↓	↓	↓	
Window	$U_W =$	0.77	0.73	0.69	0.66	W/(m <sup>2</sup> K)

Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.


Further information relating to certification can be found on [www.passivehouse.com](http://www.passivehouse.com) and [passipedia.org](http://passipedia.org).

Frame values			Frame width $b_f$ mm	$U$ -value frame $U_f$ W/(m <sup>2</sup> K)	$\Psi$ -panel edge $\Psi_g$ W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Top	(to)		129	0.70	0.023	0.77
Side	(s)		129	0.70	0.023	0.77
Bottom	(bo)		159	0.81	0.023	0.76
Transom 1 casement	(t1)		152	0.66	0.023	0.76
			Spacer: SWISSPACER ULIMATE		Secondary seal: Butyl	

### Validated installations

**Formwork blocks (operable)**

$U_{Wall} = 0.15 \text{ W}/(\text{m}^2 \text{ K})$

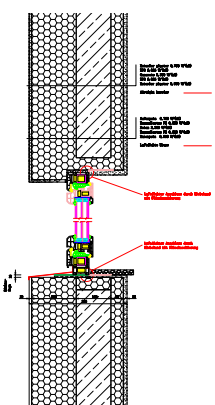


$\Psi_{install}$	W/(m K)
Top	0.008
Side	0.008
Bottom	0.022

$U_{W,installed} = 0.80 \text{ W}/(\text{m}^2 \text{ K})$

**Exterior insulation and finishing system**

$U_{Wall} = 0.13 \text{ W}/(\text{m}^2 \text{ K})$

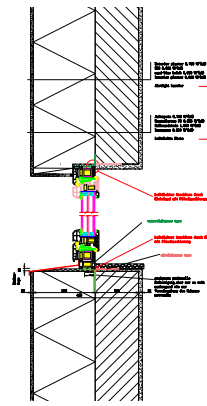


$\Psi_{install}$	W/(m K)
Top	0.007
Side	0.007
Bottom	0.022

$U_{W,installed} = 0.80 \text{ W}/(\text{m}^2 \text{ K})$

**Lightweight timber (operable)**

$U_{Wall} = 0.13 \text{ W}/(\text{m}^2 \text{ K})$

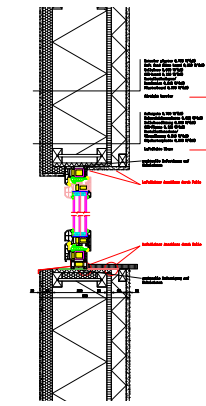

$\Psi_{install}$	W/(m K)
Top	0.011
Side	0.011
Bottom	0.019

$U_{W,installed} = 0.80 \text{ W}/(\text{m}^2 \text{ K})$

