

# Certificate

## Certified Passive House component

for cool, temperate climate, valid until 31.12.2018

Category: **Facade anchor**  
 Manufacturer: **GIP GmbH**  
**38122 Braunschweig, GERMANY**  
 Product name: **VECO-Isotherm**

The following criteria were used in awarding this certificate:

### Efficiency Criterion

In a typical application\*, the construction fulfills the requirements of

$$\text{Eff. fa} \leq 0.200 \text{ W/(kNK)}$$

### Comfort Criterion


The inner surface must be warm enough to prevent mould as well as uncomfortable down-draught and radiation losses.

$$\theta_{i,\text{min}} \geq 17^\circ\text{C}$$

### Thermal data of the certified component

VECO-Isotherm	thermal bridge coefficient $\chi$ [W/K]	minimum inner surface temperature $\theta_{i,\text{min}}$ [°C]
Fixed point	0.0045	19.44
Sliding point	0.0029	19.45

\* The criterion has been validated with a representative facade of a school building

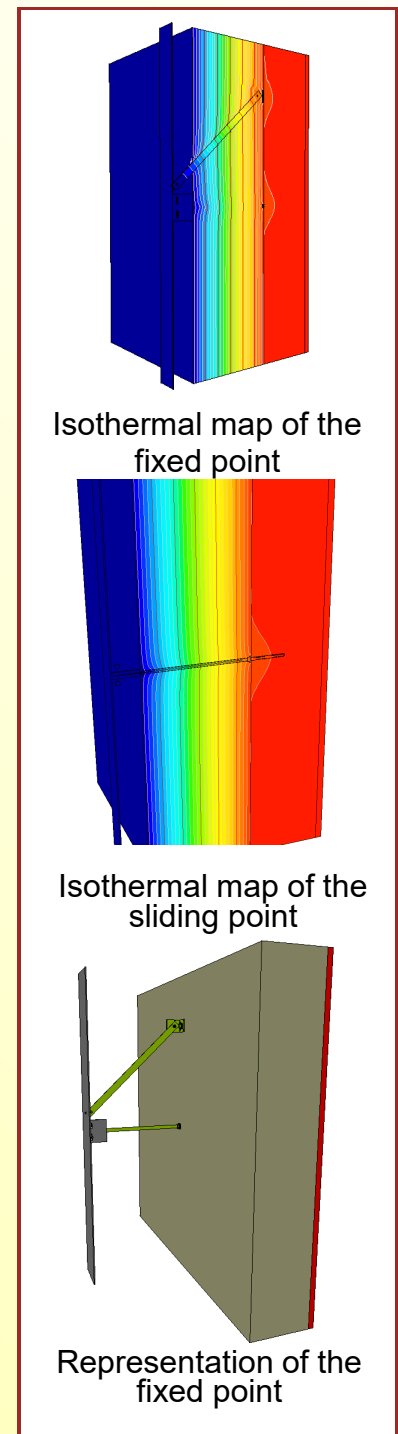

cool, temperate climate



**CERTIFIED COMPONENT**

Passive House Institute

# Data sheet GIP GmbH, VECO-Isotherm

**Manufacturer** GIP GmbH  
 Friedrich-Seele-Straße 1b, 38122 Braunschweig  
 Tel.: +49 531 20 900 415  
 www.gip-fassade.com

Validation on reference facade	<b><math>\Delta U</math> [W/m<sup>2</sup>K]</b>
<b>LC VI</b>	<b>0.0065</b>

In order to validate the suitability, the manufacturer provides a static calculation and an associated installation plan for the reference facade.

The classification criteria and the load class allocation can be found in the current criteria "Zertifizierte Passivhaus Komponente – Fassadenanker, Version 2.0, 08.05.2017".

Load class / Facade weight		Thermal bridge coefficients [W/K]			
-	[kN/m <sup>2</sup> ]	X <sub>FP</sub>	-	X <sub>SP</sub>	-
<b>VI</b>	0.32	0.0045		0.0029	
[W/(kNK)]	[W/m <sup>2</sup> K]	Quantity / m <sup>2</sup>			
<b>Efficiency</b>	<b><math>\Delta U</math></b>	<b>FP1</b>	<b>FP2</b>	<b>SP1</b>	<b>SP2</b>
0.2030	0.0065	0.65		1.23	



Installation-plan reference facade of the certified component

Load-class	Facade cladding	Facade weight [kN/m <sup>2</sup> ]	Efficiency criterion fulfilled?
<b>I</b>	Aluminium laminated	0.100	yes
<b>II</b>	Plastic	0.150	yes
<b>III</b>	Fibre-cement plates	0.200	yes
<b>IV</b>	Acrylic glass	0.250	yes
<b>V</b>	Concrete	0.300	yes
<b>VI</b>	Ceramics	> 0.300	yes