


CERTIFICATE

Certified Passive House Component

Component-ID 2204wi05 valid until 31st December 2025

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

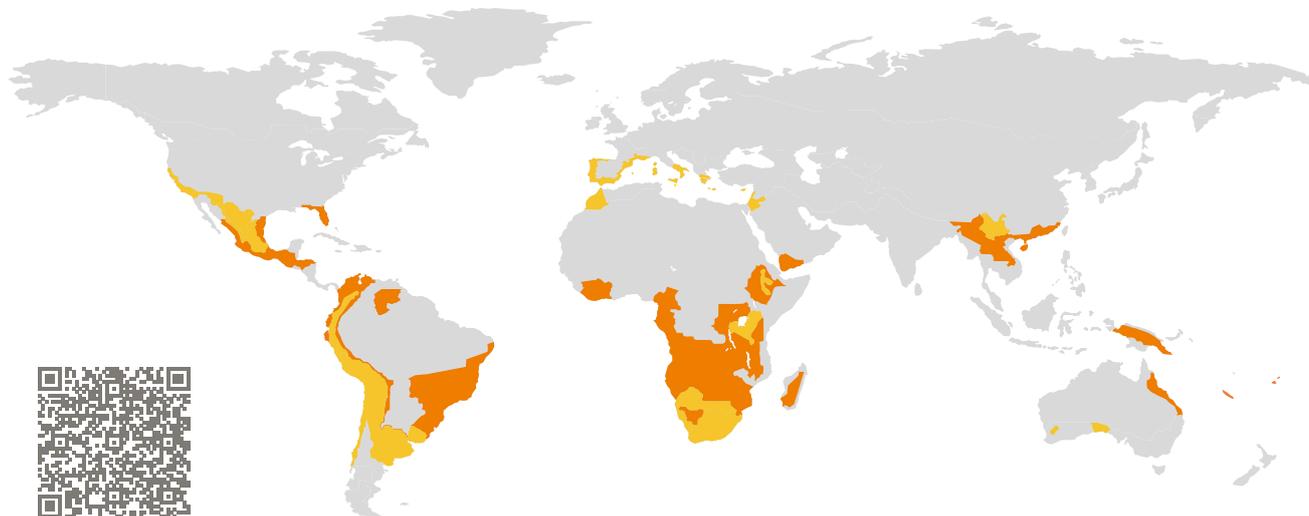


Category: **Window Frame**
Manufacturer: **GEALAN Fenster Systeme GmbH,
Santa Pola-Alicante,
Spain**
Product name: **Certification S8000**

**This certificate was awarded based on the following
criteria for the warm climate zone**

Comfort $U_W = 1.19 \leq 1.20 \text{ W}/(\text{m}^2 \text{ K})$
 $U_{W, \text{installed}} \leq 1.25 \text{ W}/(\text{m}^2 \text{ K})$
with $U_g = 1.10 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene $f_{Rsi=0.25} \geq 0.55$

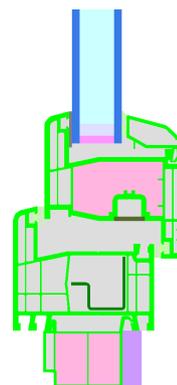

Passive House
efficiency class

phE

phD

phC

phB

phA


www.passivehouse.com

warm climate




**CERTIFIED
COMPONENT**


Passive House Institute

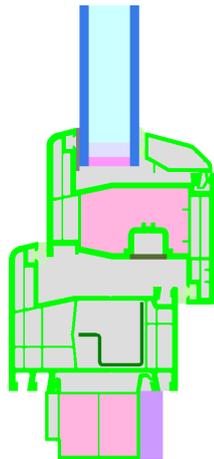

Calculation model

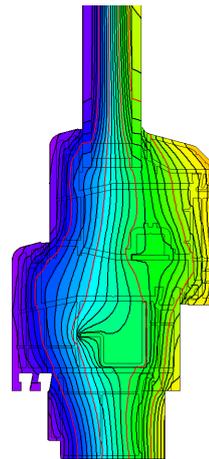

Isothermal



Description

PVC frame with PU foam (IKD[®], 0.04W/(mK)) insulated chamber. Additional EPSinsulation, 0.034 W/(mK) at the bottom profile. Frame 8001 with reinforcement 7736, bottom frame extension 7202 IKD, sash 8082 IKD with STV, mullion 8038 with reinforcement 8716, mullion 8080 with reinforcement 8701. Pane thickness: 26 mm (4/18/4), rebate depth: 17 mm.

Explanation

The window U-values were calculated for the test window size of 1.23 m × 1.48 m with $U_g = 1.10 \text{ W}/(\text{m}^2 \text{ K})$. If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	$U_g =$	1.10	1.20	1.04	0.60	W/(m ² K)
		↓	↓	↓	↓	
Window	$U_W =$	1.19	1.26	1.15	0.86	W/(m ² K)

Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Validated installations

Lightweight timber (operable)	Monolithic construction (operable)	Exterior insulation and finishing system (EIFS) (operable)
$U_{\text{Wall}} = 0.32 \text{ W}/(\text{m}^2 \text{ K})$	$U_{\text{Wall}} = 0.45 \text{ W}/(\text{m}^2 \text{ K})$	$U_{\text{Wall}} = 0.48 \text{ W}/(\text{m}^2 \text{ K})$
Ψ_{install} W/(m K)	Ψ_{install} W/(m K)	Ψ_{install} W/(m K)
Top -0.002	Top 0.015	Top 0.007
Side -0.002	Side 0.015	Side 0.007
Bottom 0.022	Bottom 0.021	Bottom 0.043
$U_{W,\text{installed}} = 1.20 \text{ W}/(\text{m}^2 \text{ K})$	$U_{W,\text{installed}} = 1.24 \text{ W}/(\text{m}^2 \text{ K})$	$U_{W,\text{installed}} = 1.23 \text{ W}/(\text{m}^2 \text{ K})$

Frame values		Frame width b_f mm	U -value frame U_f W/(m ² K)	Ψ -glazing edge Ψ_g W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Mullion 1 casement	(1M1)	162	1.22	0.031	0.61
Mullion 2 casements	(2M1)	182	1.19	0.031	0.62
Bottom	(OB1)	146	1.14	0.031	0.62
Top	(OH1)	116	1.14	0.031	0.68
Lateral	(OJ1)	116	1.14	0.031	0.68
Spacer: SWISSPACER Ultimate			Secondary seal: Polysulfide		

