
CERTIFICATE

Certified Passive House Component Component-ID 1082wi03 valid until 31st December 2025 Passive House Institute Dr. Wolfgang Feist 64283 Darmstadt Germany

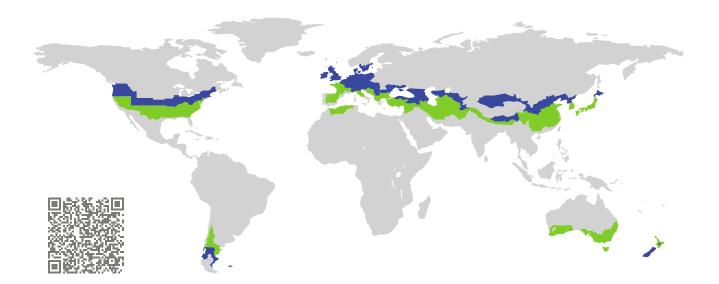



Category:	Window Frame
Manufacturer:	Feal d.o.o.,
	Siroki Brijeg,
	Bosnia and Herzegovina
Product name:	Termo 85 PA


This certificate was awarded based on the following criteria for the cool, temperate climate zone

Comfort	$U_W = 0.78$	\leq	0.80 W/(m ² K)
	$U_{W,\text{installed}}$	\leq	$0.85 W/(m^2 K)$
	with U_g	=	$0.70 W/(m^2 K)$

Hygiene $f_{Rsi=0.25}$ \geq 0.70



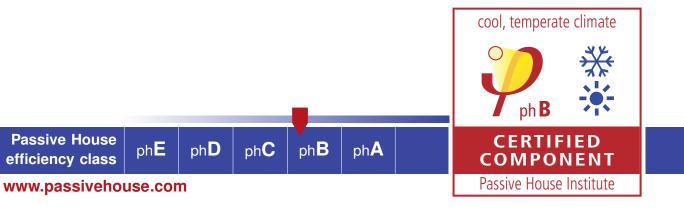

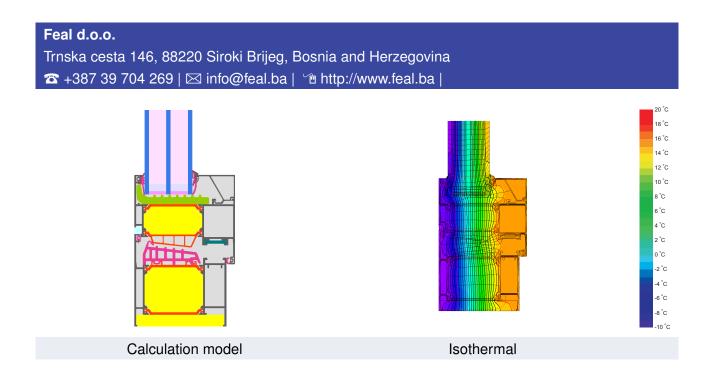

Description

Aluminium frame with thermal separation by Low lambda Polyamide and insulated by Kooltherm (0.022 W/(mK)) Pane thickness: 44 mm (4/16/4/16/4), rebate depth: 18 mm

Explanation

The window U-values were calculated for the test window size of 1.23 m \times 1.48 m with $U_g = 0.70$ W/(m² K). If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	$U_g =$	0.70	0.64	0.58	0.52	W/(m ² K)
		\downarrow	\downarrow	\downarrow	\downarrow	
Window	$U_W =$	0.78	0.74	0.70	0.67	W/(m ² K)

Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Validated installations

Formwork bloc	ks (operable)		ation and finishing IFS) (operable)	Cav	ity wall
$U_{Wall} = 0.15 W/(m^2 K)$		$U_{\text{Wall}} = 0.13 \text{W}/(\text{m}^2 \text{K})$		$U_{Wall} = 0.13 W/(m^2 K)$	
	The second		The second		
$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)
Тор	0.014	Тор	0.014	Тор	0.013
Side	0.014	Side	0.014	Side	0.013
Bottom	0.019	Bottom	0.018	Bottom	0.017
$U_{W,\text{installed}} = 0.$.83 W/(m ² K)	$U_{W, \text{installed}}$	$= 0.82 \text{ W/(m}^2 \text{ K)}$	U _{W,installed} =	0.82 W/(m ² K)

Frame values	6		Frame width <i>b_f</i> mm	<i>U</i> -value frame <i>U</i> f W/(m ² K)	$arPsi$ -glazing edge $arPsi_g$ W/(m K)	Temp. Factor f _{Rsi=0.25} [-]
Flying Mul- lion	(FM1)	1	170	0.73	0.027	0.78
Bottom	(OB1)	4	140	0.75	0.026	0.78
Тор	(OH1)	۴	140	0.75	0.026	0.78
Lateral	(OJ1)	<u>11</u>	140	0.75	0.026	0.78
	Spa	acer: SW	ISSPACER Ultimate	e Seco	ndary seal: Polysulfic	le

www.passivehouse.com