
CERTIFICATE

Certified Passive House Component

Component-ID 2419fx03 valid until 31st December 2025

Passive House Institute Dr. Wolfgang Feist 64283 Darmstadt Germany

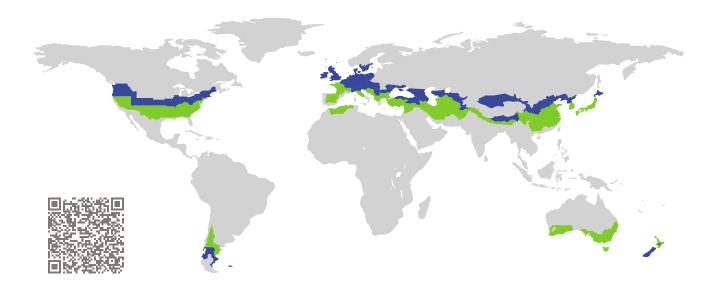



Category:	Fixed window
Manufacturer:	Duxton Windows & Doors,
	Winnipeg,
	Canada
Product name:	458AW Fixed


This certificate was awarded based on the following criteria for the cool, temperate climate zone

Comfort	$U_W = 0.80$	\leq	0.80 W/(m ² K)
	$U_{W,\text{installed}}$	\leq	$0.85 W/(m^2 K)$
	with U_g	=	$0.70 W/(m^2 K)$

Hygiene $f_{Rsi=0.25}$ \geq 0.70



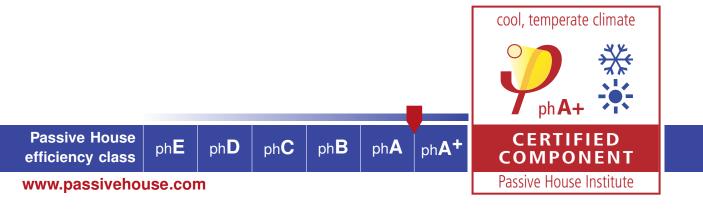

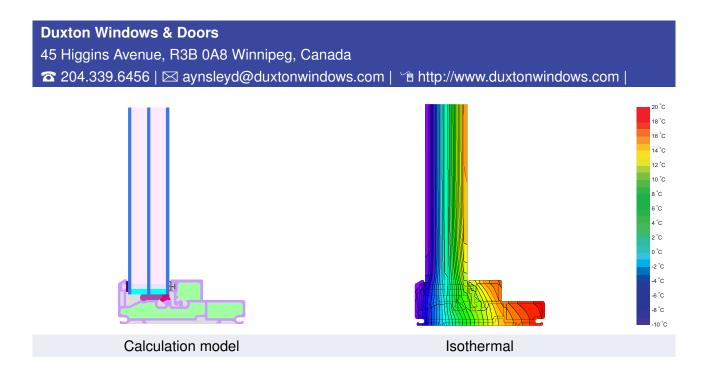

Description

Fiberglass frame insulated by graphite polystyrene foam (0.031 W/(mK)). Pane thickness: 38 mm (3/14,5/3/14,5/3), rebate depth: 13,5 mm. The minimum surface temperature is slightly not achieved at the mullion, a Ug-value of max. 0.57 W/m²K is recommended for compensation.

Explanation

The window U-values were calculated for the test window size of 1.23 m \times 1.48 m with $U_g = 0.70$ W/(m² K). If a higher quality glazing is used, the window U-values will improve as follows:


Glazing	$U_g =$	0.70	0.64	0.58	0.52	$W/(m^2 K)$
		\downarrow	\downarrow	\downarrow	\downarrow	
Window	$U_W =$	0.80	0.75	0.69	0.64	W/(m ² K)

Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Validated installations

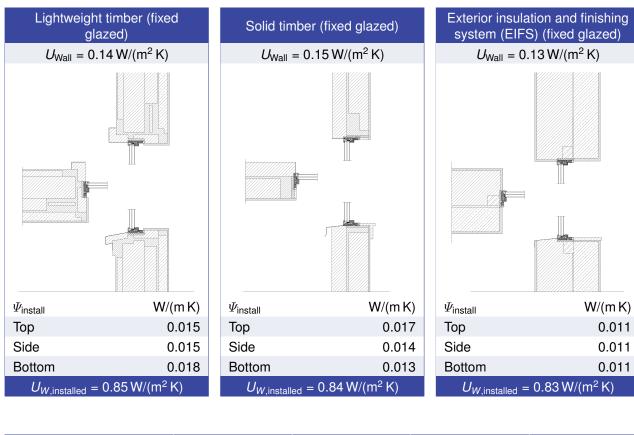

Frame valu	ies		Frame width <i>b_f</i> mm	<i>U</i> -value frame <i>U</i> f W/(m ² K)	$arPsi$ -glazing edge $arPsi_g$ W/(m K)	Temp. Factor f _{Rsi=0.25} [-]
Mullion fixed	(0M1)		83	1.00	0.024	0.69
Bottom fixed	(FB1)	1	41	0.98	0.024	0.70
Top fixed	(FH1)	T	41	0.98	0.024	0.70
Lateral	(FJ1)	-	41	0.98	0.024	0.70
		Spacer:	Super Spacer Premi	ium Se	condary seal: Butyl	

www.passivehouse.com