


CERTIFICATE

Certified Passive House Component

Component-ID 1153sk03 valid until 31st December 2025

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

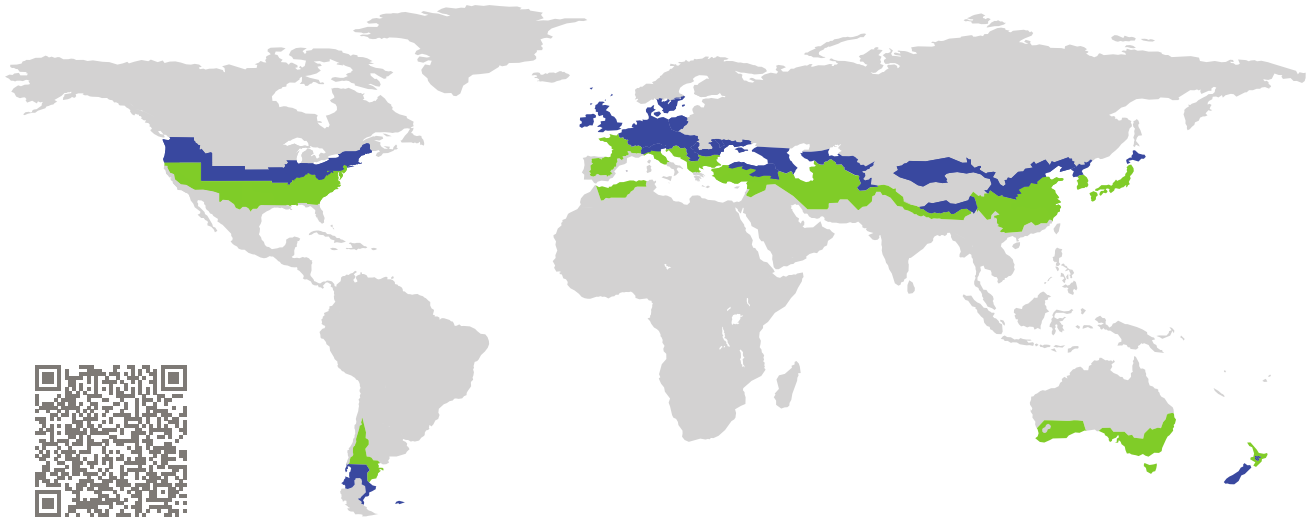


Category: **Skylight**
Manufacturer: **Roof Maker Ltd.,
Thurmaston,
United Kingdom**
Product name: **Fixed Flat**

This certificate was awarded based on the following
criteria for the cool, temperate climate zone

Comfort $U_{SK} = 0.93 \leq 1.10 \text{ W}/(\text{m}^2 \text{ K})$
 $U_{SK, \text{installed}} \leq 1.10 \text{ W}/(\text{m}^2 \text{ K})$
with $U_g = 0.80 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene $f_{Rsi=0.25} \geq 0.70$

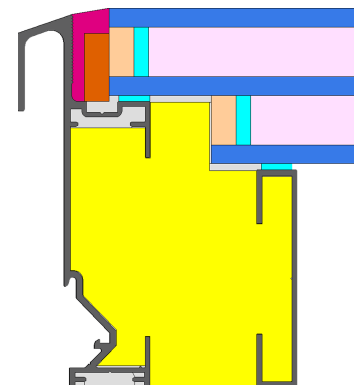

Passive House
efficiency class

phE

phD

phC

phB

phA


www.passivehouse.com

cool, temperate climate



**CERTIFIED
COMPONENT**

Passive House Institute

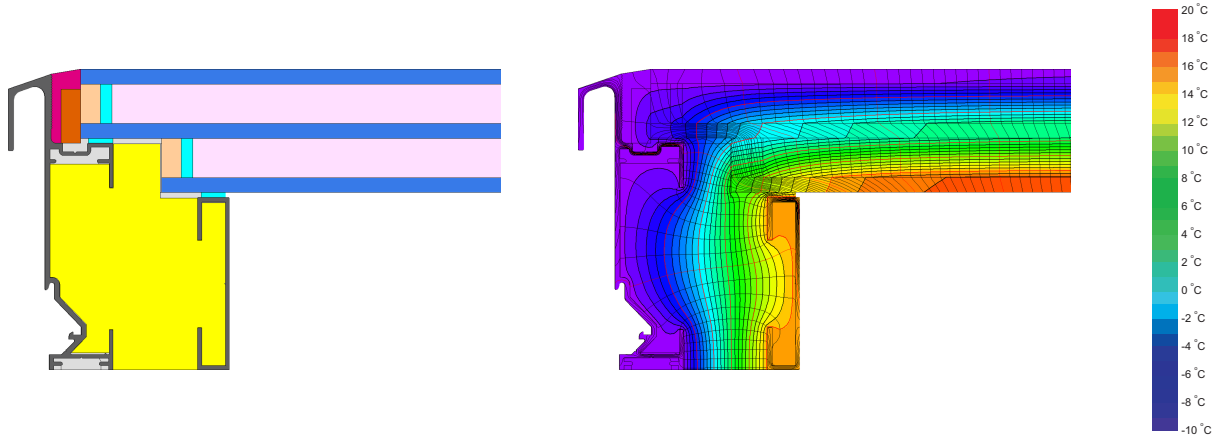

Calculation model

Isothermal

Description

Fixed skylight with aluminium facing shell. Insulation made of EPS (0.038 W/(mK)). Pane thickness: 50 mm (6/16/6/16/6), rebate depth: varies, spacer: SuperSpacer Tri-Seal

Explanation

The window U-values were calculated for the test window size of 1.50 m × 1.50 m with $U_g = 0.80 \text{ W/(m}^2 \text{ K)}$. If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	$U_g =$	0.80	0.78	0.74	0.70	W/(m ² K)
		↓	↓	↓	↓	
Window	$U_w =$	0.93	0.92	0.89	0.86	W/(m ² K)

Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.


Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Frame values		Frame width b_f mm	U-value frame U_f W/(m ² K)	ψ -glazing edge ψ_g W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Bottom	(OB1)	90	0.88	0.049	0.74
Head	(OH1)	90	0.88	0.049	0.74
Jamb	(OJ1)	90	0.88	0.049	0.74
Spacer: Super Spacer TriSeal / T-Spacer Premium				Secondary seal: Butyl	

Validated installations

Concrete roof

$U_{Wall} = 0.10 \text{ W/(m}^2 \text{ K)}$

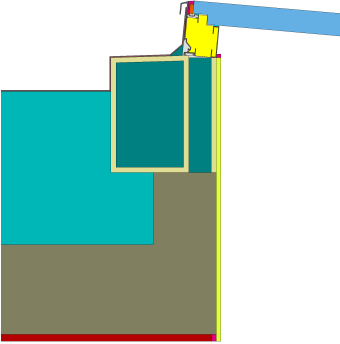


$\Psi_{install}$	W/(m K)
Top	0.054
Left	0.065
Right	0.065
Bottom	0.054

$U_{W,installed} = 1.09 \text{ W/(m}^2 \text{ K)}$

Lightweight roof

$U_{Wall} = 0.08 \text{ W/(m}^2 \text{ K)}$

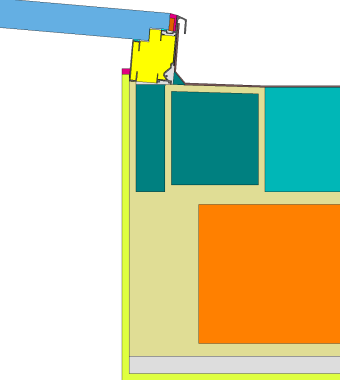

$\Psi_{install}$	W/(m K)
Top	0.065
Left	0.035
Right	0.035
Bottom	0.065

$U_{W,installed} = 1.06 \text{ W/(m}^2 \text{ K)}$

