
CERTIFICATE

Certified Passive House Component Component-ID 1772sr00 valid until 31st December 2025 Passive House Institute Dr. Wolfgang Feist 64283 Darmstadt Germany

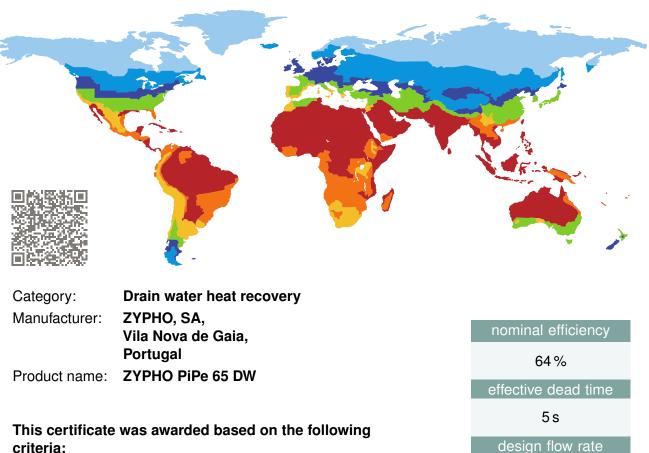

Tested under standard boundary conditions¹ the system reduces the useful energy demand for shower by

$$53\% \ge 30\%$$


Further properties

www.passivehouse.com

Pressure drop tap water at 8 l/min:0.24 barConnection tap water:1/2"AG 3/4"IGConnection waste water:DN 50

¹Balanced flow rates, cold water temperature 10 ℃, Temperature at shower head 40 ℃, waste water temperature 35 ℃, negligible pipe length, shower time 6 min, flow rate 8 l/min

Passive House phE phD phC phB phA





phA+