
CERTIFICATE

Certified Passive House Component Component-ID 1822wi03 valid until 31st December 2025 Passive House Institute Dr. Wolfgang Feist 64283 Darmstadt Germany

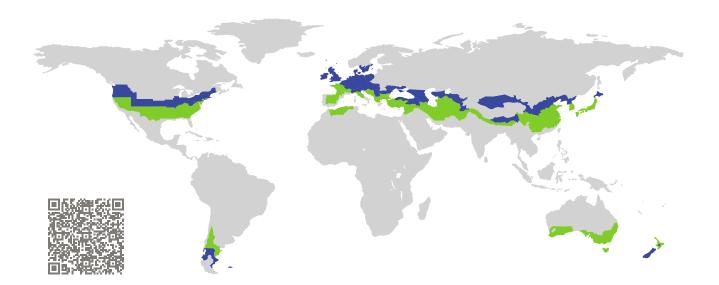



Category:	Window Frame
Manufacturer:	REYNAERS ALUMINIUM NV/SA, Duffel, Belgium
Product name:	MasterLine 10


This certificate was awarded based on the following criteria for the cool, temperate climate zone

Comfort	$U_W = 0.80$	\leq	0.80 W/(m ² K)
	$U_{W,\text{installed}}$	\leq	0.85 W/(m ² K)
	with U_g	=	$0.70 W/(m^2 K)$

Hygiene $f_{Rsi=0.25}$ \geq 0.70



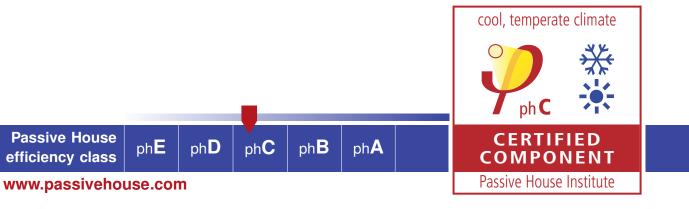

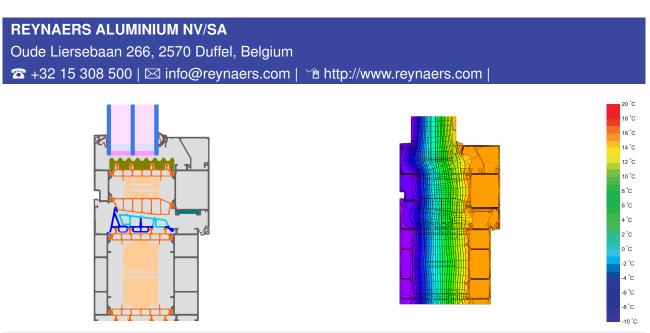

Calculation model

Isothermal

Description

Aluminium frame with thermal separation (low lambda PA 0.21 W/(mK)), XPS foam insulation (0.029 W/(mK)) and insulation (0.038 W/(mK)) in the rebate; Pane thickness: 48 mm (4/18/4/18/4), rebate depth: 18 mm

Explanation

The window U-values were calculated for the test window size of 1.23 m \times 1.48 m with $U_g = 0.70$ W/(m² K). If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	$U_g =$	0.70	0.64	0.58	0.52	W/(m ² K)
		\downarrow	\downarrow	\downarrow	\downarrow	
Window	$U_W =$	0.80	0.77	0.74	0.70	W/(m ² K)

Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Validated installations

Formwork blo	cks (operable)	Lightwei	ght timber (operable)	Exterior insulation and finishing system (EIFS) (operable)			
$U_{\text{Wall}} = 0.1$	5 W/(m² K)	U _{Wall}	$= 0.13 \text{ W}/(\text{m}^2 \text{ K})$	$U_{Wall} = 0.13 W/(m^2 K)$			
		- - - -					
$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)		
Тор	0.004	Тор	0.009	Тор	0.005		
Side	0.004	Side	0.009	Side	0.005		
Bottom	0.015	Bottom	0.020	Bottom	0.018		
$U_{W,\text{installed}} = 0$	$U_{W,\text{installed}} = 0.82 \text{W}/(\text{m}^2 \text{K})$		$U_{W,\text{installed}} = 0.84 \text{ W/(m}^2 \text{ K)}$ $U_{W,\text{installed}} = 0.83 \text{ W/(m}^2 \text{ K)}$		$U_{W,\text{installed}} = 0.84 \text{ W/(m}^2 \text{ K)}$		0.83 W/(m ² K)
Frame width U -value frame Ψ -glazing edgeTemp. Factor F are a set U U Ψ f_{0} e_{0}							

Frame value	es		Frame width <i>b_f</i> mm	<i>U</i> -value frame <i>U</i> f W/(m ² K)	Ψ -glazing edge Ψ_g W/(m K)	Iemp. Factor f _{Rsi=0.25} [-]	
Mullion 1 casement	(1M1)	~7	186	0.79	0.030	0.78	
Bottom	(OB1)	4	172	0.78	0.030	0.78	
Тор	(OH1)	Ĩ	172	0.78	0.030	0.78	
Lateral	(OJ1)		172	0.78	0.030	0.78	
Spacer: SWISSPACER Ultimate				e Seco	Secondary seal: Polysulfide		

www.passivehouse.com