


# CERTIFICATE

Certified Passive House Component

Component-ID 2187ws03 valid until 31st December 2025

Passive House Institute  
Dr. Wolfgang Feist  
64283 Darmstadt  
Germany

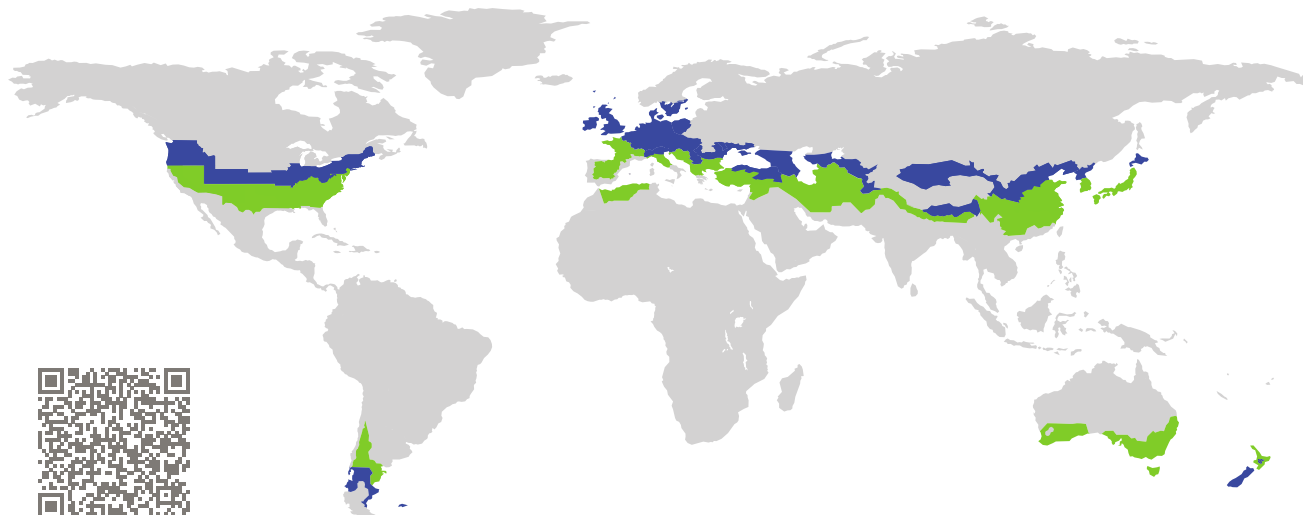


Category: **Window system**  
Manufacturer: **INTUS Windows,  
Lorton, VA,  
United States of America**  
Product name: **Supera 83 Passive+**

**This certificate was awarded based on the following  
criteria for the cool, temperate climate zone**

Comfort  $U_{W=0.80} \leq 0.80 \text{ W}/(\text{m}^2 \text{ K})$   
 $U_{W,\text{installed}} \leq 0.85 \text{ W}/(\text{m}^2 \text{ K})$   
with  $U_g = 0.70 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene  $f_{Rsi=0.25} \geq 0.70$   
Airtightness  $Q_{100} = 0.16 \leq 0.25 \text{ m}^3/(\text{h m})$

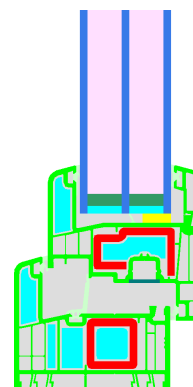

Passive House  
efficiency class

phE

phD

phC

phB


phA

cool, temperate climate



**CERTIFIED  
COMPONENT**

Passive House Institute

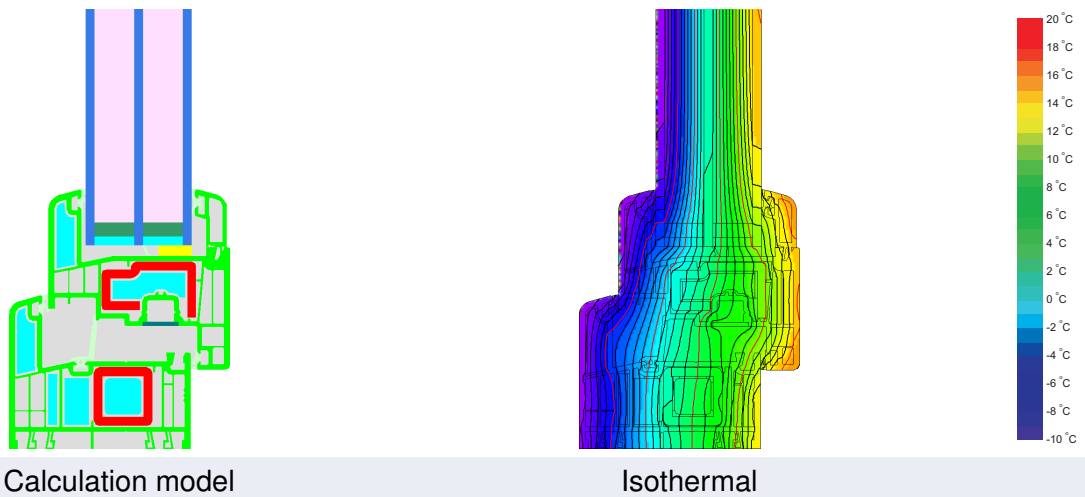

**Description**

Multi-cavity vinyl-frame with undersill options. Cavities partly filled with insulation (0.033 W/(mK)). Reinforcements from fibre-reinforced polymer (0.36 W/(mK)). Pane thickness: 48 mm (4/18/4/18/4), rebate depth: 15 mm.

**Explanation**

The window U-values were calculated for the test window size of 2.46 m × 1.48 m with  $U_g = 0.70 \text{ W}/(\text{m}^2 \text{ K})$ . If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	$U_g =$	0.70	0.64	0.58	0.54	W/(m <sup>2</sup> K)
		↓	↓	↓	↓	
Window	$U_W =$	0.80	0.76	0.72	0.69	W/(m <sup>2</sup> K)


Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on [www.passivehouse.com](http://www.passivehouse.com) and [passipedia.org](http://passipedia.org).



Frame values			Frame width $b_f$ mm	$U$ -value frame $U_f$ W/(m <sup>2</sup> K)	$\Psi$ -glazing edge $\Psi_g$ W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Mullion fixed	(0M1)		108	0.78	0.019	0.76
Mullion 2 casements	(2M1)		204	1.02	0.024	0.72
Bottom fixed	(FB1)		100	0.98	0.019	0.68
Top fixed	(FH1)		70	0.75	0.019	0.76
Lateral fixed	(FJ1)		70	0.75	0.019	0.76
Flying Mullion	(FM1)		156	0.87	0.019	0.74
Bottom	(OB1)		118	0.88	0.019	0.74
Top	(OH1)		118	0.88	0.019	0.74
Lateral	(OJ1)		118	0.88	0.019	0.74
Threshold	(OT1)		123	1.53	0.020	0.59
Sash Variant	(SV1)		148	1.02	0.020	0.70


Spacer: MULTITECH G                      Secondary seal: Butyl



**Mullion fixed**



$b_f = 108 \text{ mm}$   
 $U_f = 0.78 \text{ W/(m}^2 \text{ K)}$   
 $\Psi_g = 0.019 \text{ W/(m K)}$   
 $f_{Rsi} = 0.76$



**Mullion 2 casements**

$b_f = 204 \text{ mm}$   
 $U_f = 1.02 \text{ W/(m}^2 \text{ K)}$   
 $\Psi_g = 0.024 \text{ W/(m K)}$   
 $f_{Rsi} = 0.72$





Bottom  
fixed

$$b_f = 100 \text{ mm}$$

$$U_f = 0.98 \text{ W/(m}^2 \text{ K)}$$

$$\Psi_g = 0.019 \text{ W/(m K)}$$

$$f_{Rsi} = 0.68$$





Top  
fixed

$$b_f = 70 \text{ mm}$$

$$U_f = 0.75 \text{ W/(m}^2 \text{ K)}$$

$$\Psi_g = 0.019 \text{ W/(m K)}$$

$$f_{Rsi} = 0.76$$





Lateral  
fixed

$$b_f = 70 \text{ mm}$$

$$U_f = 0.75 \text{ W/(m}^2 \text{ K)}$$

$$\Psi_g = 0.019 \text{ W/(m K)}$$

$$f_{Rsi} = 0.76$$

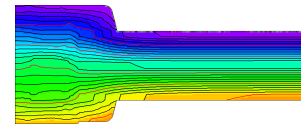



Flying Mullion

$$b_f = 156 \text{ mm}$$

$$U_f = 0.87 \text{ W/(m}^2 \text{ K)}$$

$$\Psi_g = 0.019 \text{ W/(m K)}$$

$$f_{Rsi} = 0.74$$





Bottom

$$b_f = 118 \text{ mm}$$

$$U_f = 0.88 \text{ W/(m}^2 \text{ K)}$$

$$\Psi_g = 0.019 \text{ W/(m K)}$$



$$f_{Rsi} = 0.74$$







### Top

$b_f = 118 \text{ mm}$   
 $U_f = 0.88 \text{ W/(m}^2 \text{ K)}$   
 $\Psi_g = 0.019 \text{ W/(m K)}$   
 $f_{Rsi} = 0.74$





### Lateral

$b_f = 118 \text{ mm}$   
 $U_f = 0.88 \text{ W/(m}^2 \text{ K)}$   
 $\Psi_g = 0.019 \text{ W/(m K)}$   
 $f_{Rsi} = 0.74$

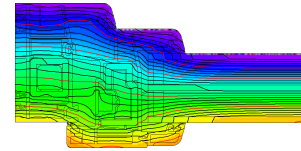



### Threshold

$b_f = 123 \text{ mm}$   
 $U_f = 1.53 \text{ W/(m}^2 \text{ K)}$   
 $\Psi_g = 0.020 \text{ W/(m K)}$   
 $f_{Rsi} = 0.59$









### Sash Variant

$b_f = 148 \text{ mm}$   
 $U_f = 1.02 \text{ W/(m}^2 \text{ K)}$   
 $\Psi_g = 0.020 \text{ W/(m K)}$   
 $f_{Rsi} = 0.70$




## Validated installations

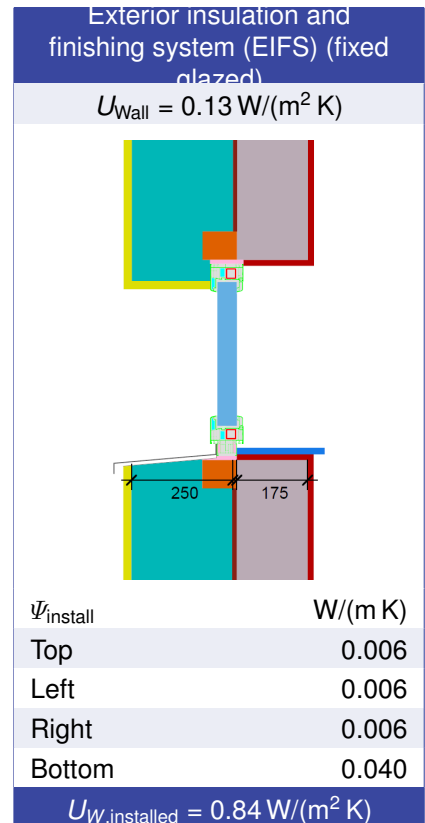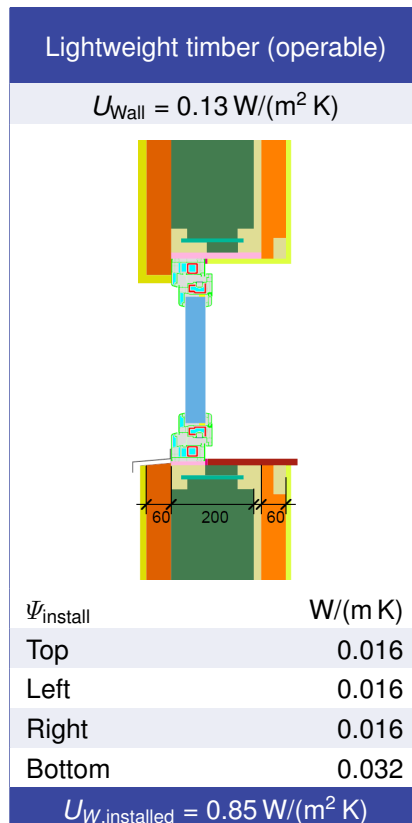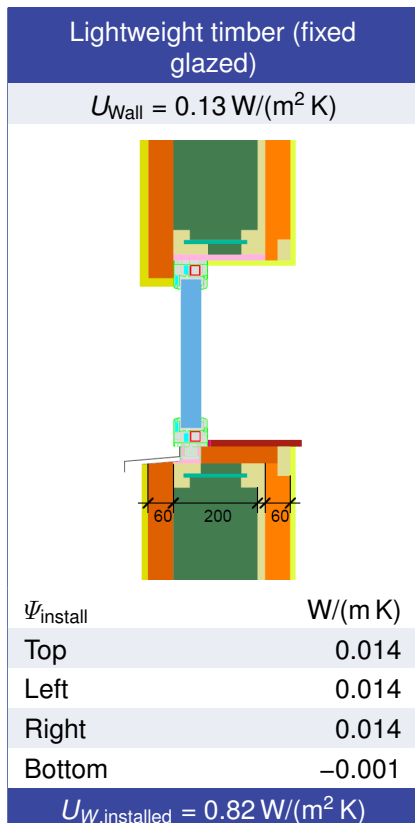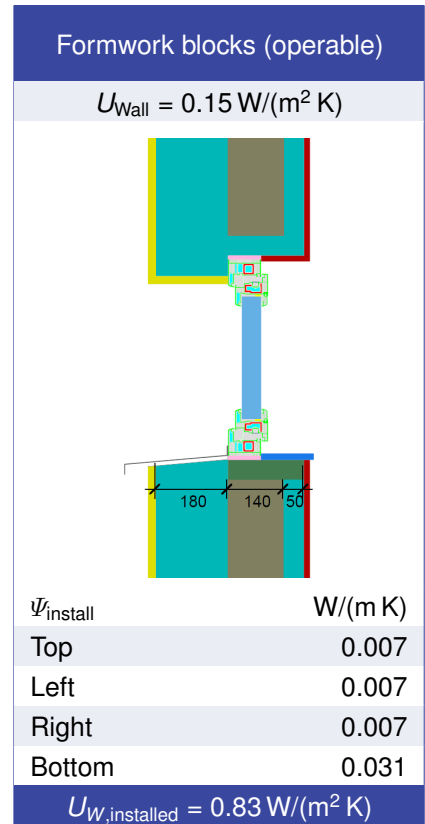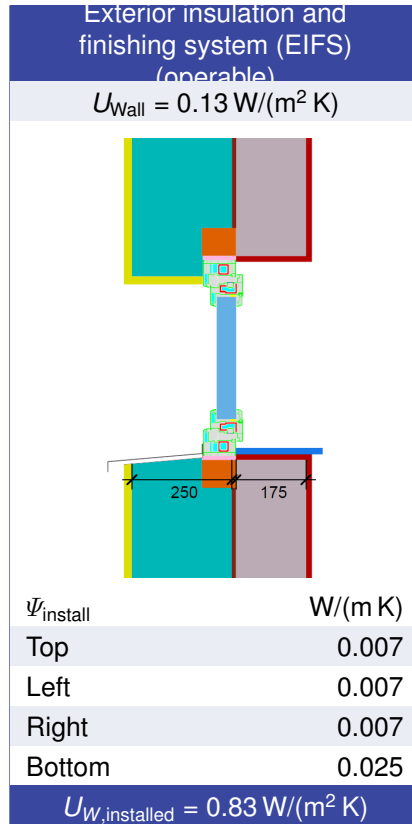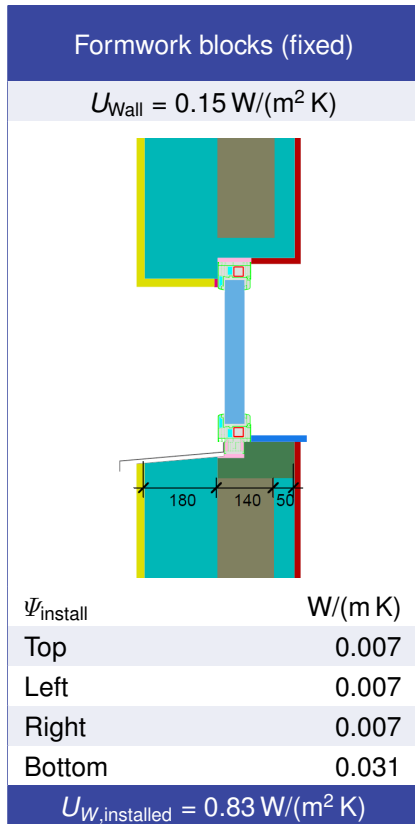

Ext insulation a. finish. s. (EIFS)  
threshold ceiling (operable)

$$U_1 = 0.13 \text{ [W/(m}^2 \text{ K)]}$$

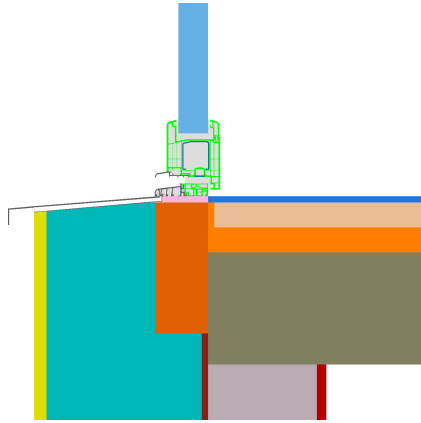

$$\Psi_{\text{install}} = 0.05 \text{ W/(m K)}$$

