CERTIFICATE

Certified Passive House Component

Component-ID 2161wi03 valid until 31st December 2025

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

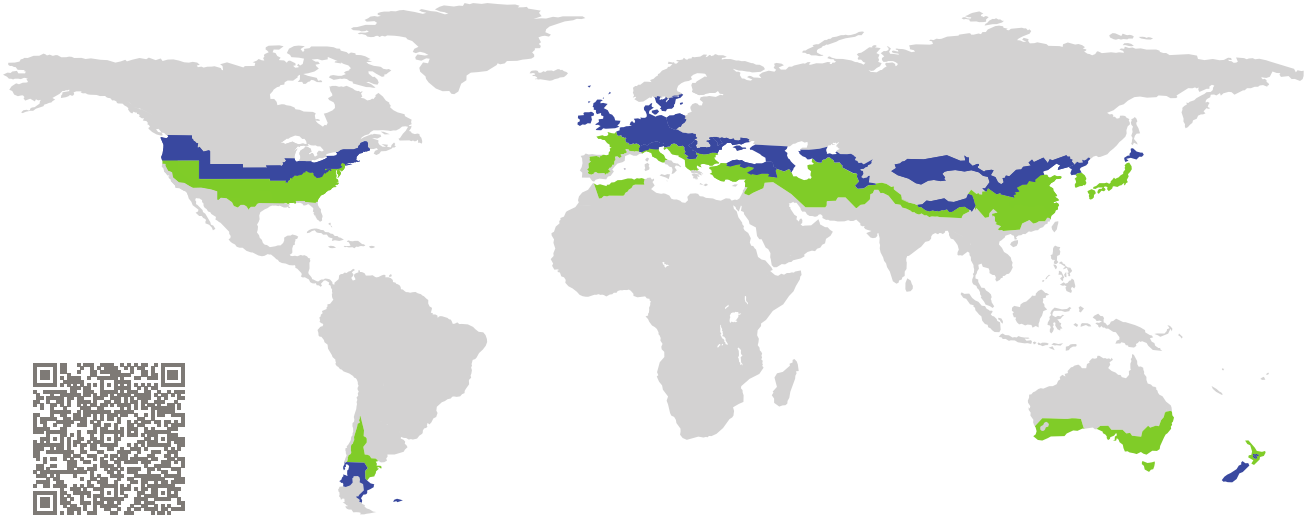

Category:	**Window Frame**
Manufacturer:	**Weifang Yerui Industry and Trade Co., Ltd., Weifang, China**
Product name:	**YHS103**

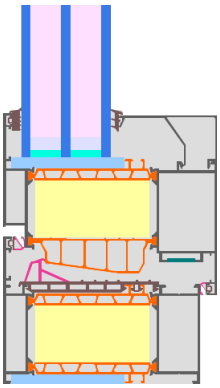

This certificate was awarded based on the following criteria for the cool, temperate climate zone

Comfort	$U_W = 0.80$	$\leq$	0.80 W/(m² K)
	$U_{W,\text{installed}}$	$\leq$	0.85 W/(m² K)
	with U_g	=	0.70 W/(m² K)
Hygiene	$f_{Rsi=0.25}$	$\geq$	0.70

cool, temperate climate

phC

CERTIFIED COMPONENT

Passive House Institute

Passive House efficiency class	phE	phD	phC	phB	phA

www.passivehouse.com

Weifang Yerui Industry and Trade Co., Ltd.
200 meters south of Huangshan Road, Dongcheng Street, 262600 Weifang, China
☎ +8618265607888 | ✉ 84292947@qq.com | |

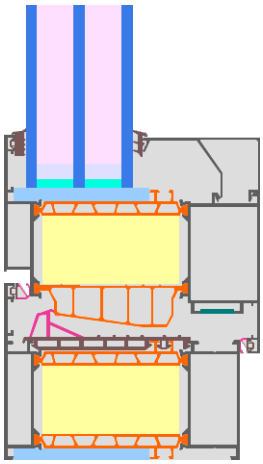

Calculation model

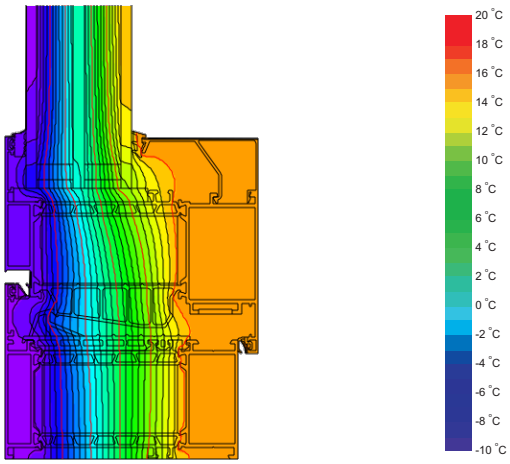

Isothermal

Description

Aluminium frame with thermal separation (Technoform Low Lambda PA 0.21 W/(mK)) and insulation (Kooltherm 0.022 W/(mK)); Pane thickness: 47 mm (5/16/5/16/5), rebate depth: 23 mm. Spacer: Technoform SP16 with butyl secondary seal.

Explanation

The window U-values were calculated for the test window size of 1.23 m × 1.48 m with U_g = 0.70 W/(m^2 K). If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	U_g =	0.70	0.64	0.58	0.52	W/(m^2 K)
		↓	↓	↓	↓	
Window	U_W =	0.80	0.77	0.73	0.69	W/(m^2 K)

Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification
can be found on www.passivehouse.com and passipedia.org.

Validated installations

Formwork blocks (operable)	
U_{Wall} = 0.15 W/(m² K)	
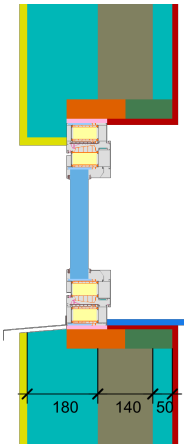	
$\Psi_{install}$	W/(m K)
Top	0.014
Side	0.014
Bottom	0.019
$U_{W,installed}$ = 0.85 W/(m² K)	

Ventilated facade (operable)	
U_{Wall} = 0.13 W/(m² K)	
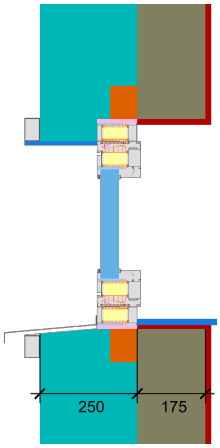	
$\Psi_{install}$	W/(m K)
Top	0.015
Side	0.015
Bottom	0.022
$U_{W,installed}$ = 0.85 W/(m² K)	

Exterior insulation and finishing system (EIFS) (operable)	
U_{Wall} = 0.13 W/(m² K)	
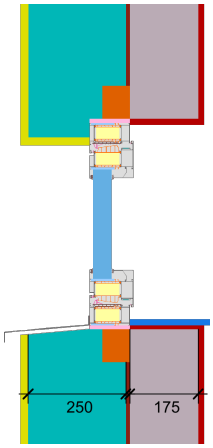	
$\Psi_{install}$	W/(m K)
Top	0.016
Side	0.016
Bottom	0.022
$U_{W,installed}$ = 0.85 W/(m² K)	

Frame values		Frame width b_f mm	U-value frame U_f W/(m² K)	Ψ-glazing edge Ψ_g W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Mullion 1 casement	(1M1)	167	0.80	0.026	0.78
Bottom	(OB1)	143	0.80	0.027	0.79
Top	(OH1)	143	0.80	0.027	0.79
Lateral	(OJ1)	143	0.80	0.027	0.79
Spacer: Technoform-Spacer SP16			Secondary seal: Butyl		