
CERTIFICATE

Certified Passive House Component Component-ID 1295wi03 valid until 31st December 2025 Passive House Institute Dr. Wolfgang Feist 64283 Darmstadt Germany

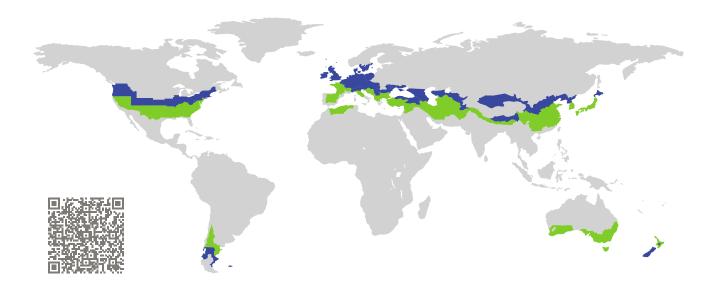



Category:	Window Frame
Manufacturer:	Xianghe Wanlitong Industrial Co. Ltd, Langfang, China
Product name:	RiseSun002146A


This certificate was awarded based on the following criteria for the cool, temperate climate zone

Comfort	$U_W = 0.80$	\leq	0.80 W/(m ² K)
	$U_{W,\text{installed}}$	\leq	$0.85 W/(m^2 K)$
	with U_g	=	0.70 W/(m ² K)

Hygiene $f_{Rsi=0.25}$ \geq 0.70



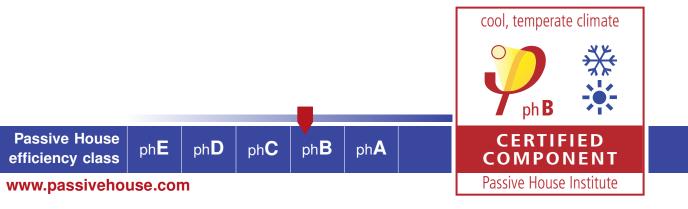

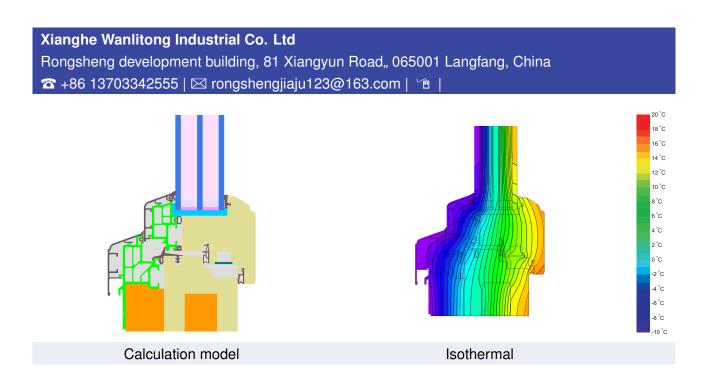

Description

Timber frame with external PVC-aluminium shell and insulation (XPS 035); Pane thickness: 45 mm (5/15/5/15/5), rebate depth: 13 mm. Spacer: SWISSPACER Ultimate.

Explanation

The window U-values were calculated for the test window size of 1.23 m \times 1.48 m with $U_g = 0.70$ W/(m² K). If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	$U_g =$	0.70	0.64	0.58	0.54	W/(m ² K)
		\downarrow	\downarrow	\downarrow	\downarrow	
Window	$U_W =$	0.80	0.76	0.72	0.70	W/(m ² K)

Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Validated installations

Formwork blocks (operable)		Lightweight t	imber (operable)	Exterior insulation and finishing system (EIFS) (operable)		
$U_{\text{Wall}} = 0.15$	W/(m ² K)	$U_{Wall} = 0$.13 W/(m ² K)	$U_{Wall} = 0$).13 W/(m ² K)	
	MI AL VI AL VIA VIA AL		I a construction of the second		Array and a second	
$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)	
Тор	0.006	Тор	0.012	Тор	0.005	
Side	0.006	Side	0.012	Side	0.005	
Bottom	0.014	Bottom	0.016	Bottom	0.013	
$U_{W,\text{installed}} = 0.3$	83 W/(m ² K)	U _{W,installed} =	= 0.84 W/(m ² K)	U _{W,installed} =	= 0.82 W/(m ² K)	

Frame value	es		Frame width <i>b_f</i> mm	<i>U</i> -value frame <i>U</i> f W/(m ² K)	$arPsi$ -glazing edge $arPsi_g$ W/(m K)	Temp. Factor f _{Rsi=0.25} [-]	
Mullion 1 casement	(1M1)	-1	149	0.89	0.029	0.72	
Bottom	(OB1)	4	128	0.79	0.030	0.73	
Тор	(OH1)	T	128	0.79	0.030	0.73	
Lateral	(OJ1)	1	128	0.79	0.030	0.73	
Spacer: SWISSPACER Ultimate				e Seco	Secondary seal: Polysulfide		

www.passivehouse.com