


CERTIFICATE

Certified Passive House Component

Component-ID 1525fx03 valid until 31st December 2025

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

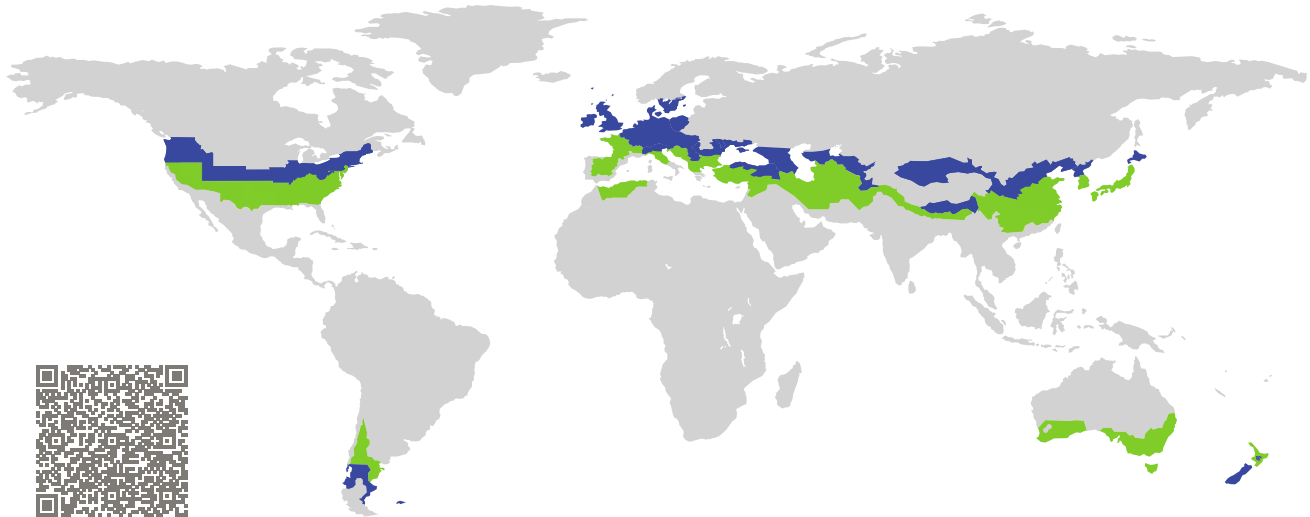


Category: **Fixed window**
Manufacturer: **FENETRES-FRANC-COMTOISES
MENUISERIE THIEBAUD,
Belleherbe,
France**
Product name: **Caméléwood fixe bois alu**

**This certificate was awarded based on the following
criteria for the cool, temperate climate zone**

Comfort $U_W = 0.78 \leq 0.80 \text{ W}/(\text{m}^2 \text{ K})$
 $U_{W,\text{installed}} \leq 0.85 \text{ W}/(\text{m}^2 \text{ K})$
with $U_g = 0.70 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene $f_{Rsi=0.25} \geq 0.70$

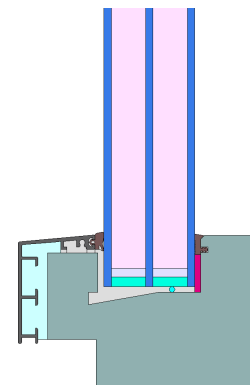

Passive House
efficiency class

phE

phD

phC

phB


phA

cool, temperate climate



**CERTIFIED
COMPONENT**

Passive House Institute

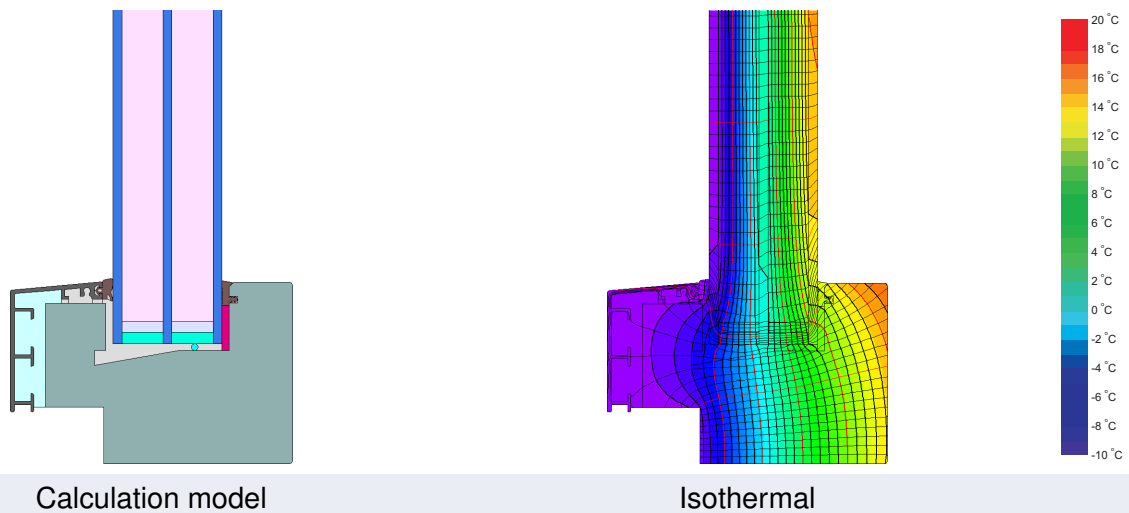

Description

Timberframe Jura fir (0.11 W / (mK)), PEFC certified, laminated wood, free of glue with aluminium facing shell, sealings and gaskets made of EPDM and silicone. Glass thickness: 48 mm (4/18/4/18/4), rebate depth: 27 mm, Spacer : Edgetech super spacer premium, Butyl secondary sealing. Recyclable at life-cycle end.

Explanation

The window U-values were calculated for the test window size of 1.23 m × 1.48 m with $U_g = 0.70 \text{ W}/(\text{m}^2 \text{ K})$. If a higher quality glazing is used, the window U-values will improve as follows:




Glazing	$U_g =$	0.70	0.64	0.58	0.52	W/(m ² K)
		↓	↓	↓	↓	
Window	$U_W =$	0.78	0.73	0.69	0.64	W/(m ² K)





Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

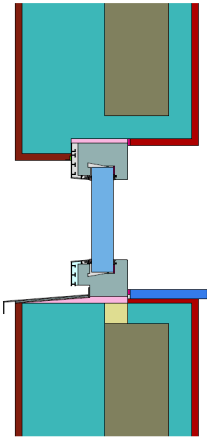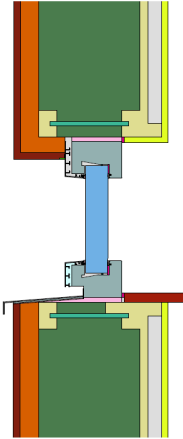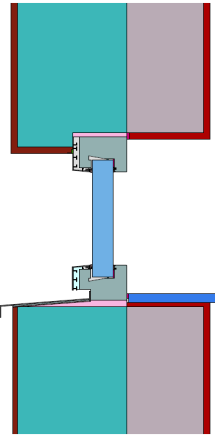Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Validated installations

Formwork blocks (fixed)	Lightweight timber (fixed glazed)	Exterior insulation and finishing system (EIFS) (fixed glazed)
$U_{Wall} = 0.15 \text{ W}/(\text{m}^2 \text{ K})$	$U_{Wall} = 0.15 \text{ W}/(\text{m}^2 \text{ K})$	$U_{Wall} = 0.13 \text{ W}/(\text{m}^2 \text{ K})$
		
$\Psi_{install}$ W/(m K)	$\Psi_{install}$ W/(m K)	$\Psi_{install}$ W/(m K)
Top 0.014	Top 0.017	Top 0.008
Side 0.014	Side 0.017	Side 0.008
Bottom 0.026	Bottom 0.029	Bottom 0.020
$U_{W,installed} = 0.83 \text{ W}/(\text{m}^2 \text{ K})$	$U_{W,installed} = 0.84 \text{ W}/(\text{m}^2 \text{ K})$	$U_{W,installed} = 0.81 \text{ W}/(\text{m}^2 \text{ K})$

Frame values		Frame width b_f mm	U -value frame U_f W/(m ² K)	Ψ -glazing edge Ψ_g W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Mullion 1 casement	(1M1) 	174	0.78	0.020	0.78
Bottom fixed	(FB1) 	80	0.92	0.020	0.74
Top fixed	(FH1) 	80	0.79	0.020	0.76
Lateral fixed	(FJ1) 	80	0.79	0.020	0.76
Spacer: Super Spacer® Premium			Secondary seal: Butyl		

