


CERTIFICATE

Certified Passive House Component

Component-ID 1901ed03 valid until 31st December 2025

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

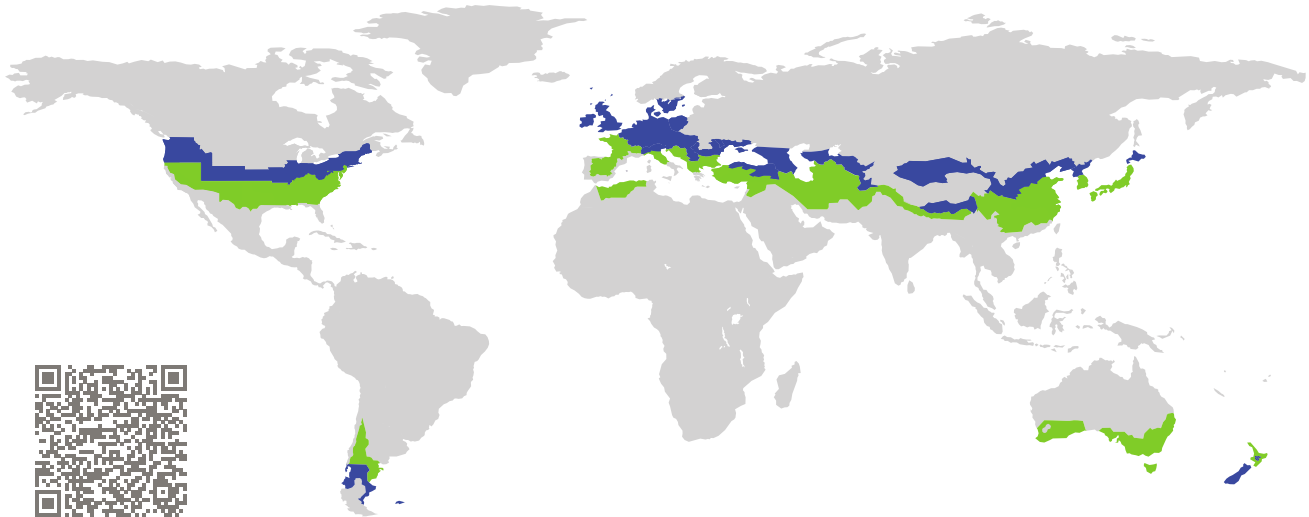


Category: **Entry door(opaque)**
Manufacturer: **Schüco International KG**
Bielefeld, Nordrhein-Westfalen
Germany
Product name: **AD UP 90.SI**

This certificate was awarded based on the following criteria for the cool, temperate climate zone

Comfort $U_D = 0.68 \leq 0.80 \text{ W}/(\text{m}^2 \text{ K})$
 $U_{D, \text{installed}} \leq 0.85 \text{ W}/(\text{m}^2 \text{ K})$
with $U_{\text{door leaf}}^1 = 0.38 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene $f_{Rsi=0.25} \geq 0.70$
Airtightness $Q_{100} = 2.11 \leq 2.25 \text{ m}^3/(\text{h m})$

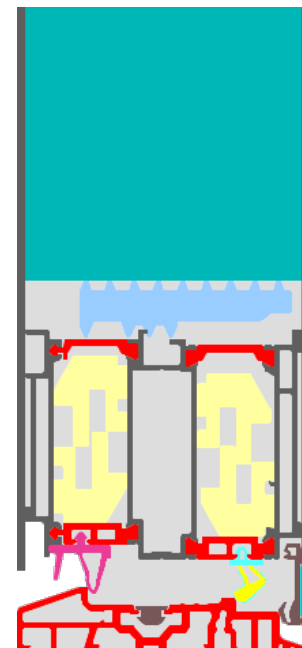

(Inward opening)


¹U-value of the insulated area of door leaf

cool, temperate climate




**CERTIFIED
COMPONENT**


Passive House Institute

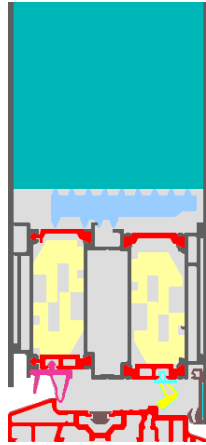

Calculation model

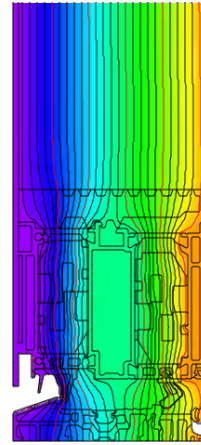

Isothermal



Description

Door made of aluminium, thermally separated with glass fibre-reinforced plastic (25% glass fibre, 0,30 W/(mK)), insulated with Kooltherm phenolic foam (0,022 W/(mK)) and polyethylene foam (0,038 W/(mK)). Door leaf insulation: EPS (0,035 W/(mK)). Threshold: glass fibre-reinforced plastic (25% glass fibre, 0,30 W/(mK)). The door meets airtightness class 3 according to DIN EN 12207:2017-03.

Explanation

The U-values of the door apply to a door 1.10 m wide by 2.20 m tall.


A detailed report of the calculations performed in the context of certification is available from the manufacturer.

Unless stated otherwise, the air tightness was determined according to EN 1026 with respect to the joint length under climate load in conjunction with EN 1121 for the closed, non-locked door. The result corresponds at least to air-tightness class 3 according to EN 12207.



The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.


Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Frame values		Frame width b_f mm	U -value frame U_f W/(m ² K)	Ψ edge Ψ_g W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Door hinge side	(DJ1) 	158	1.14	0.005	0.78
Door lock side	(DL1) 	158	1.15	0.005	0.78
Top	(OH1) 	158	1.14	0.005	0.77
Threshold	(OT2) 	115	1.16	0.004	0.80
		Spacer: -	Secondary seal: -		



 Door hinge side


$b_f = 158 \text{ mm}$
 $U_f = 1.14 \text{ W/(m}^2 \text{ K)}$
 $\Psi_g = 0.005 \text{ W/(m K)}$
 $f_{Rsi} = 0.78$



 Door lock side


$b_f = 158 \text{ mm}$
 $U_f = 1.15 \text{ W/(m}^2 \text{ K)}$
 $\Psi_g = 0.005 \text{ W/(m K)}$
 $f_{Rsi} = 0.78$



 Top

$b_f = 158 \text{ mm}$
 $U_f = 1.14 \text{ W/(m}^2 \text{ K)}$
 $\Psi_g = 0.005 \text{ W/(m K)}$
 $f_{Rsi} = 0.77$

 Threshold


$b_f = 115 \text{ mm}$
 $U_f = 1.16 \text{ W/(m}^2 \text{ K)}$
 $\Psi_g = 0.004 \text{ W/(m K)}$
 $f_{Rsi} = 0.80$

Validated installations

Formwork blocks top (operable)


$U_1 = 0.15 \text{ [W/(m}^2 \text{ K)]}$

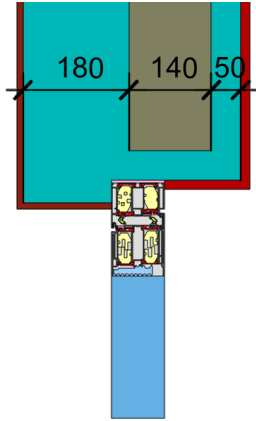

$\Psi_{\text{install}} = 0.02 \text{ W/(m K)}$

Formwork blocks side (operable)


$U_1 = 0.15 \text{ [W/(m}^2 \text{ K)]}$

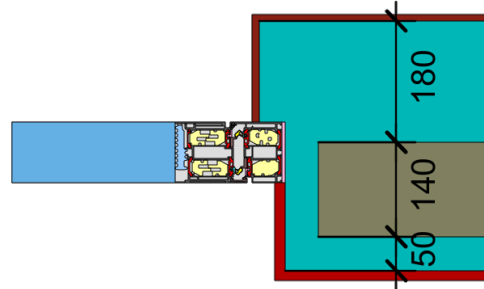

$\Psi_{\text{install}} = 0.02 \text{ W/(m K)}$

Formwork blocks side (operable)


$U_1 = 0.15 \text{ [W/(m}^2 \text{ K)]}$

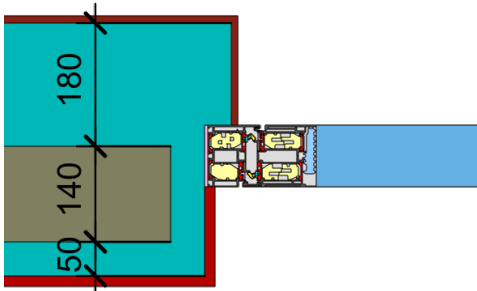

$\Psi_{\text{install}} = 0.02 \text{ W/(m K)}$

Lightweight timber top (operable)


$U_1 = 0.13 \text{ [W/(m}^2 \text{ K)]}$

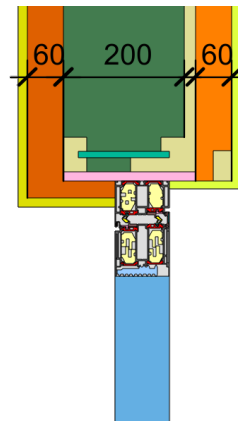

$\Psi_{\text{install}} = 0.02 \text{ W/(m K)}$

Lightweight timber side (operable)


$U_1 = 0.13 \text{ [W/(m}^2 \text{ K)]}$

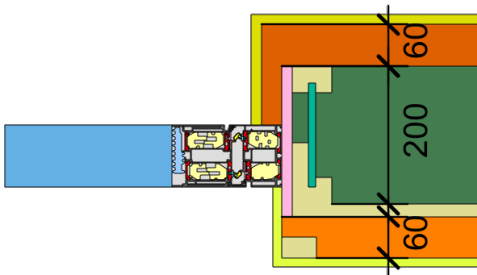

$\Psi_{\text{install}} = 0.02 \text{ W/(m K)}$

Lightweight timber side (operable)


$U_1 = 0.13 \text{ [W/(m}^2 \text{ K)]}$

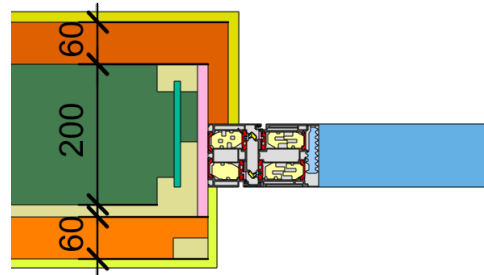

$\Psi_{\text{install}} = 0.02 \text{ W/(m K)}$

Exterior insulation and finishing s (EIFS)
top (operable)


$$U_1 = 0.13 \text{ [W/(m}^2 \text{ K)]}$$

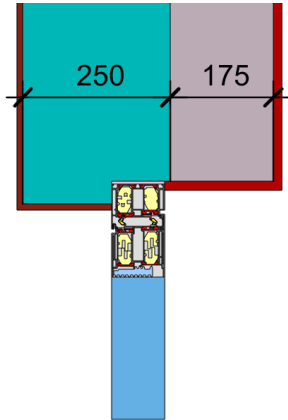

$$\Psi_{\text{install}} = 0.02 \text{ W/(m K)}$$

Ext. ins. a. finish. s. (EIFS) threshold
floor slab (operable)


$$U_1 = 0.13 \text{ [W/(m}^2 \text{ K)]}$$

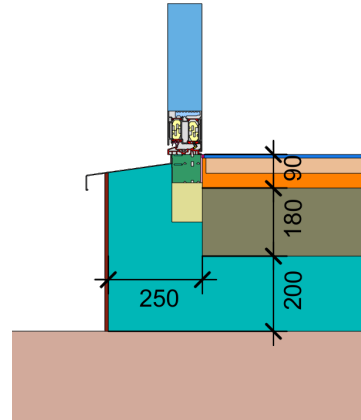

$$\Psi_{\text{install}} = 0.03 \text{ W/(m K)}$$

Ext insulation a. finish. s. (EIFS)
threshold ceiling (operable)


$$U_1 = 0.14 \text{ [W/(m}^2 \text{ K)]}$$

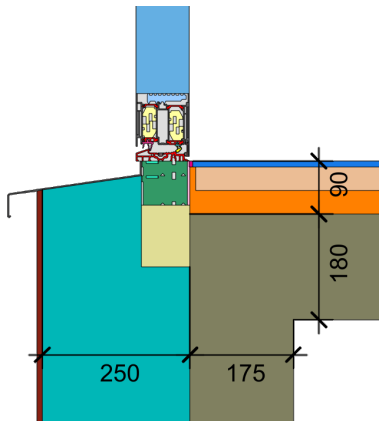

$$\Psi_{\text{install}} = 0.05 \text{ W/(m K)}$$

Exterior insulation and finishing s (EIFS)
threshold (operable)


$$U_1 = 0.14 \quad U_2 = 0.12 \text{ [W/(m}^2 \text{ K)]}$$

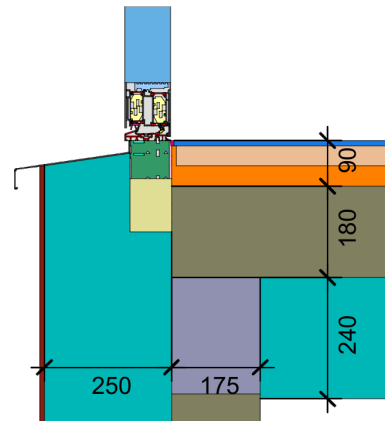

$$\Psi_{\text{install}} = 0.02 \text{ W/(m K)}$$

Exterior insulation and finishing system
(EIFS) side (operable)


$$U_1 = 0.13 \text{ [W/(m}^2 \text{ K)]}$$

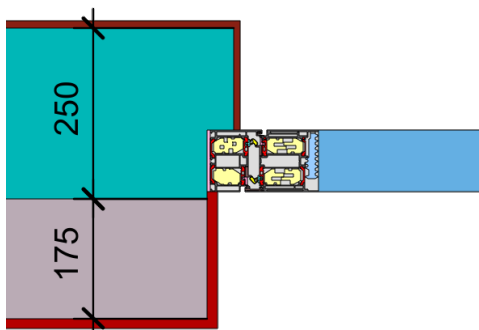

$$\Psi_{\text{install}} = 0.02 \text{ W/(m K)}$$

Exterior insulation and finishing system
(EIFS) side (operable)

$$U_1 = 0.13 \text{ [W/(m}^2 \text{ K)]}$$

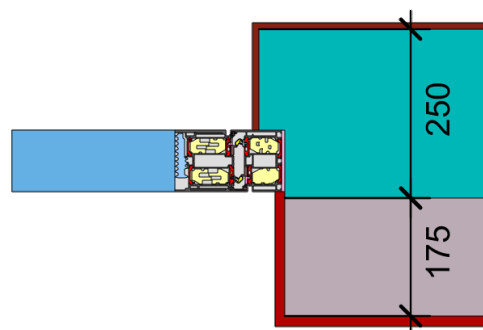

$$\Psi_{\text{install}} = 0.02 \text{ W/(m K)}$$

