


CERTIFICATE

Certified Passive House Component

Component-ID 2093wi04 valid until 31st December 2025

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

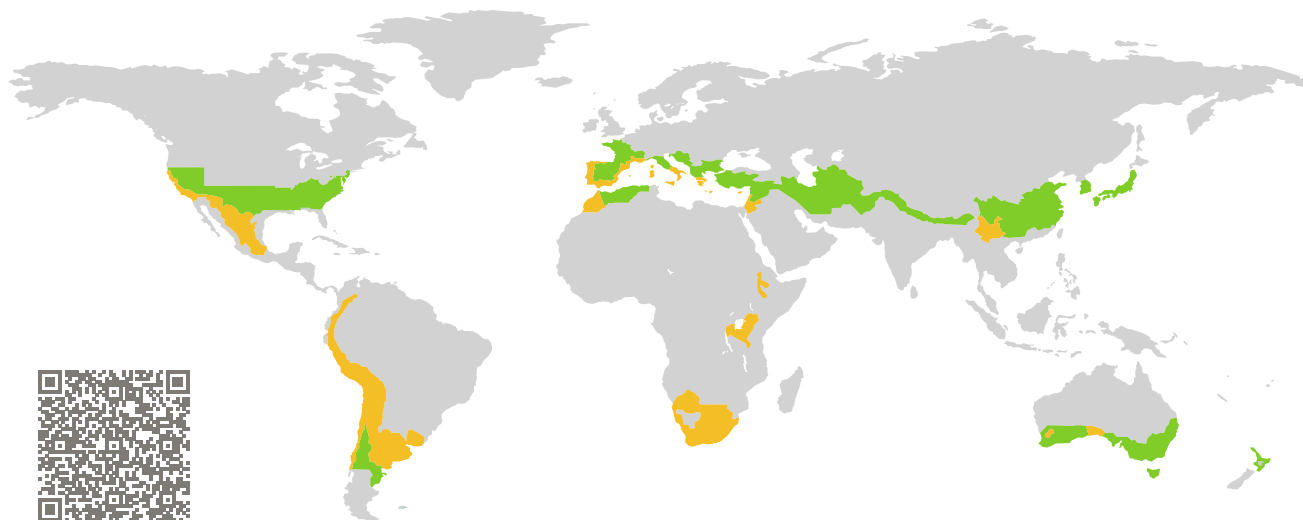


Category: **Window Frame**
Manufacturer: **Durable Window Industry Co.,Ltd,
Jiaozuo City,
China**
Product name: **PVC-U Passive Window**

**This certificate was awarded based on the following
criteria for the warm, temperate climate zone**

Comfort $U_W = 1.00 \leq 1.00 \text{ W}/(\text{m}^2 \text{ K})$
 $U_{W, \text{installed}}$ $\leq 1.05 \text{ W}/(\text{m}^2 \text{ K})$
with U_g $= 0.90 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene $f_{Rsi=0.25} \geq 0.65$

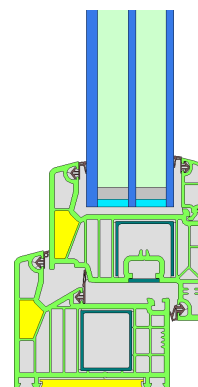

Passive House
efficiency class

phE

phD

phC

phB

phA

www.passivehouse.com

warm, temperate climate




phC



**CERTIFIED
COMPONENT**

Passive House Institute

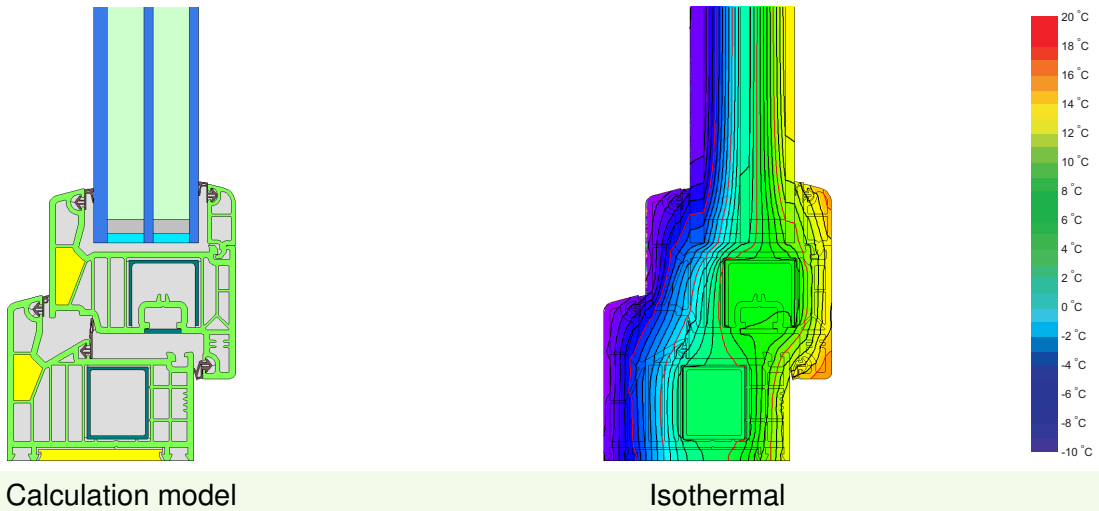

Description

Vinyl-frame with steel reinforcements. Max. dimension according to manufacturer = 2.00 m x 1.50 m. No Color restrictions. PUR-foam insulation fillings (0.028 W/(mK)) inside certain cavities. Pane thickness: 46 mm (6/16/4/16/4), rebate depth: 25 mm.

Explanation

The window U-values were calculated for the test window size of 1.23 m x 1.48 m with $U_g = 0.90 \text{ W}/(\text{m}^2 \text{ K})$. If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	$U_g =$	0.90	0.80	0.70	0.64	W/(m ² K)
		↓	↓	↓	↓	
Window	$U_W =$	1.00	0.93	0.86	0.82	W/(m ² K)

Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Validated installations

Lightweight timber (operable)		Ventilated facade		Exterior insulation and finishing system (EIFS) (operable)	
$U_{Wall} = 0.18 \text{ W}/(\text{m}^2 \text{ K})$		$U_{Wall} = 0.21 \text{ W}/(\text{m}^2 \text{ K})$		$U_{Wall} = 0.23 \text{ W}/(\text{m}^2 \text{ K})$	
<p>Exterior plaster 1.0 W/(mK) Wood fibre board 0.050 W_f Cellulose 0.040 W/(mK) OSB-board 0.13 W/(mK) Insulation 0.040 W/(mK) Plasterboard 0.25 W/(mK)</p>		<p>Ventilated facade – substructure Mineral wool 0.035 W/(mK) Concrete 2.3 W/(mK) Interior plaster 0.57 W/(mK)</p>		<p>Exterior plaster 1.0 W/(mK) EPS 0.035 W/(mK) Adhesive 0.70 W/(mK) Sand-lime brick 1.0 W/(mK) Interior plaster 0.57 W/(mK)</p>	
		<p>Suitable fastening, e.g. mounting frame or bracket, but only protruding as far as necessary for fixing the window</p>		<p>Suitable fastening, e.g. mounting frame or bracket, but only protruding as far as necessary for fixing the window</p>	
$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)
Top	0.013	Top	0.005	Top	0.005
Side	0.013	Side	0.005	Side	0.005
Bottom	0.041	Bottom	0.068	Bottom	0.069
$U_{W,installed} = 1.05 \text{ W}/(\text{m}^2 \text{ K})$		$U_{W,installed} = 1.05 \text{ W}/(\text{m}^2 \text{ K})$		$U_{W,installed} = 1.05 \text{ W}/(\text{m}^2 \text{ K})$	

Frame values		Frame width b_f mm	U -value frame U_f W/(m ² K)	Ψ -glazing edge Ψ_g W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Mullion 2 casements	(2M1)	192	1.06	0.024	0.71
Bottom	(OB1)	122	1.00	0.026	0.73
Top	(OH1)	122	1.00	0.026	0.73
Lateral	(OJ1)	122	1.00	0.026	0.73
Spacer: Technoform-Spacer SP16			Secondary seal: Butyl		

