


# CERTIFICATE

Certified Passive House Component

Component-ID 1131wi05 valid until 31st December 2021

Passive House Institute  
Dr. Wolfgang Feist  
64283 Darmstadt  
Germany

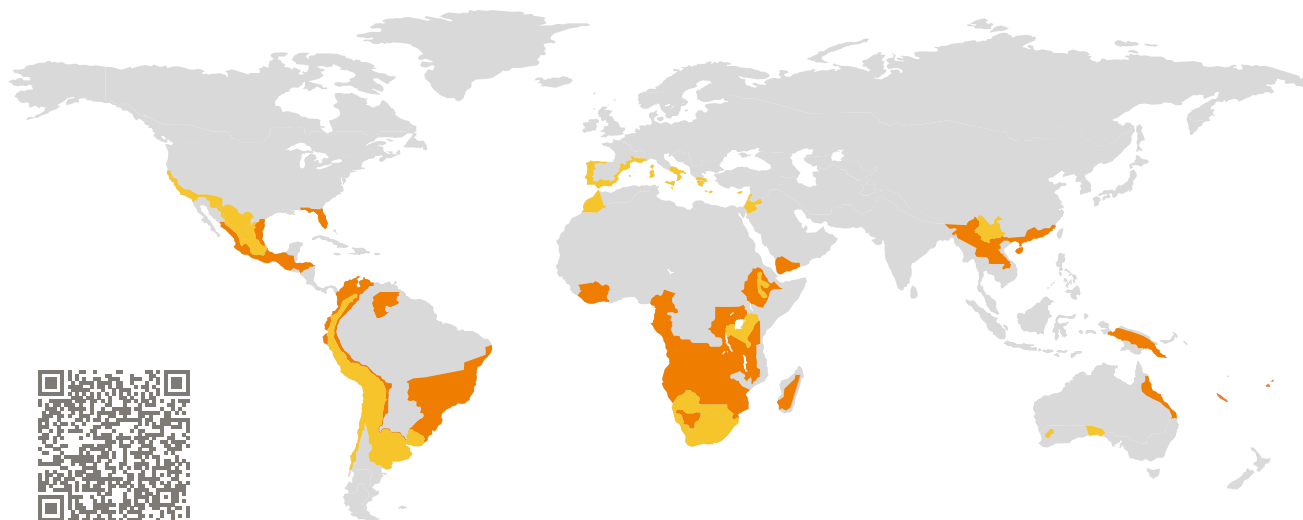


Category: **Window Frame**  
Manufacturer: **Centroalum S.A,  
Sabadell,  
Spain**  
Product name: **Renova PR RPT 75 c16**

**This certificate was awarded based on the following criteria for the warm climate zone**

Comfort  $U_W = 1.19 \leq 1.20 \text{ W}/(\text{m}^2 \text{ K})$   
 $U_{W,\text{installed}} \leq 1.25 \text{ W}/(\text{m}^2 \text{ K})$   
with  $U_g = 1.10 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene  $f_{Rsi=0.25} \geq 0.55$

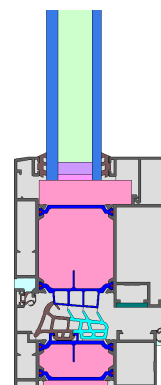

Passive House  
efficiency class

phE

phD

phC

phB

phA


[www.passivehouse.com](http://www.passivehouse.com)

warm climate



**CERTIFIED  
COMPONENT**

Passive House Institute

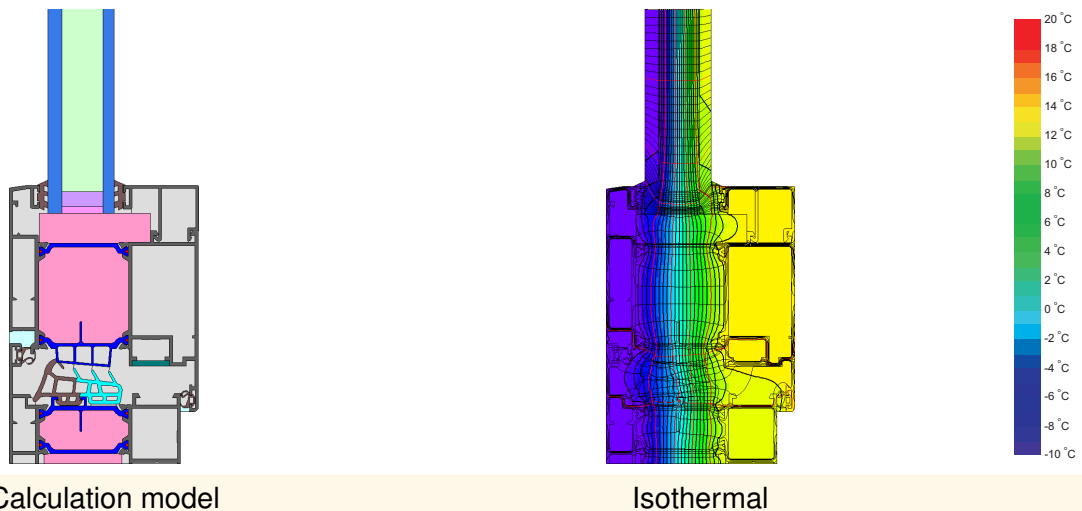

Calculation model

Isothermal

## Description

Aluminium frame with insulation of PIR-foam (0.023 W/(mK)) and struts of polyamide. Pane thickness: 29 mm (6/18/5//), rebate depth: 12 mm, spacer: SWISSPACER Ultimate

## Explanation





The window U-values were calculated for the test window size of 1.23 m × 1.48 m with  $U_g = 1.10$  W/(m<sup>2</sup> K). If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	$U_g =$	1.10	1.02	0.95	0.90	W/(m <sup>2</sup> K)
		↓	↓	↓	↓	
Window	$U_W =$	1.19	1.14	1.09	1.06	W/(m <sup>2</sup> K)




Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on [www.passivehouse.com](http://www.passivehouse.com) and [passipedia.org](http://passipedia.org).

Frame values			Frame width $b_f$ mm	$U$ -value frame $U_f$ W/(m <sup>2</sup> K)	$\Psi$ -panel edge $\Psi_g$ W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Top	(to)		123	1.05	0.044	0.69
Side	(s)		123	1.05	0.044	0.69
Bottom	(bo)		123	1.05	0.044	0.69
Mullion flying	(fm)		183	1.10	0.043	0.68
			Spacer: SWISSPACER Ultimate		Secondary seal: Polysulfid	

### Validated installations

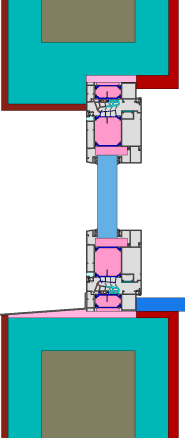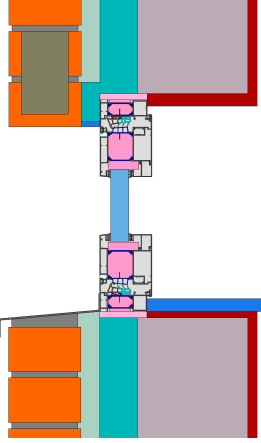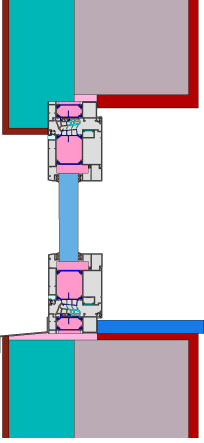Formwork blocks (operable)		Cavity wall		Exterior insulation and finishing system	
$U_{Wall} = 0.32$ W/(m <sup>2</sup> K)		$U_{Wall} = 0.44$ W/(m <sup>2</sup> K)		$U_{Wall} = 0.31$ W/(m <sup>2</sup> K)	
					
$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)
Top	0.011	Top	0.011	Top	0.015
Side	0.011	Side	0.011	Side	0.015
Bottom	0.022	Bottom	0.017	Bottom	0.027
$U_{W,installed} = 1.23$ W/(m <sup>2</sup> K)		$U_{W,installed} = 1.23$ W/(m <sup>2</sup> K)		$U_{W,installed} = 1.24$ W/(m <sup>2</sup> K)	

