


CERTIFICATE

Certified Passive House Component

Component-ID 0208ic03 valid until 31st December 2025

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

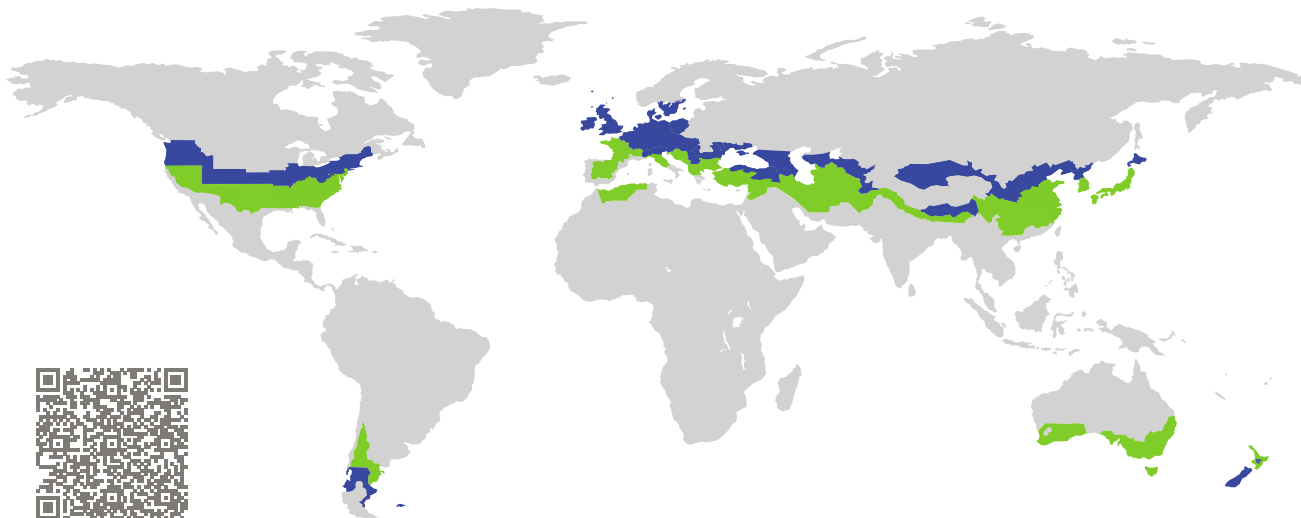


Category: **Glass roof**
Manufacturer: **RAICO Bautechnik GmbH,
Pfaffenhausen,
Germany**
Product name: **THERM+ 50 A-I (schräg)**

**This certificate was awarded based on the following
criteria for the cool, temperate climate zone**

Comfort $U_{CW,i=0.85} \leq 1.00 \text{ W}/(\text{m}^2 \text{ K})$
 $U_{CW,i,\text{installed}} \leq 1.00 \text{ W}/(\text{m}^2 \text{ K})$
with $U_g = 0.73 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene $f_{Rsi=0.25} \geq 0.70$

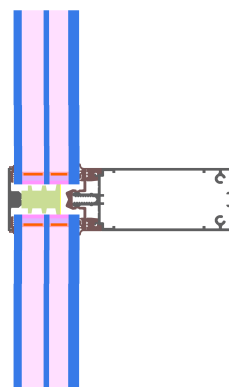

Passive House
efficiency class

phE

phD

phC

phB


phA

cool, temperate climate



**CERTIFIED
COMPONENT**

Passive House Institute

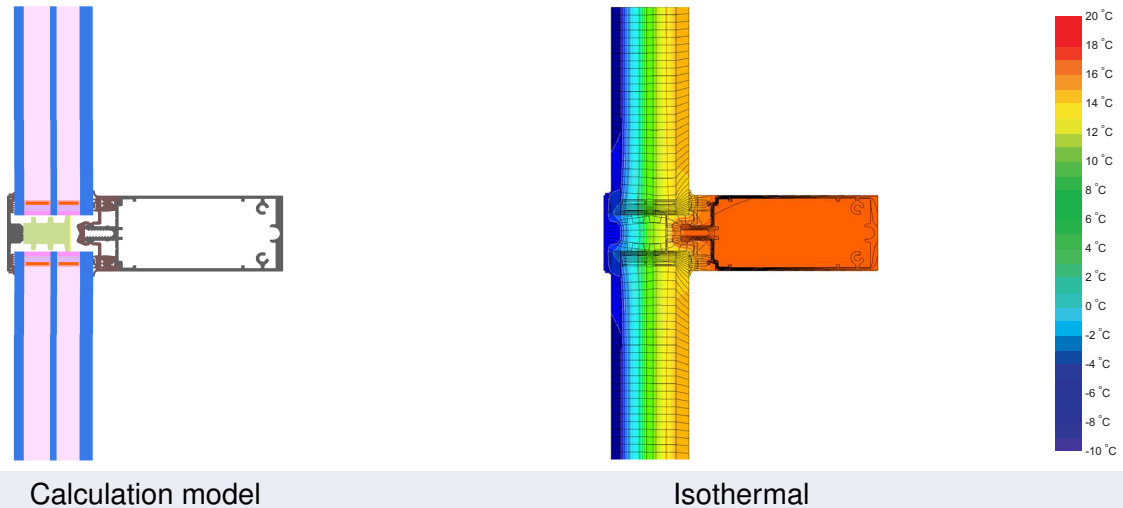

Description

Aluminium construction, with aluminium system carrier. Covering- and pressure-strip from aluminium. PE-foam insulator in the glazing rebate (0.038 W/(mK)), cover by aluminium foil on the inside. Screw- and Glass carrier losses measured by ift Rosenheim. Used Pane: 48 mm (8/14/4/16/6), intersection of the Glass: 13 mm. Used spacer: Swisspacer V. The glazing was calculated with a 3 mm secondary seal. As it is often the case that this is thicker, today the calculation is carried out with a 6 mm secondary seal. This leads to a higher glazing edge thermal bridge, which can also be estimated by way of the spacer certificates: www.passivhauskomponenten.org / glazing edge bonds. The higher rates of heat loss can be compensated for by using e. g. improved glazing.

Explanation







The element U-values were calculated for the test element size of 1.20 m × 2.50 m with $U_g = 0.73 \text{ W}/(\text{m}^2 \text{ K})$. If a higher quality glazing is used, the element U-values will improve as follows:

Glazing	$U_g =$	0.73	0.83	0.76	0.68	W/(m ² K)
		↓	↓	↓	↓	
Element	$U_{CW,i}$	0.85	0.94	0.88	0.80	W/(m ² K)

Transparent building components are sorted into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.


The Passive House Institute has defined international component criteria for seven climate zones. In principle, components that have been certified for climate zones with higher thermal requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Frame values			Frame width b_f mm	U -value frame U_f^1 W/(m ² K)	Ψ -glazing edge Ψ_g W/(m K)	Temp. Factor $f_{RSI=0.25}$ [-]
Mullion fixed	(OM1)		50	0.95	0.041	0.77
Transom fixed	(OT1)		50	1.05	0.041	0.77
Transom 1 casement	(1T1)		94	1.65	0.035	0.77
Bottom fixed	(FB1)		50	1.05	0.040	0.77
Top fixed	(FH1)		50	1.05	0.040	0.77
Lateral fixed	(FJ1)		50	0.95	0.041	0.77
Spacer: SWISSPACER V			Secondary seal: Polysulfide			

Thermal glass carrier bridge² $\chi_{GT} = 0.005$ W/K

Validated installations

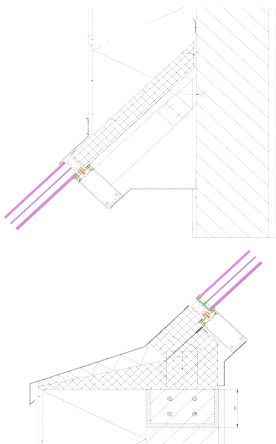Exterior insulation and finishing system (EIFS) (fixed glazed)	
	
$\Psi_{install}$	W/(m K)
Top	0.092
Left	0.092
Right	0.092
Bottom	0.105
$U_{W,installed} = 0.97$ W/(m ² K)	

¹ Includes $\Delta U = 0.23$ W/(m² K). Determined through measurement

² Determined through measurement. Glass carrier type: Non-metallic glass carrier with screws

