
CERTIFICATE

Certified Passive House Component

Component-ID 1910fx03 valid until 31st December 2025

Passive House Institute Dr. Wolfgang Feist 64283 Darmstadt Germany

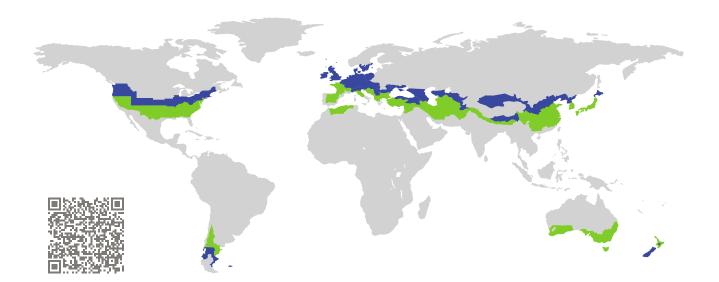



Category:	Fixed window
Manufacturer:	Aliplast Sp. z o.o.,
	LUBLIN,
	Poland
Product name:	GENESIS 90 fixed


This certificate was awarded based on the following criteria for the cool, temperate climate zone

Comfort	$U_W = 0.79$	\leq	0.80 W/(m ² K)
	$U_{W,\text{installed}}$	\leq	0.85 W/(m ² K)
	with U_g	=	$0.70 W/(m^2 K)$

Hygiene $f_{Rsi=0.25}$ \geq 0.70



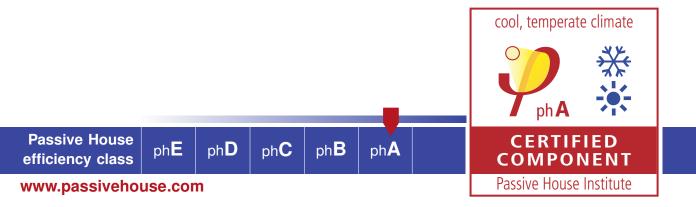

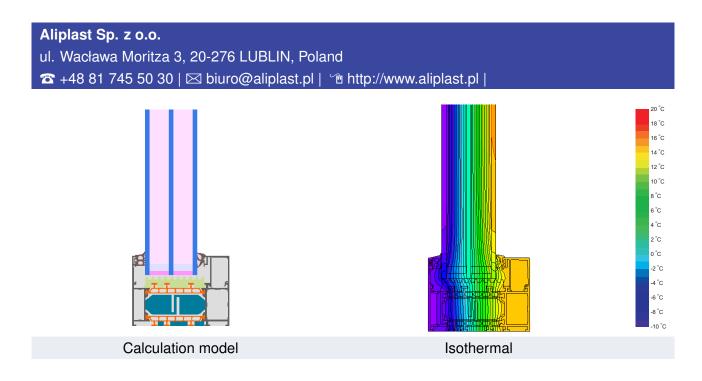

Description

Aluminium window frame with Low Lambda PA thermal break, 0.21 W/(mK). Insulated by XPS-foam 0.029 W/(mK) and PE-foam in the glazing rebate, 0.038 W/(mK). Pane thickness: 48 mm (4/18/4/18/4), rebate depth: 18 mm. Spacer: SWISSPACER Ultimate.

Explanation

The window U-values were calculated for the test window size of 1.23 m \times 1.48 m with $U_g = 0.70$ W/(m² K). If a higher quality glazing is used, the window U-values will improve as follows:


Glazing	$U_g =$	0.70	0.64	0.58	0.52	W/(m ² K)
		\downarrow	\downarrow	\downarrow	\downarrow	
Window	$U_W =$	0.79	0.75	0.70	0.65	W/(m ² K)


Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.


The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Validated installations

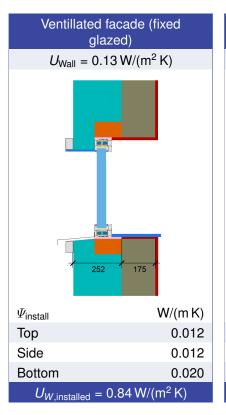

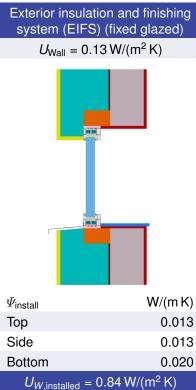

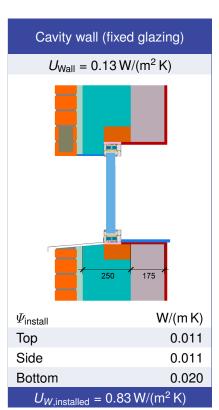

Frame value	es		Frame width <i>b_f</i> mm	<i>U</i> -value frame <i>U</i> f W/(m ² K)	Ψ -glazing edge Ψ_g W/(m K)	Temp. Factor f _{Rsi=0.25} [-]	
Mullion	(0M1)		90	0.72	0.029	0.77	
Mullion 1 casement	(1M1)	- 7	158	0.76	0.030	0.76	
Bottom fixed	(FB1)	1	65	0.79	0.029	0.76	
Top fixed	(FH1)	Τ.	65	0.79	0.029	0.76	
Lateral	(FJ1)		65	0.79	0.029	0.76	
	Spacer: SWISSPACER ULTIMATE			E Sec	Secondary seal: Polysulfide		

www.passivehouse.com