


# CERTIFICATE


Certified Passive House Component

Component-ID 1981cs07 valid until 31st December 2025

Passive House Institute  
Dr. Wolfgang Feist  
64283 Darmstadt  
Germany

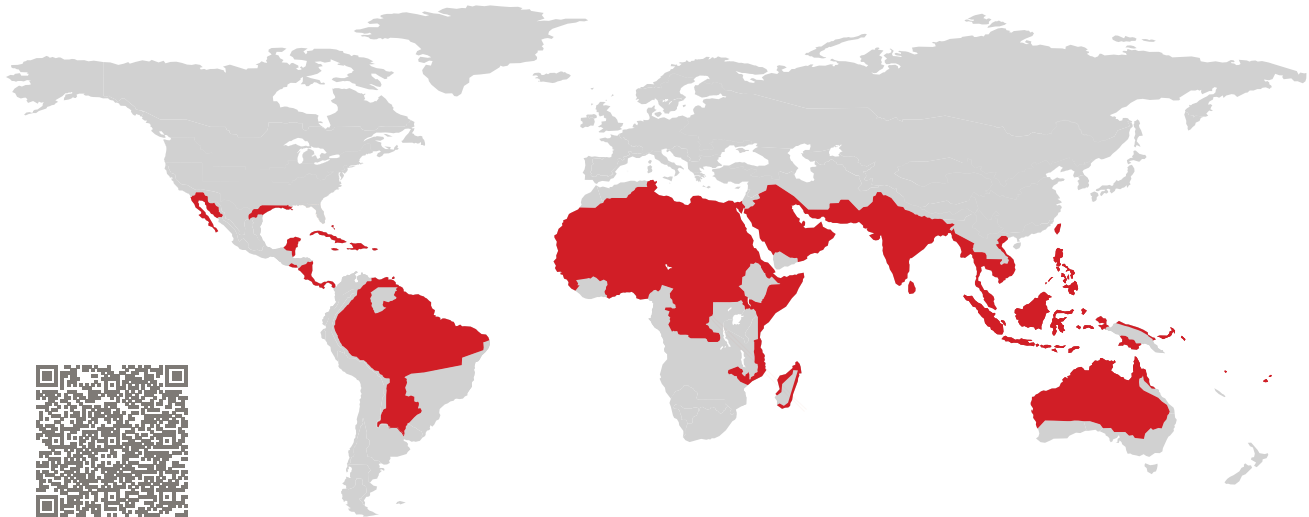

Category: **Construction system**  
Manufacturer: **Shekari Design Studios S.L.,  
Málaga,  
Spain**  
Product name: **Modular Passive House System VH**



## Comfort criterion

The U-value of the installed windows is

$$U_{wi} \leq 1.05 \text{ W}/(\text{m}^2 \text{ K})$$

## Efficiency criteria

Heat transfer coefficient of building envelope:

$$U * f_{PHI} \leq 0.25 \text{ W}/(\text{m}^2 \text{ K})$$

Temperature factor of opaque junctions:

$$f_{Rsi=0.25 \text{ m}^2 \text{ K}/\text{W}} \geq 0.82$$

Thermal bridge-free design for key connection details:

$$\Psi \leq 0.01 \text{ W}/(\text{m K})$$

An airtightness concept for all components and connection details was provided.

It was confirmed that the structure will dry out within 12 months and there is no risk of moisture-related damage.

very hot climate



**CERTIFIED  
COMPONENT**

Passive House Institute

## **Opaque building envelope**

The system is made of a main support layer made from steel tubing (120 mm x 120 mm) forming the modules with a fibre cement sandwich board on the outside. On the inside of this main support layer is an insulated installation layer made from gypsum fibre boards and standard drywall construction profiles. The main insulation layer is formed with a fibre cement sandwich panel with XPS insulation in-between the panels. For the floor a sandwich panel with insulation inside is used on the inside of the main support structure. The modules are placed on an insulated slab. The main support layer of the floor therefore does not contain any insulation. It is only placed below the concrete slab and in the sandwich panel on top of the main support layer. For the roof a sandwich panel is used on the top surface of the main support structure and additional insulation placed on top of this. The system is designed to be produced offsite and then carried onto the jobsite module by module. Through the construction with steel buildings with multiple stories are possible.




## **Windows**

Windows are placed half in the insulation layer and half in the main support structure layer. For the connection of the window to the main support structure a block of wood is used. For the certification a passive house suitable window was used. All calculation were carried out using a triple pane wood-aluminum window.




## **Airtightness concept**


Airtightness is ensured by using the fibre cement board on the outside of the main support layer. The connections of the modules and to the windows are to be sealed with airtight tape.

## Summary of values


Opaque assemblies	U-value W/(m <sup>2</sup> K)	Thickness mm
exterior wall (EW1) 	0.11	460
flat roof (FR1) 	0.12	396
floor slab (FS1) 	0.18	544


Frame Cuts with "dummy window - cold" from "dummy window manufacturer" (0001)


Frame values		Frame width $b_f$ mm	$U$ -value frame $U_f$ W/(m <sup>2</sup> K)	$\Psi$ -glazing edge $\Psi_g$ W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Bottom	(OB1) 	100	0.74	0.022	0.75
Top	(OH1) 	100	0.56	0.023	0.77
Lateral	(OJ1) 	100	0.56	0.023	0.77
Spacer: Super Spacer TriSeal / T-Spacer Premium Plus				Secondary seal: Butyl	

Junctions		U1	U2	$\Psi$ -value $\Psi$	Temp. factor $f_{Rsi=0.25}$
		W/(m <sup>2</sup> K)		W/(m K)	[-]
Ceiling integration into exterior wall (EW1_EW1_CE_1)		0.11	0.11	0.010	0.941
Exterior corner exterior wall (EW1_EW1_ec_1)		0.11	0.11	-0.062	0.878
Interior corner exterior wall (EW1_EW1_ic_1)		0.11	0.11	0.027	0.924
Internal wall integration into exterior wall (EW1_EW1_IW_1)		0.11	0.11	-0.001	0.924
Internal wall integration into exterior wall (EW1_EW1_IW_1)		0.11	0.11	0.009	0.924
Panel joint exterior wall (EW1_EW1_pj_1)		0.11	0.11	0.010	0.924
Roof parapet flat roof (EW1_FR1_rp_1)		0.11	0.12	-0.052	0.879
Window bottom operable window in exterior wall (EW1_OB1_2)		0.11	0.74	0.034	0.803
Window head operable window in exterior wall (EW1_OH1_1)		0.11	0.56	0.002	0.849
Window head operable window in exterior wall with shading box (EW1_OH1_sb_1)		0.11	0.56	0.027	0.841
Window jamb operable window in exterior wall (EW1_OJ1_1)		0.11	0.56	0.000	0.869
Panel joint flat roof (FR1_FR1_pj_1)		0.12	0.12	0.010	0.919
Exterior wall plinth on floor slab (FS1_EW1_1)		0.18	0.11	-0.076	0.903
Panel joint floor slab (FS1_FS1_pj_1)		0.18	0.18	0.001	0.953

## Opaque Assemblies

		Material		
		Lambda W/(m K)	Thickness (mm)	
<div style="display: flex; align-items: center;"> <div style="width: 20px; height: 20px; background-color: #800000; margin-right: 5px;"></div> <div> <p><b>exterior wall</b> (EW1)</p>  </div> </div>	fibre-cement board	0.350	12	
	Insulation 040	0.040	240	
	fibre-cement board	0.350	12	
	Insulation 040 + 1.0% steel	0.540	122	
	gypsum wall board acc. to DIN EN 12859 750 kg/r	0.350	12	
	Insulation 040	0.040	50	
	gypsum wall board acc. to DIN EN 12859 750 kg/r	0.350	12	
			Total thickness: 460 mm	
			Rsi: 0.13 m <sup>2</sup> K/W	
			Rse: 0.04 m <sup>2</sup> K/W	
		U-value: 0.11 W/(m <sup>2</sup> K)		

		Material		
		Lambda W/(m K)	Thickness (mm)	
<div style="display: flex; align-items: center;"> <div style="width: 20px; height: 20px; background-color: #800000; margin-right: 5px;"></div> <div> <p><b>flat roof</b> (FR1)</p>  </div> </div>	fibre-cement board	0.350	12	
	Insulation 040	0.040	240	
	fibre-cement board	0.350	12	
	Insulation 040 + 0.1% steel	0.090	120	
	gypsum wall board acc. to DIN EN 12859 750 kg/r	0.350	12	
			Total thickness: 396 mm	
			Rsi: 0.10 m <sup>2</sup> K/W	
			U-value: 0.12 W/(m <sup>2</sup> K)	


		Material		
		Lambda W/(m K)	Thickness (mm)	
<div style="display: flex; align-items: center;"> <div style="width: 20px; height: 20px; background-color: #800000; margin-right: 5px;"></div> <div> <p><b>floor slab</b> (FS1)</p>  </div> </div>	fibre-cement board	0.350	12	
	Insulation 040	0.040	40	
	fibre-cement board	0.350	12	
	air cavity - heat flow downwards + 0.0% steel	0.540	120	
	concrete (1 % steel)	2.300	200	
	Insulation 040	0.040	160	
			Total thickness: 544 mm	
			Rsi: 0.17 m <sup>2</sup> K/W	
		Rse: - m <sup>2</sup> K/W		
		U-value: 0.18 W/(m <sup>2</sup> K)		

Frame Cuts with "dummy window - cold" from "dummy window manufacturer" (0001)



Bottom

$b_f = 100 \text{ mm}$   
 $U_f = 0.74 \text{ W/(m}^2 \text{ K)}$   
 $\Psi_g = 0.022 \text{ W/(m K)}$   
 $f_{Rsi} = 0.75$



Top

$b_f = 100 \text{ mm}$   
 $U_f = 0.56 \text{ W/(m}^2 \text{ K)}$   
 $\Psi_g = 0.023 \text{ W/(m K)}$   
 $f_{Rsi} = 0.77$



Lateral

$b_f = 100 \text{ mm}$   
 $U_f = 0.56 \text{ W/(m}^2 \text{ K)}$   
 $\Psi_g = 0.023 \text{ W/(m K)}$   
 $f_{Rsi} = 0.77$





### Ceiling integration



into exterior wall  
(EW1\_EW1\_CE\_1)

$$U_{EW1} = 0.11 \text{ W}/(\text{m}^2 \text{ K})$$

$$U_{EW1} = 0.11 \text{ W}/(\text{m}^2 \text{ K})$$

$$\Psi = 0.010 \text{ W}/(\text{m K})$$

$$f_{Rsi} = 0.941$$



### Exterior corner



exterior wall (EW1\_EW1\_ec\_1)

$$U_{EW1} = 0.11 \text{ W}/(\text{m}^2 \text{ K})$$

$$U_{EW1} = 0.11 \text{ W}/(\text{m}^2 \text{ K})$$

$$\Psi = -0.062 \text{ W}/(\text{m K})$$

$$f_{Rsi} = 0.878$$



### Interior corner



exterior wall (EW1\_EW1\_ic\_1)

$$U_{EW1} = 0.11 \text{ W}/(\text{m}^2 \text{ K})$$

$$U_{EW1} = 0.11 \text{ W}/(\text{m}^2 \text{ K})$$

$$\Psi = 0.027 \text{ W}/(\text{m K})$$

$$f_{Rsi} = 0.924$$



### Internal wall integration



into exterior wall (EW1\_EW1\_IW\_1)

$$U_{EW1} = 0.11 \text{ W}/(\text{m}^2 \text{ K})$$

$$U_{EW1} = 0.11 \text{ W}/(\text{m}^2 \text{ K})$$

$$\Psi = -0.001 \text{ W}/(\text{m K})$$

$$f_{Rsi} = 0.924$$







### Internal wall integration



into exterior wall (EW1\_EW1\_IW\_1)

$$U_{EW1} = 0.11 \text{ W}/(\text{m}^2 \text{ K})$$

$$U_{EW1} = 0.11 \text{ W}/(\text{m}^2 \text{ K})$$

$$\Psi = 0.009 \text{ W}/(\text{m K})$$

$$f_{Rsi} = 0.924$$

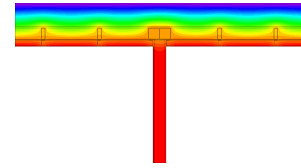

### Panel joint


exterior wall (EW1\_EW1\_pj\_1)

$$U_{EW1} = 0.11 \text{ W}/(\text{m}^2 \text{ K})$$

$$U_{EW1} = 0.11 \text{ W}/(\text{m}^2 \text{ K})$$

$$\Psi = 0.010 \text{ W}/(\text{m K})$$

$$f_{Rsi} = 0.924$$



### Roof parapet



flat roof (EW1\_FR1\_rp\_1)

$$U_{EW1} = 0.11 \text{ W}/(\text{m}^2 \text{ K})$$

$$U_{FR1} = 0.12 \text{ W}/(\text{m}^2 \text{ K})$$

$$\Psi = -0.052 \text{ W}/(\text{m K})$$

$$f_{Rsi} = 0.879$$



### Window bottom



operable window in exterior wall (EW1\_OB1\_2)

$$U_{EW1} = 0.11 \text{ W}/(\text{m}^2 \text{ K})$$

$$U_{OB1} = 0.74 \text{ W}/(\text{m}^2 \text{ K})$$

$$\Psi = 0.034 \text{ W}/(\text{m K})$$

$$f_{Rsi} = 0.803$$



### Window head

operable window in exterior wall (EW1\_OH1\_1)

$$U_{EW1} = 0.11 \text{ W}/(\text{m}^2 \text{ K})$$

$$U_{OH1} = 0.56 \text{ W}/(\text{m}^2 \text{ K})$$

$$\Psi = 0.002 \text{ W}/(\text{m K})$$

$$f_{Rsi} = 0.849$$





### Window head

operable window in exterior wall with shading box


(EW1\_OH1\_sb\_1)

$$U_{EW1} = 0.11 \text{ W}/(\text{m}^2 \text{ K})$$

$$U_{OH1} = 0.56 \text{ W}/(\text{m}^2 \text{ K})$$

$$\psi = 0.027 \text{ W}/(\text{m K})$$

$$f_{Rsi} = 0.841$$



### Window jamb



operable window in exterior wall (EW1\_OJ1\_1)

$$U_{EW1} = 0.11 \text{ W}/(\text{m}^2 \text{ K})$$

$$U_{OJ1} = 0.56 \text{ W}/(\text{m}^2 \text{ K})$$

$$\psi = 0.000 \text{ W}/(\text{m K})$$

$$f_{Rsi} = 0.869$$



### Panel joint



flat roof (FR1\_FR1\_pj\_1)

$$U_{FR1} = 0.12 \text{ W}/(\text{m}^2 \text{ K})$$

$$U_{FR1} = 0.12 \text{ W}/(\text{m}^2 \text{ K})$$

$$\psi = 0.010 \text{ W}/(\text{m K})$$

$$f_{Rsi} = 0.919$$



### Exterior wall plinth



on floor slab (FS1\_EW1\_1)

$$U_{FS1} = 0.18 \text{ W}/(\text{m}^2 \text{ K})$$

$$U_{EW1} = 0.11 \text{ W}/(\text{m}^2 \text{ K})$$

$$\psi = -0.076 \text{ W}/(\text{m K})$$

$$f_{Rsi} = 0.903$$



### Panel joint


floor slab (FS1\_FS1\_pj\_1)

$$U_{FS1} = 0.18 \text{ W}/(\text{m}^2 \text{ K})$$

$$U_{FS1} = 0.18 \text{ W}/(\text{m}^2 \text{ K})$$

$$\psi = 0.001 \text{ W}/(\text{m K})$$

$$f_{Rsi} = 0.953$$



Disclaimer: The Passive House Institute GmbH (PHI) carries out heat transfer analyses according to the standards set out in the document "[Criteria and Algorithms for Certified Passive House Components: Opaque Construction Systems](#)" and based on information provided by the manufacturer. It is the responsibility of the project leader, e.g. the architect to ensure the appropriate assessments have been carried out for specific buildings, which may include more detailed analyses than those carried out for this certification. Use of a certified Passive House component does not guarantee that a construction project will achieve the [Passive House, EnerPHit or PHI Low Energy Building standard](#). In all cases full details are to be made available by the manufacturer on request to the engaged certified Passive House designer or certifier, who will be permitted to check these against the construction information and to perform on-site checks as part of the quality assurance process.