
# **CERTIFICATE**

**Certified Passive House Component** 

Component-ID 2360wm04 valid until 31st December 2025

Passive House Institute Dr. Wolfgang Feist 64283 Darmstadt Germany

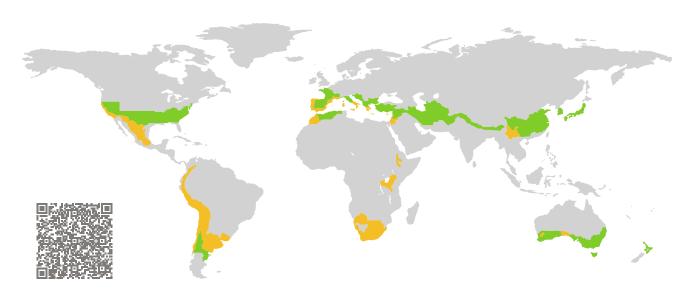

Category: Window mounting system

Manufacturer: CAJAISLANT GRUPO, S.L.U.,

Sentmenat,

**Spain** 

Product name: Cajaislant Premarco Térmico©

# This certificate was awarded based on the following criteria for the warm, temperate climate zone

Efficiency  $\Delta U \leq 0.05 \; W/(m^2 \cdot K)$ 


Hygiene  $f_{Rsi = 0.25} \geq 0.65$ 





#### **CAJAISLANT GRUPO, S.L.U.**

Torrent de Baiell, 38A-C, 08181 Sentmenat, Spain

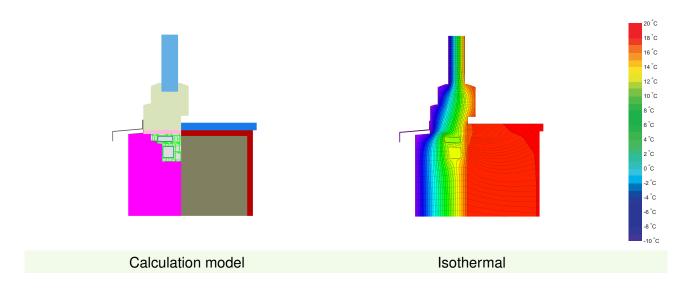

## **Description**

PVC window mounting system with steel reinforcement.

## **Explanation**


The certifiability is demonstrated by the increase of the heat transfer coefficient  $\Delta U$  [W/(m².K)] caused by the installation thermal bridge (efficiency criterion) in conjunction with given installation situations and window frames as well as by the minimum temperature factor at the coldest point of the installation connection (hygiene criterion).


The heat transfer coefficients (U-values) and the thermal bridge loss coefficients ( $\psi$ -values) of the window are determined on the basis of DIN EN ISO 10077-2, the installation thermal bridges according to ISO 10211.


The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

#### Validated installations

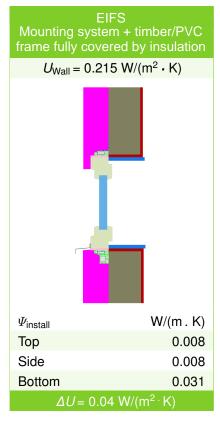

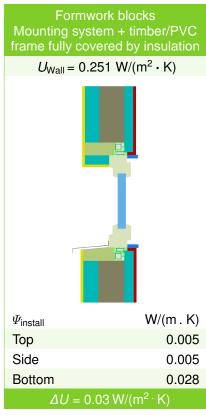

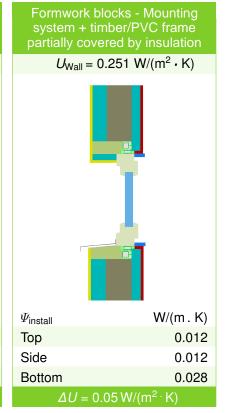

Frame valu	ıes		Frame width <i>b<sub>f</sub></i> mm	$U$ -value frame $U_f$ W/(m $^2$ K)	$\Psi$ -glazing edge $\Psi_g$ W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Bottom	(OB1)	Ļ	125	0.92	0.038	0.70
Тор	(OH1)	F	125	0.92	0.038	0.70
Lateral	(OJ1)	11	125	0.92	0.038	0.70
		Spacer: PHI phB-Spacer		Secondary seal: Polysulfide		

