
CERTIFICATE

Certified Passive House Component Component-ID 1645wi03 valid until 31st December 2025 Passive House Institute Dr. Wolfgang Feist 64283 Darmstadt Germany

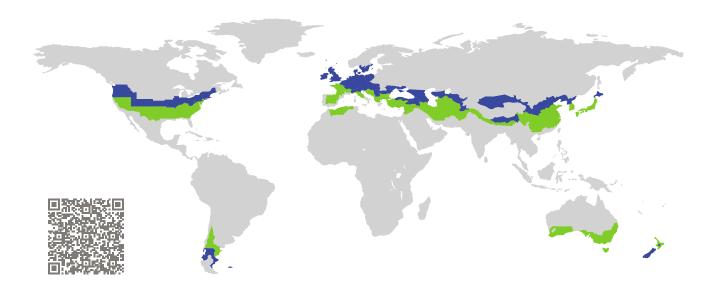



Category:	Window Frame			
Manufacturer:	Intelligent Windows,			
	Croydon, United Kingdom			
Product name:	Intelligent Windows Artemis			


This certificate was awarded based on the following criteria for the cool, temperate climate zone

Comfort	$U_W = 0.80$	\leq	0.80 W/(m ² K)
	$U_{W,\text{installed}}$	\leq	$0.85 W/(m^2 K)$
	with U_g	=	$0.70 W/(m^2 K)$

Hygiene $f_{Rsi=0.25}$ \geq 0.70



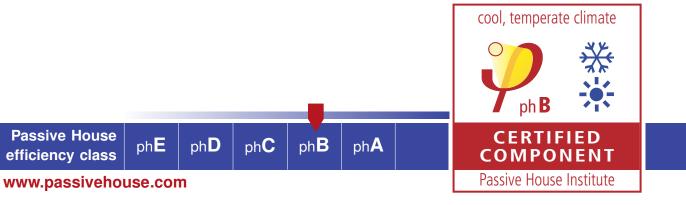

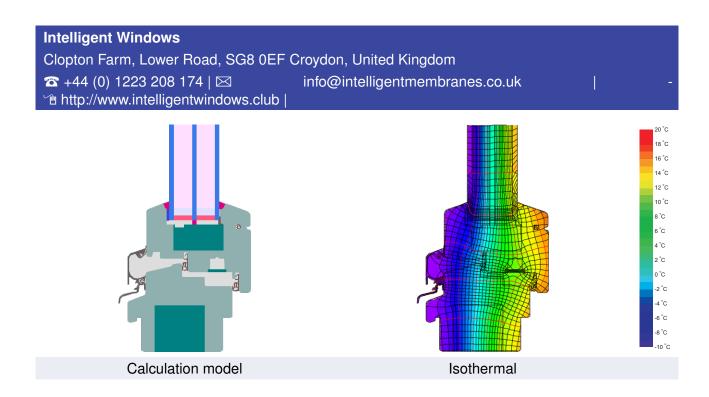

Description

Timber frame (spruce/fir 0,11 W/(mK)), insulated with Compacfoam 150 (0,043 W/(mK)). Aluminium weather protection profile. Pane thickness 44 mm (4/16/4/16/4), rebate depth 14 mm. Edge bond: TGI Precision with DOWSIL 3364 secondary seal.

Explanation

The window U-values were calculated for the test window size of 1.23 m \times 1.48 m with $U_g = 0.70$ W/(m² K). If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	$U_g =$	0.70	0.64	0.58	0.52	$W/(m^2 K)$
		\downarrow	\downarrow	\downarrow	\downarrow	
Window	$U_W =$	0.80	0.76	0.72	0.68	W/(m ² K)

Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Validated installations

Formwork blocks (operat	ole) Lightwe	eight timber (operable)		ation and finishing IFS) (operable)	
$U_{Wall} = 0.15 W/(m^2 K)$	Uwa	$_{all} = 0.13 W/(m^2 K)$		0.13 W/(m ² K)	
			, 25	0 175	
$\Psi_{install}$ W/	(mK) <i>Ψ</i> _{install}	W/(m K)	$\Psi_{install}$	W/(m K)	
Тор (0.000 Тор	0.009	Тор	0.004	
Side (0.000 Side	0.009	Side	0.004	
Bottom (0.028 Bottom	0.022	Bottom	0.034	
$U_{W,\text{installed}} = 0.82 \text{W}/(\text{m}^2)$	K) U _{W,ins}	$_{talled} = 0.83 W/(m^2 K)$	U _{W,installed} =	$U_{W,\text{installed}} = 0.83 \text{W}/(\text{m}^2 \text{K})$	
Frame values	Frame width <i>b_f</i> mm	U-value frame U _f W/(m ² K)	Ψ -glazing edge Ψ_g W/(m K)	Temp. Factor f _{Rsi=0.25} [-]	

Frame valu	Jes	b _f mm	U _f W/(m ² K)	Ψ_g W/(mK)	f _{Rsi=0.25} [-]
Bottom	(OB1)	130	0.90	0.022	0.75
Тор	(OH1)	115	0.81	0.022	0.75
Lateral	(OJ1)	115	0.81	0.022	0.75
Spacer: Technoform-Spacer SP16			Secondary seal: DOWSIL ™ 3364 Warm Edge IG Sealant		

www.passivehouse.com