


CERTIFICATE

Certified Passive House Component

Component-ID 1693wi04 valid until 31st December 2025

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

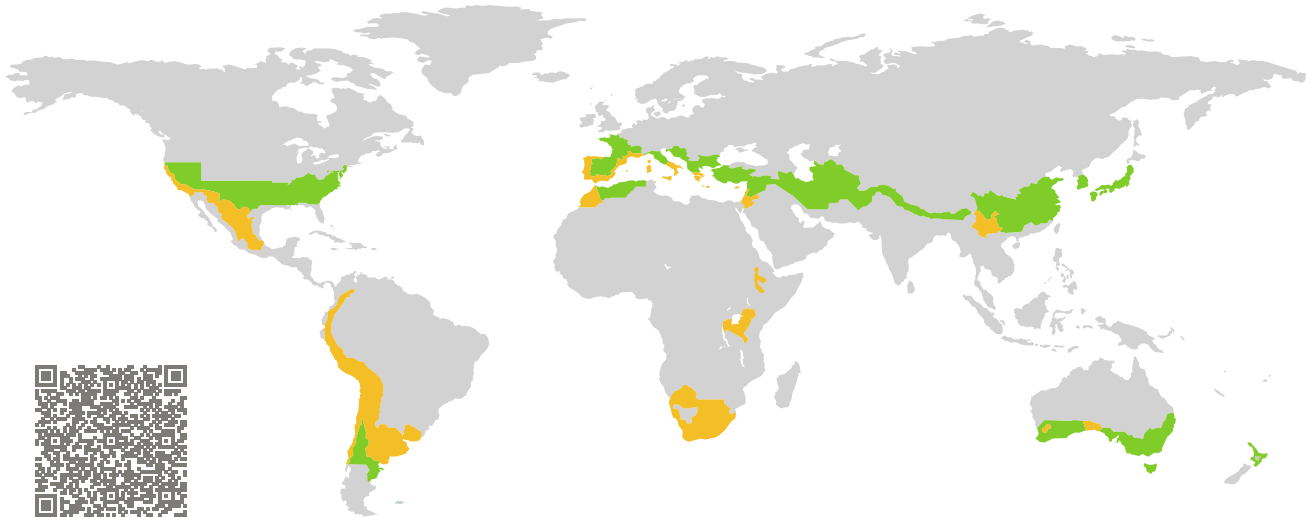


Category: **Window Frame**
Manufacturer: **BENITO SISTEMAS NOBLES DE CARPINTERIA SL,**
Navia,
Spain
Product name: **EBANIA MAX CLIMA M-92**


This certificate was awarded based on the following criteria for the warm, temperate climate zone

Comfort $U_{W=1.00} \leq 1.00 \text{ W}/(\text{m}^2 \text{ K})$
 $U_{W,\text{installed}} \leq 1.05 \text{ W}/(\text{m}^2 \text{ K})$
with $U_g = 0.90 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene $f_{Rsi=0.25} \geq 0.65$

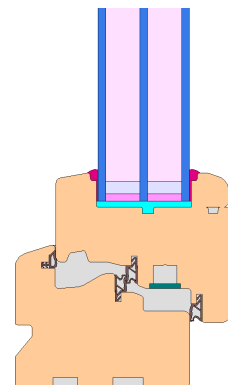

warm, temperate climate

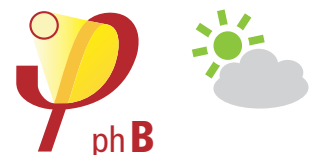

CERTIFIED COMPONENT

Passive House Institute

Passive House
efficiency class

phE


phD

phC

phB

phA

www.passivehouse.com

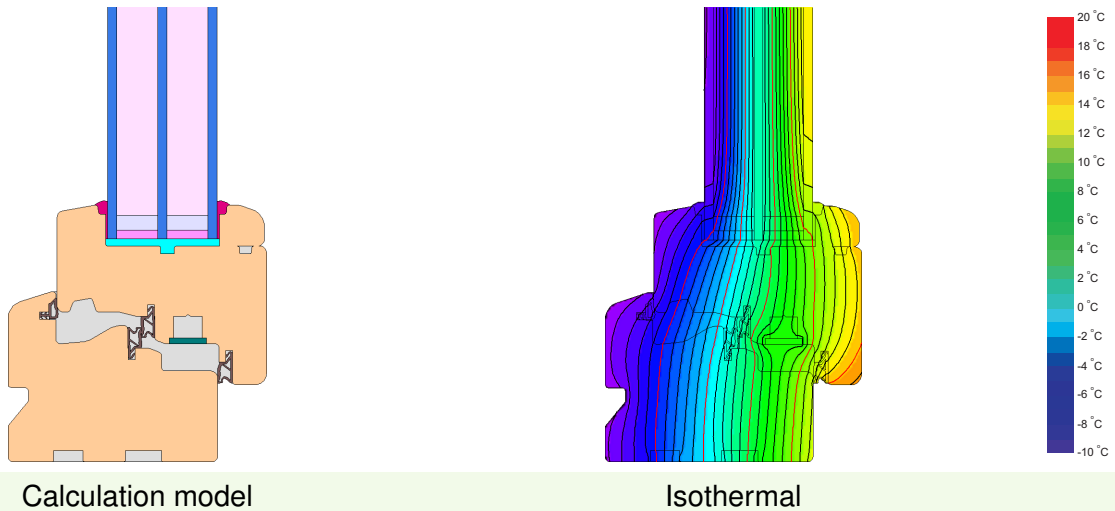

Calculation model Isothermal

Description

Timberframe (450kg/m³, 0.12 W/(mK)) with PU-foam rebate-filling. Pane thickness: 48 mm (4/18/4/18/4), rebate depth: 15 mm. Spacer: SWISSPACER Ultimate.

Explanation

The window U-values were calculated for the test window size of 1.23 m × 1.48 m with $U_g = 0.90$ W/(m² K). If a higher quality glazing is used, the window U-values will improve as follows:




Glazing	$U_g =$	0.90	0.70	0.64	0.62	W/(m ² K)
		↓	↓	↓	↓	
Window	$U_W =$	1.00	0.87	0.82	0.81	W/(m ² K)





Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

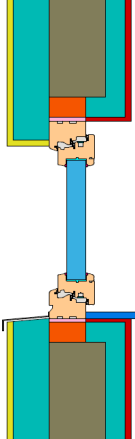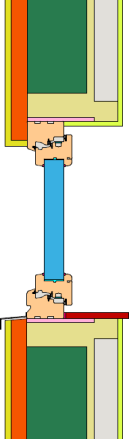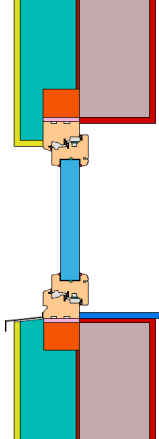Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Validated installations

Formwork blocks (operable)		Lightweight timber (operable)		Exterior insulation and finishing system (EIFS) (operable)	
$U_{\text{Wall}} = 0.23 \text{ W}/(\text{m}^2 \text{ K})$		$U_{\text{Wall}} = 0.22 \text{ W}/(\text{m}^2 \text{ K})$		$U_{\text{Wall}} = 0.23 \text{ W}/(\text{m}^2 \text{ K})$	
					
Ψ_{install}	W/(m K)	Ψ_{install}	W/(m K)	Ψ_{install}	W/(m K)
Top	0.000	Top	0.007	Top	-0.001
Side	0.000	Side	0.007	Side	-0.001
Bottom	0.018	Bottom	0.016	Bottom	0.015
$U_{W,\text{installed}} = 1.02 \text{ W}/(\text{m}^2 \text{ K})$		$U_{W,\text{installed}} = 1.03 \text{ W}/(\text{m}^2 \text{ K})$		$U_{W,\text{installed}} = 1.01 \text{ W}/(\text{m}^2 \text{ K})$	

Frame values			Frame width b_f mm	U -value frame U_f W/(m ² K)	Ψ -glazing edge Ψ_g W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Flying Mullion	(FM1)		130	1.05	0.027	0.68
Bottom	(OB1)		113	1.03	0.027	0.72
Top	(OH1)		113	1.02	0.027	0.72
Lateral	(OJ1)		113	1.02	0.027	0.72
Spacer: SWISSPACER ULTIMATE			Secondary seal: Polysulfide			

