


CERTIFICATE

Certified Passive House Component

Component-ID 1767wi03 valid until 31st December 2025

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

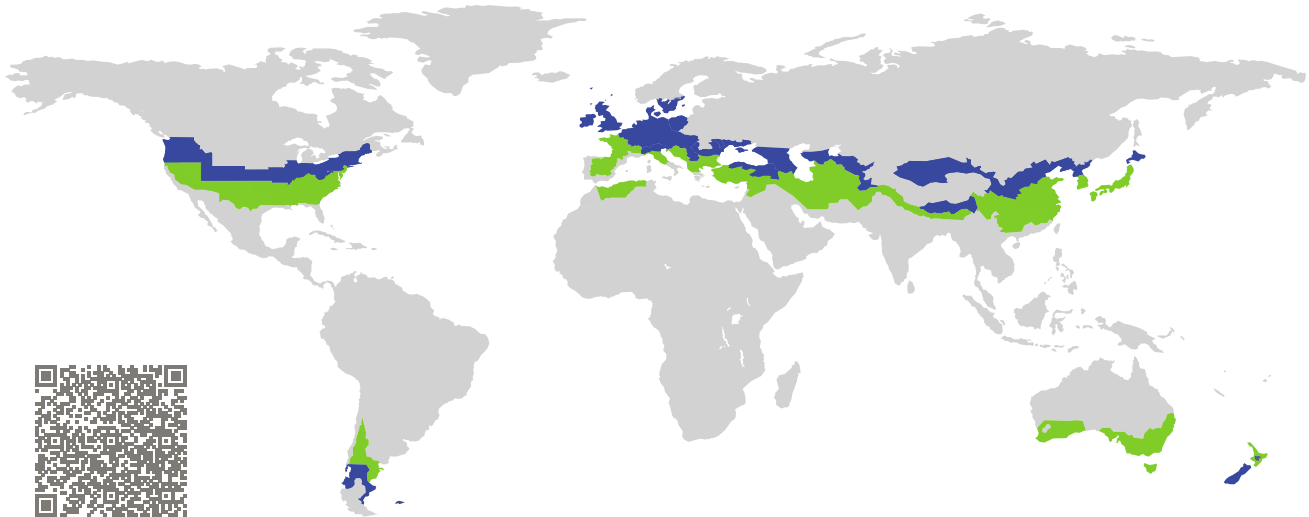


Category: **Window Frame**
Manufacturer: **Innotech Windows & Doors, Inc.,
Langley, BC,
Canada**
Product name: **Defender 88PH+ Pro Terrace Door**

**This certificate was awarded based on the following
criteria for the cool, temperate climate zone**

Comfort $U_W = 0.79 \leq 0.80 \text{ W/(m}^2 \text{ K)}$
 $U_{W, \text{installed}} \leq 0.85 \text{ W/(m}^2 \text{ K)}$
with $U_g = 0.70 \text{ W/(m}^2 \text{ K)}$

Hygiene $f_{Rsi=0.25} \geq 0.70$

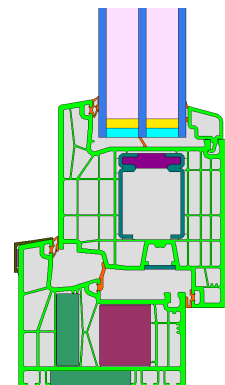

Passive House
efficiency class

phE

phD

phC

phB

phA


www.passivehouse.com

cool, temperate climate



**CERTIFIED
COMPONENT**

Passive House Institute

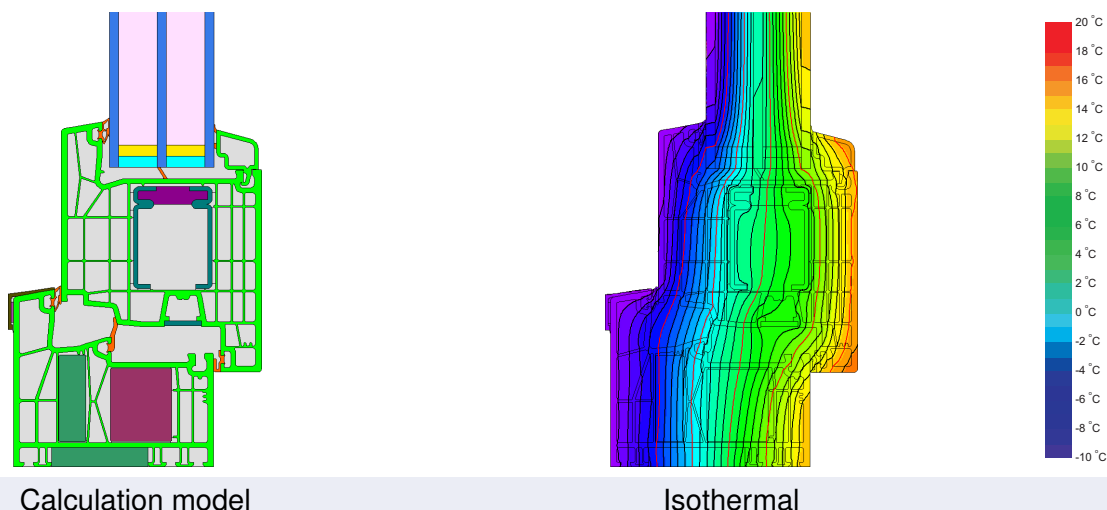

Description

PVC frame with steel reinforcement and EPS insulation. The maximum size of the window with this reinforcement is 1,31 m x 2,60 m. Pane thickness 46 mm (4/17/4/17/4), rebate depth 20 mm. Spacer: SuperSpacer Premium with butyl secondary seal. There are no limitations on colour.

Explanation

The window U-values were calculated for the test window size of 1.23 m × 1.48 m with $U_g = 0.70 \text{ W}/(\text{m}^2 \text{ K})$. If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	$U_g =$	0.70	0.64	0.58	0.54	$\text{W}/(\text{m}^2 \text{ K})$
		↓	↓	↓	↓	
Window	$U_w =$	0.79	0.75	0.72	0.69	$\text{W}/(\text{m}^2 \text{ K})$


Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.


The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.


Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Frame values			Frame width b_f mm	U -value frame U_f W/(m ² K)	Ψ -glazing edge Ψ_g W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Mullion 1 casement	(1M1)		275	0.77	0.022	0.75
Door hinge side	(DJ1)		166	0.77	0.022	0.74
Door lock side	(DL1)		166	0.82	0.022	0.74
Bottom	(OB1)		152	0.79	0.022	0.74
Head	(OH1)		166	0.76	0.022	0.75
Jamb	(OJ1)		166	0.79	0.022	0.74
Spacer: Super Spacer Premium			Secondary seal: Butyl			

Validated installations

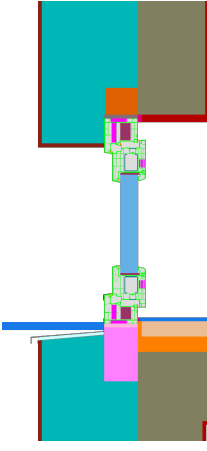Exterior insulation and finishing system (EIFS) (operable)	
$U_{Wall} = 0.14 \text{ W/(m}^2 \text{ K)}$	
	
$\Psi_{install}$	W/(m K)
Top	0.001
Side	0.001
Bottom	0.035
$U_{W,installed} = 0.81 \text{ W/(m}^2 \text{ K)}$	

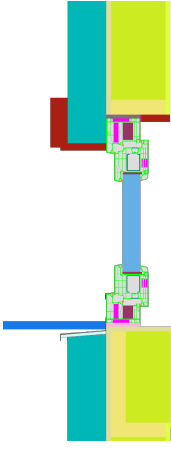Lightweight timber (operable)	
$U_{Wall} = 0.14 \text{ W/(m}^2 \text{ K)}$	
	
$\Psi_{install}$	W/(m K)
Top	0.003
Side	0.003
Bottom	0.037
$U_{W,installed} = 0.82 \text{ W/(m}^2 \text{ K)}$	

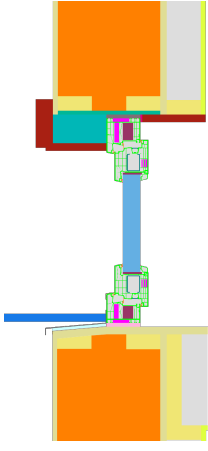Lightweight timber (operable) 2	
$U_{Wall} = 0.14 \text{ W/(m}^2 \text{ K)}$	
	
$\Psi_{install}$	W/(m K)
Top	0.010
Side	0.010
Bottom	0.035
$U_{W,installed} = 0.83 \text{ W/(m}^2 \text{ K)}$	

