


# CERTIFICATE

Certified Passive House Component

Component-ID 1869wi05 valid until 31st December 2025

Passive House Institute  
Dr. Wolfgang Feist  
64283 Darmstadt  
Germany

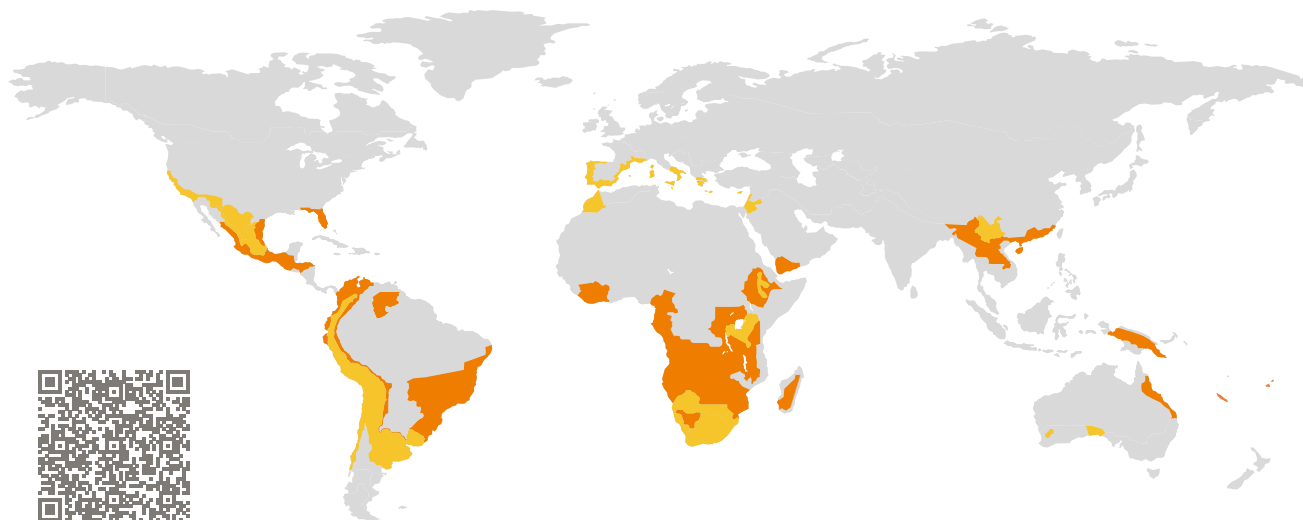


Category: **Window Frame**  
Manufacturer: **Firat Plastik ve Kauçuk San.Tic.AS.,  
Istanbul,  
Turkey**  
Product name: **Selenit 75**

**This certificate was awarded based on the following  
criteria for the warm climate zone**

Comfort  $U_W = 1.20 \leq 1.20 \text{ W}/(\text{m}^2 \text{ K})$   
 $U_{W, \text{installed}} \leq 1.25 \text{ W}/(\text{m}^2 \text{ K})$   
with  $U_g = 1.10 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene  $f_{Rsi=0.25} \geq 0.55$

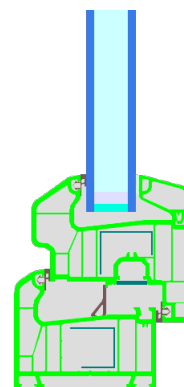

Passive House  
efficiency class

phE

phD

phC

phB

phA


[www.passivehouse.com](http://www.passivehouse.com)

warm climate




**CERTIFIED  
COMPONENT**

Passive House Institute

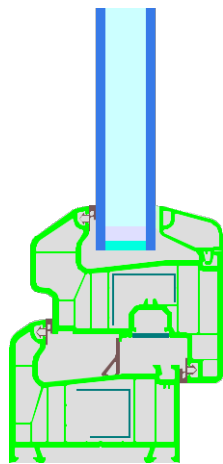

Calculation model

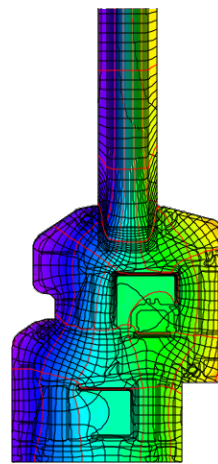

Isothermal

## Description

PVC frame with steel reinforcements. The maximum size of the window with this reinforcement is 1.23 m by 2.00 m. Pane thickness: 26 mm (4/18/4), rebate depth: 20 mm. Swisspacer Ultimate with butyl secondary seal. There is no limitation to the colour finishes.

## Explanation

The window U-values were calculated for the test window size of 1.23 m × 1.48 m with  $U_g = 1.10 \text{ W}/(\text{m}^2 \text{ K})$ . If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	$U_g =$	1.10	1.05	0.95	0.90	$\text{W}/(\text{m}^2 \text{ K})$
		↓	↓	↓	↓	
Window	$U_W =$	1.20	1.17	1.10	1.07	$\text{W}/(\text{m}^2 \text{ K})$

Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on [www.passivehouse.com](http://www.passivehouse.com) and [passipedia.org](http://passipedia.org).

## Validated installations

Formwork blocks (operable)		Lightweight timber (operable)		Exterior insulation and finishing system (EIFS) (operable)	
$U_{Wall} = 0.39 \text{ W}/(\text{m}^2 \text{ K})$		$U_{Wall} = 0.25 \text{ W}/(\text{m}^2 \text{ K})$		$U_{Wall} = 0.47 \text{ W}/(\text{m}^2 \text{ K})$	
$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)	$\Psi_{install}$	W/(m K)
Top	0.006	Top	0.007	Top	0.011
Side	0.006	Side	0.007	Side	0.011
Bottom	0.019	Bottom	0.020	Bottom	0.027
$U_{W,installed} = 1.23 \text{ W}/(\text{m}^2 \text{ K})$		$U_{W,installed} = 1.23 \text{ W}/(\text{m}^2 \text{ K})$		$U_{W,installed} = 1.25 \text{ W}/(\text{m}^2 \text{ K})$	

Frame values		Frame width $b_f$ mm	$U$ -value frame $U_f$ W/(m <sup>2</sup> K)	$\Psi$ -glazing edge $\Psi_g$ W/(m K)	Temp. Factor $f_{RSi=0.25}$ [-]
Mullion 1 casement	(1M1)	130	1.27	0.027	0.64
Bottom	(OB1)	113	1.21	0.028	0.66
Top	(OH1)	113	1.21	0.028	0.66
Lateral	(OJ1)	113	1.21	0.028	0.66
Spacer: SWISSPACER ULTIMATE			Secondary seal: Butyl		

