


# CERTIFICATE

Certified Passive House Component

Component-ID 2328wi03 valid until 31st December 2025

Passive House Institute  
Dr. Wolfgang Feist  
64283 Darmstadt  
Germany

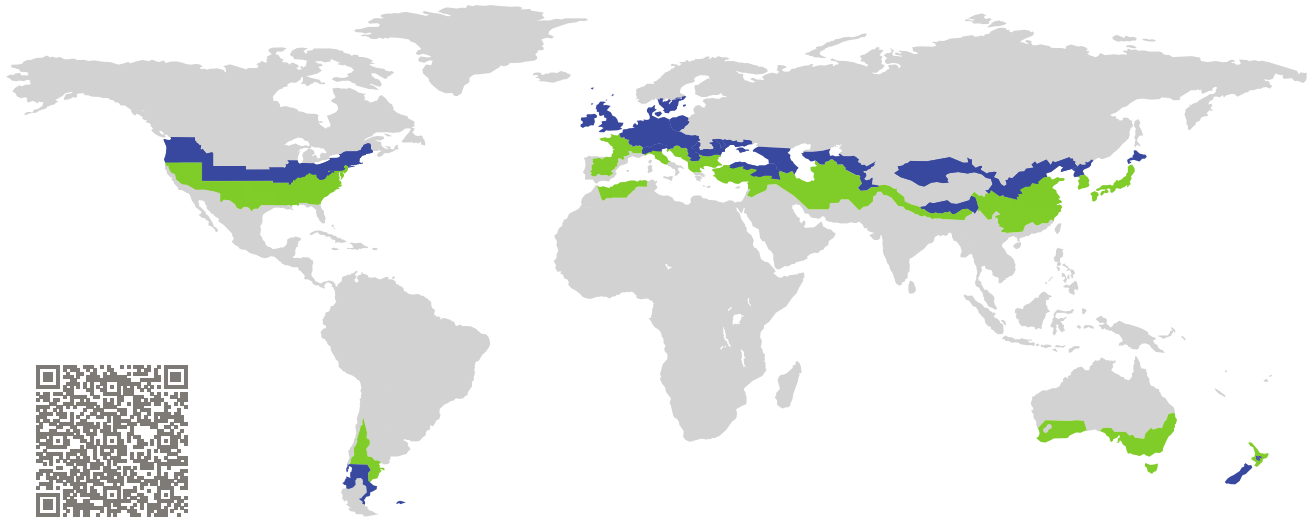


Category: **Window Frame**  
Manufacturer: **NZP Fenestration,  
Longueuil,  
Canada**  
Product name: **PassivCanada Cool operable**

**This certificate was awarded based on the following  
criteria for the cool, temperate climate zone**

Comfort  $U_W = 0.77 \leq 0.80 \text{ W}/(\text{m}^2 \text{ K})$   
 $U_{W, \text{installed}} \leq 0.85 \text{ W}/(\text{m}^2 \text{ K})$   
with  $U_g = 0.70 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene  $f_{Rsi=0.25} \geq 0.70$

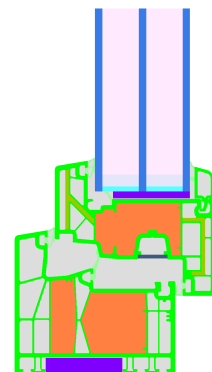

Passive House  
efficiency class

phE

phD

phC

phB

phA

[www.passivehouse.com](http://www.passivehouse.com)

cool, temperate climate




ph B



**CERTIFIED  
COMPONENT**

Passive House Institute

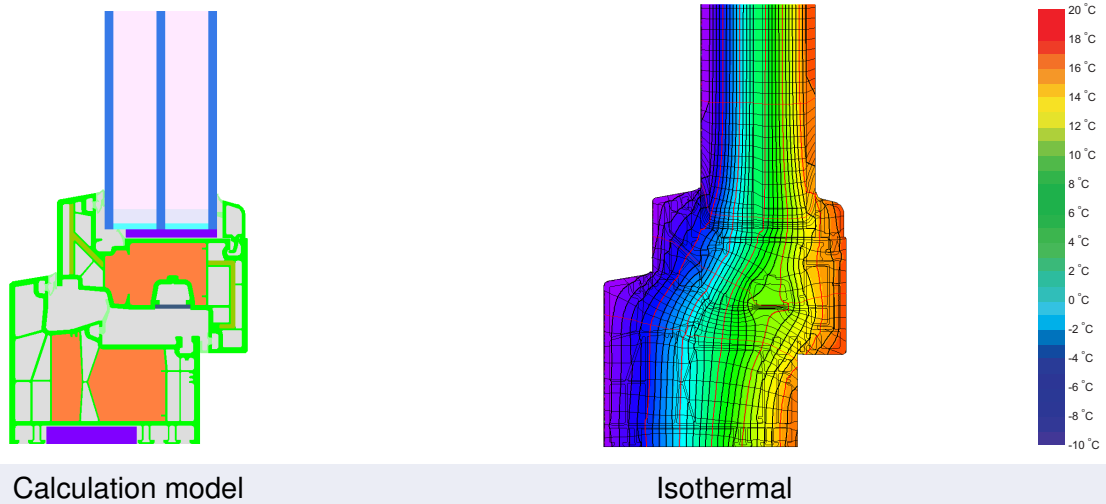

**Description**

PVC frame with Ultradur reinforcement in the sash. Walltite insulation (0.034 W/(mK)) inside the cavities. Secondary seal in accordance with supplier data sheet, max. size 1.30 m x 1.70 m (white) or up to 1.00 m width in standard colors (see static table) in technical documents. Pane thickness: 52 mm (4/20/4/20/4), glass inset: 15 mm. Secondary sealant in accordance to technical documents

**Explanation**

The window U-values were calculated for the test window size of 1.23 m × 1.48 m with  $U_g = 0.70 \text{ W}/(\text{m}^2 \text{ K})$ . If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	$U_g =$	0.70	0.64	0.58	0.54	W/(m <sup>2</sup> K)
		↓	↓	↓	↓	
Window	$U_W =$	0.77	0.72	0.68	0.66	W/(m <sup>2</sup> K)

Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on [www.passivehouse.com](http://www.passivehouse.com) and [passipedia.org](http://passipedia.org).

# Validated installations

**Lightweight timber (operable)**

$U_{Wall} = 0.14 \text{ W}/(\text{m}^2 \text{ K})$

$\Psi_{install}$   $\text{W}/(\text{m K})$

Top	0.017
Side	0.011
Bottom	0.015

$U_{W,installed} = 0.81 \text{ W}/(\text{m}^2 \text{ K})$

**Solid timber (operable)**

$U_{Wall} = 0.14 \text{ W}/(\text{m}^2 \text{ K})$

$\Psi_{install}$   $\text{W}/(\text{m K})$

Top	0.020
Side	0.014
Bottom	0.013

$U_{W,installed} = 0.81 \text{ W}/(\text{m}^2 \text{ K})$

**Exterior insulation and finishing system (EIFS) (operable)**

$U_{Wall} = 0.13 \text{ W}/(\text{m}^2 \text{ K})$

$\Psi_{install}$   $\text{W}/(\text{m K})$

Top	0.010
Side	0.010
Bottom	0.014

$U_{W,installed} = 0.80 \text{ W}/(\text{m}^2 \text{ K})$

Frame values		Frame width $b_f$ mm	$U$ -value frame $U_f$ $\text{W}/(\text{m}^2 \text{ K})$	$\Psi$ -glazing edge $\Psi_g$ $\text{W}/(\text{m K})$	Temp. Factor $f_{Rsi=0.25}$ [-]
Mullion 1 casement	(1M1)	136	0.73	0.022	0.75
Mullion 2 casements	(2M1)	174	0.81	0.022	0.79
Bottom	(OB1)	116	0.76	0.019	0.80
Top	(OH1)	116	0.76	0.019	0.80
Lateral	(OJ1)	116	0.76	0.019	0.80

Spacer: SWISSPACER ULTIMATE      Secondary seal: Hotmelt Butyl

