


CERTIFICATE

Certified Passive House Component

Component-ID 0193ed03 valid until 31st December 2025

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

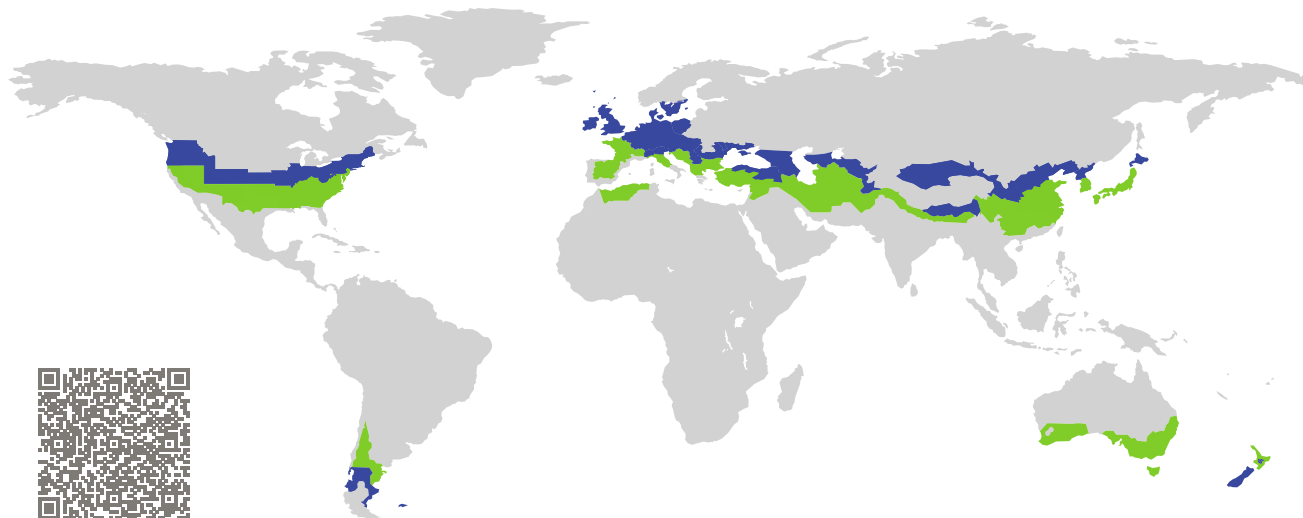


Category: **Entry door(with glas section)**
Manufacturer: **Rehau Industries SE & Co. KG
Erlangen
Germany**
Product name: **Haustür GENE0 PHZ, mit Füllung
Rodenberg zweiseitig
flügelüberdeckend**

**This certificate was awarded based on the following
criteria for the cool, temperate climate zone**

Comfort $U_D = 0.64 \leq 0.80 \text{ W}/(\text{m}^2 \text{ K})$
 $U_{D,\text{installed}} \leq 0.85 \text{ W}/(\text{m}^2 \text{ K})$
with $U_{\text{door leaf}}^1 = 0.33 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene $f_{Rsi=0.25} \geq 0.70$

¹U-value of the insulated area of door leaf

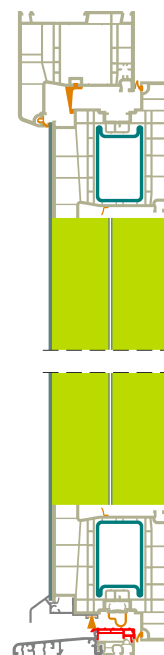


(Inward opening)

cool, temperate climate



**CERTIFIED
COMPONENT**

Passive House Institute

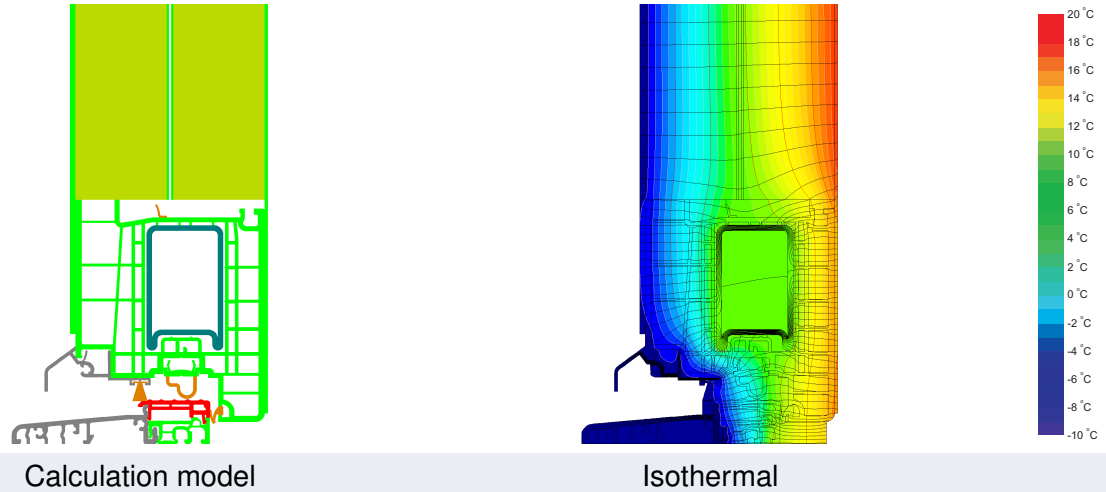

Description

Door frame made of PVC profiles; partially with reinforcing steel profiles; Door leaf (thickness 90 mm) covered by PVC panels on both sides; door leaf insulation (thickness 86 mm): PU-foam 0.030 W/(mK); threshold: thermally separated aluminum profile, the temperature factor requirement is not met at the threshold

Explanation


The U-values of the door apply to a door 1.10 m wide by 2.20 m tall.


A detailed report of the calculations performed in the context of certification is available from the manufacturer.

Unless stated otherwise, the air tightness was determined according to EN 1026 with respect to the joint length under climate load in conjunction with EN 1121 for the closed, non-locked door. The result corresponds at least to air-tightness class 3 according to EN 12207.



The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.


Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

| Frame values | | Frame width b_f mm | U -value frame U_f W/(m ² K) | Ψ edge Ψ_g W/(m K) | Temp. Factor $f_{Rsi=0.25}$ [-] |
|-----------------|---|----------------------------|---|------------------------------------|---------------------------------------|
| Door hinge side | (DJ1)  | 153 | 1.12 | 0.000 | - |
| Door lock side | (DL1)  | 153 | 1.12 | 0.000 | - |
| Top | (OH1)  | 153 | 1.12 | 0.000 | - |
| Threshold | (OT2)  | 111 | 1.48 | 0.000 | - |
| | | Spacer: | Secondary seal: | | |



 Door hinge side


$b_f = 153 \text{ mm}$
 $U_f = 1.12 \text{ W/(m}^2 \text{ K)}$
 $\Psi_g = 0.000 \text{ W/(m K)}$
 $f_{Rsi} = -$



 Door lock side


$b_f = 153 \text{ mm}$
 $U_f = 1.12 \text{ W/(m}^2 \text{ K)}$
 $\Psi_g = 0.000 \text{ W/(m K)}$
 $f_{Rsi} = -$



 Top

$b_f = 153 \text{ mm}$
 $U_f = 1.12 \text{ W/(m}^2 \text{ K)}$
 $\Psi_g = 0.000 \text{ W/(m K)}$
 $f_{Rsi} = -$





 Threshold

$b_f = 111 \text{ mm}$
 $U_f = 1.48 \text{ W/(m}^2 \text{ K)}$
 $\Psi_g = 0.000 \text{ W/(m K)}$
 $f_{Rsi} = -$

Door with glass section/infill

| Glazing/Infill: None | |
|---|--|
| $U_p = 0.50 \text{ W/(m}^2 \text{ K)}$ $\Psi = 0.033 \text{ W/(m K)}$ $f_{Rsi} = -$ |  <p>The image contains two side-by-side diagrams. On the left is a technical cross-section of a door assembly. It shows a green door frame at the bottom, a pink glass pane in the middle, and blue vertical elements representing the infill. On the right is a thermal simulation of the same door assembly, showing a color gradient from blue (cooler) to red (warmer) across the door and frame, indicating heat flow patterns.</p> |
| Description: | <p>Glazing (pane structure: 4*/23Ar/4/23Lu/4/23Ar/*4) with $U_g = 0.50 \text{ W/(m}^2 \text{ K)}$ according to EN 673; Spacer: "Super Spacer TriSeal"</p> <p>The comfort criterion limits the use of the infill element as follows: Maximum area= 1.17 m^2 Maximum circumference= 4.90 m</p> |

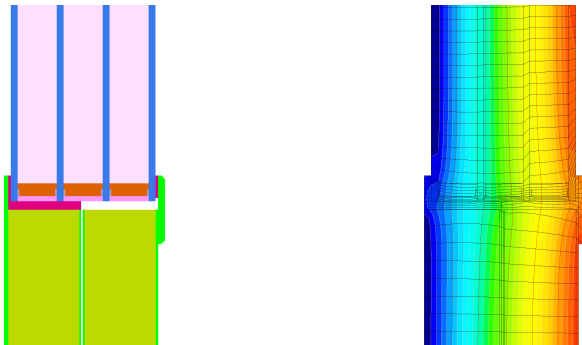